

---

# LPCB Red Book



# 1

## Part: 4 Fixed fire fighting systems

---

bre

## Introduction

BRE Global Ltd, based in the UK near London, is an independent third party organisation offering certification of fire, security and sustainability products and services to an international market. LPCB is the certification brand used for fire and security products and services. The LPCB mark is accepted worldwide. We have representative offices in China, India and Dubai. We are owned by the BRE Trust, a not-for-profit organisation.

LPCB listings can be accessed, free of charge, at [www.redbooklive.com](http://www.redbooklive.com).

BRE Global additionally carries out:

- Fire Investigation
- Fire Risk Assessment
- Fire Safety Engineering
- Research
- Training

## LPCB Listings

Listings are given in sections which list related groups of products and services such as suppression, security and so on. Each section also summarises the technical basis for the certification of each product or service. The Red Book listings should always be used in conjunction with rules, regulations and design specifications required by the relevant Authority having jurisdiction.

Listings comprise:

### Volume 1: (This Volume)

- **Fire detection and alarm products, systems, and cables**
- **Manual fire extinguishing equipment**
- **Automatic sprinkler, water spray and deluge systems**
- **Fixed fire fighting products and systems**
- **Watermist systems**
- **Related installers**


### Volume 2:

- Passive fire protection products
- Security protection products
- Fire doors and shutters
- Smoke and fire ventilation systems
- Security Assessments - SABRE
- Related installers
- Management Systems
- Construction products

Listings are given in the name of the manufacturer or service provider, in alphabetical order. They can be downloaded free of charge from our website at [www.redbooklive.com](http://www.redbooklive.com)

## Updates

Certification of products and services are updated regularly. To ensure that you are using the most up to date information please refer to [www.redbooklive.com](http://www.redbooklive.com).

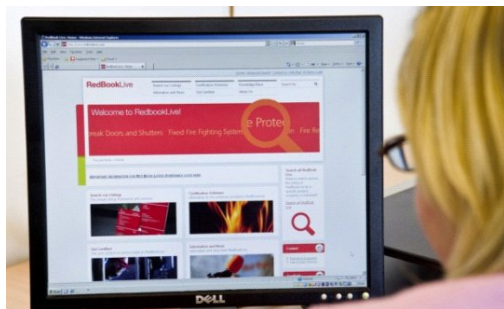

## What is Third Party Certification?

A frequent concern of stakeholders is in knowing whether a product will perform in accordance with the stated specifications. These concerns can involve such product attributes as safety, health or environmental impacts, durability, compatibility, suitability for intended purposes or for stated conditions, and other similar considerations. These issues can all be addressed through product certification.

Third party certification is a conformity assessment process, carried out by a body that is independent of both supplier and customer organisations. It provides confirmation that products and services have met and will continue to meet the requirements of specified standards and other normative documents.

LPCB third party product certification schemes are quality assurance schemes and comprise initial type testing and technical evaluation, assessment and surveillance of the manufacturer's quality system and factory production procedures, regular audit testing, labelling and listing.

Similarly, LPCB schemes for suppliers of services (installers) are also quality assurance schemes comprising a technical assessment of an installer's capability, assessment and surveillance of the installer's quality system and production procedures, regular inspection of completed installations and listing.

## Benefits of Third Party Certification

For specifiers, regulators, insurers, manufacturers and installers, the benefits of an LPCB approval are:

### For specifiers and regulators:

- Risk reduction - specifying LPCB approved products and services demonstrates due-diligence and best endeavour and mitigates against possible accusations of negligence.
- Avoidance of costly mistakes - you can trust LPCB approved products and services to conform each and every time.
- Time - using Red Book Live to search for and assess products and services can save you time.

### For manufacturers and installers:

- Increased global sales - LPCB approval is recognised and specified widely throughout the world. In some territories LPCB approval is a mandatory requirement.
- Added value of the product or service - LPCB approved products and services are recognised as providing added value given their ability to conform each and every time.
- Reduced liability - LPCB approved products and services demonstrate due-diligence which can reduce liability for both you and your customers.

## What does LPCB Certification offer?

LPCB certification is carried out against Loss Prevention Standards (LPS's). These LPS's include reference to BS, EN or ISO standards as appropriate. LPCB certification are level 5 schemes as detailed in ISO/ IEC 17067 with the added requirement to have a quality system certificated to ISO 9001.

The technical requirements of LPCB schemes are given in the Loss Prevention Standards (LPSs). These documents are drafted by LPCB technical experts in conjunction with appropriate external experts. They are then peer reviewed by representatives from trade bodies, regulators, insurers, specifiers, manufacturers and other suppliers. Finally these documents are approved for use by the BRE Global Governing Body; the Body that oversees all of the certification activities of BRE Global.

## VOLUME 1 LIST OF APPROVED PRODUCTS AND SERVICES

### Product schemes comprise:

- Initial type testing and evaluation of product.
- Approval and surveillance of the manufacturer's (or supplier's) quality management system to ISO 9001
- Assessment and surveillance of the manufacturer's (or supplier) factory production control system (FPC).
- Periodic audit testing of the product from either the factory or marketplace.
- Labelling or marking as appropriate.
- Listing on Red Book Live

### Installer schemes comprise:

- Technical assessment of the installation contractor's capability.
- Approval and surveillance of the contractor's quality management system to ISO 9001 or assessment against the requirements of the relevant Loss Prevention Standard where ISO 9001 is not appropriate.
- Regular surveillance inspections of on-going installations.
- The issue of Certificates of Conformity by the installer to demonstrate compliance for each installation.
- Listing in the Red Book.

### **The LPCB Mark - the Mark you can trust**

After certification of a product or service the manufacturer or service provider may place the LPCB certification mark, as shown below, on the product, packaging and literature etc.



Where LPCB holds accreditation through the United Kingdom Accreditation Service (UKAS), the certified company may include the UKAS symbol (the Crown and Tick) alongside the LPCB mark for certain applications e.g. promotional literature or material and stationery, as shown below.



(Full details of LPCB accreditation can be found on the UKAS website at [www.ukas.com](http://www.ukas.com))

Where for reasons of space or cost the use of the above full mark is not practical, then the following simplified mark may be applied directly to the product (for some schemes only). The LPCB scheme rules define how and where the marks can be used.



<b>4 Fixed fire fighting systems</b>	<b>1</b>
SECTION 1 LPS 1204 certificated gas extinguishing system firms	3
SECTION 2.1 Gaseous system components	8
SECTION 2.2 Gaseous systems	68
SECTION 3 Fixed fire extinguishing systems for catering equipment	81
SECTION 4 Direct low pressure (DLP) application systems	89
SECTION 5 Condensed aerosol extinguishing generators	100

## INDEX

<b>A</b>			
AIR Fire S.p.A.	8, 81, 89		
Alberta Fire & Security Equipment Limited	3		
Amerex Corporation	82		
Ansul Incorporated	82		
<b>B</b>			
Buckeye Fire Equipment	83		
<b>C</b>			
Carrier Airconditioning & Refrigeration Ltd	8, 68		
Ceasefire Industries Pvt. Ltd	12, 68, 83, 90		
Ceodeux Extinguisher Valves Technology S.A. (ROTAREX FIRETEC)	13, 84		
Chubb Fire & Security Ltd t/a Chubb Mechanical	3		
Clymac Limited	4		
<b>E</b>			
EA-RS Fire Engineering Limited	4		
EKC International FZE	91		
Emirates Fire Fighting Equipment Factory L.L.C. (FIREX)	84		
Eurotech Fire Protection Ltd, in collaboration with Firetec Systems Ltd	14, 69		
<b>F</b>			
Fike Safety Technology Ltd	18, 71		
Finder Yangin Güvenlik Elektronik Sistemler A.Ş	85		
Fire Eater A/S	23, 72		
Fireater	72		
Firecheck Contracts Limited	4		
FirePro Systems Limited	100		
Firetrace International LLC	93		
Firetrace Limited	94		
FiWaRec Valves & Regulators GmbH & Co. KG	25		
<b>G</b>			
G.B. Electronics Limited trading as GBE Converge	4		
Gemini AMPM Ltd	4		
<b>H</b>			
Haci Ayvaz End. Mam. San. Ve Tic. A.S.	27		
Hall & Kay Fire Services Limited trading as Hall & Kay Fire Engineering (Ascot)	5		
<b>I</b>			
Interserve FS (UK) Limited	5		
<b>J</b>			
Jactone Products Limited	85, 94		
<b>K</b>			
Kidde Fire Protection	28, 73		
Kidde-Fenwal, Inc.	39, 76		
<b>L</b>			
Lehavot Production & Protection (1995) Ltd	85		
LPG Técnicas En Extinción De Incendios, S.L.	77		
<b>M</b>			
Macron Safety Systems (UK) Ltd	42, 78, 95		
Mercury Engineering	5		
MOBIAK S.A.	86		
<b>N</b>			
NAFFCO FZ Co	95		
<b>P</b>			
Protec Camerfield Limited (Firepro Division)	5		
<b>R</b>			
Regulus Fire Systems	97		
Resguardo Industries Pvt Ltd	98		
RG Green Systems	58		
<b>S</b>			
Safety Hi-Tech Srl	61		
Siemens Plc, Smart Infrastructure (Regional Solutions & Service)	5		
Siemens Switzerland Limited	62		
Spectrum Fire Protection (UK) Limited	6		
Spoon2 International Limited	86		
Steel Recon Industries Sdn Bhd	87		
<b>T</b>			
Telesto Sp. z o.o.	88		
Thorn Security Limited	79		
Trinity Fire & Security Systems Limited	6		
Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)	6, 7, 65, 79		
Tyco Safety Products (Great Yarmouth)	80		
<b>U</b>			
Ultra Surefire Limited	7		
<b>V</b>			
Vipond Fire Protection Limited	7		
<b>W</b>			
Watermist Ltd	88		
WIKA Alexander Wiegand SE & Co. KG	66		

*Part*

*4*

*FIXED FIRE FIGHTING  
SYSTEMS*

# **PART 4: FIXED FIRE FIGHTING SYSTEMS**

## **INTRODUCTION**

The fixed fire extinguishing systems included in this section are for the protection of specific risks, e.g. computer rooms, switch gear, high risk production lines, commercial kitchen protection systems etc.

Great care must be taken in the choice of fire extinguishing agent with respect to life safety, damage to equipment from bi-products, venting and the time it takes to have the system operational again after a discharge incident.

In addition to careful product/system selection it is recommended that all systems are designed, installed and commissioned by third party approved contractors who have demonstrated their competence.

Listings in this section include:

### **Products**

- Condensed aerosol extinguishing generators
- Direct low pressure (DLP) application systems
- Fine water spray components
- Fixed fire extinguishing systems for catering equipment
- Gaseous system components
- Gaseous systems

Products are approved in accordance with a range of standards, the details of which are given at the front of each section relevant to the product.

### **Design, installation and commissioning contractors**

LPS 1204: Requirements for contractors engaged in the design, installation and commissioning of fixed fire systems.



The purpose of LPS 1204 scheme, *Requirements for firms engaged in the design, installation, commissioning and servicing of gas extinguishing systems*, is to provide an assurance that gas extinguishing systems perform correctly. It is recommended that the LPS 1204 Certificated Firm is given responsibility for the complete system, including the following aspects:

- Selection of appropriate gas type
- Extinguishing design concentration
- Check on enclosure leakage integrity
- Discharge and post discharge venting
- Electrical system integration

**Certification of Fixed Systems and LPCB Certificates of Conformity**

It is a requirement of the LPS 1204 scheme that Certificated Firms shall issue an LPCB Certificate of Conformity in respect of each completed system, extension and alteration. The issue of an LPCB Certificate of Conformity:

(a) certifies that the gas extinguishing system, extension or alteration has been designed, installed and commissioned in accordance with the recognised standards identified in LPS 1204 and

(b) ensures that the certificated system, extension and alteration is recorded by the LPCB.

**LPCB Inspections**

LPS 1204 Certificated Firms are regularly audited for their competence to design, install, commission and service gas extinguishing systems in accordance with recognised installation standards.

**Additional Offices**

Where a firm has additional offices, each office must meet the requirements of LPS 1204 to be eligible for certification, and is separately listed.

**Provisional Approval**

Firms with limited experience and track record can gain Provisional Approval in the LPS 1204 scheme. Their work is closely monitored by LPCB and when they have completed the requisite number of gas extinguishing systems contracts over a period of not less than two years, and subject to satisfactory performance, they will be given full approval and listed in this section of the Red Book.

---

**Alberta Fire & Security Equipment Limited**

San Gwakkın Road, Mriehel, BKR 3000, Malta

Tel: +356 21 443538 • Fax: +356 21 484077

E-mail: [enquiries@alberta.com.mt](mailto:enquiries@alberta.com.mt) • Website: [www.alberta.com.mt](http://www.alberta.com.mt)

**Certificate No. CFSI-017 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

**Chubb Fire & Security Ltd t/a Chubb Mechanical**

Littleton Road, Ashford, Middlesex TW15 1TZ, United Kingdom

Tel: +44 (0)1784 425950

E-mail: [mechanical@chubb.co.uk](mailto:mechanical@chubb.co.uk) • Website: [www.chubb.co.uk](http://www.chubb.co.uk)

**Certificate No. CFSI-026 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

## **PART 4: SECTION 1**

LPS 1204 CERTIFICATED GAS EXTINGUISHING SYSTEM FIRMS

---

### **Clymac Limited**

Cloudway Court, Belton Road, Loughborough LE11 1LW, United Kingdom

Tel: +44 (0)1509 232651 • Fax: +44 (0)1509 232665

E-mail: sales@clymac.co.uk • Website: www.clymac.co.uk

**Certificate No. CFSI-018 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **EA-RS Fire Engineering Limited**

4 Swanbridge Industrial Park, Black Croft Road, Witham, Essex CM8 3YN, United Kingdom

Tel: +44 (0)1376 503680

E-mail: onesolution@ea-rsfire.com • Website: www.ea-rsfire.com

**Certificate No. CFS1-021 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **Firecheck Contracts Limited**

53 Huntercombe Lane North, Burnham SL1 6DX, United Kingdom

Tel: +44 (0)1628 660999 • Fax: +44 (0)1628 662998

E-mail: info@firecheckltd.co.uk • Website: www.firecheckltd.co.uk

**Certificate No. CFSI-019 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases, Liquefied halocarbon gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

---

### **G.B. Electronics Limited trading as GBE Converge**

GBEC House, 31 Barnett Way, Barnwood, Gloucester GL4 3RT, United Kingdom

Tel: +44 (0)8451 220884 • Fax: +44 (0)845 1220885

E-mail: info@gbeconverge.com • Website: www.gbeconverge.com

**Certificate No. CFSI-029 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **Gemini AMPM Ltd**

18 Albert Drive, Jubilee Road, Burgess Hill, West Sussex RH15 9TN, United Kingdom

Tel: +44 (0)845 872 5999

E-mail: Sales@GeminiAMPM.co.uk • Website: www.GeminiAMPM.co.uk

**Certificate No. CFSI-025 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

**Hall & Kay Fire Services Limited trading as Hall & Kay Fire Engineering (Ascot)**

Unit E - Science Park, Silwood Business Park, Ascot, Berkshire SL5 7PW, United Kingdom

Tel: +44 (0)1344 203800 • Fax: +44 (0)1344 203801

E-mail: [MatthewC.Jones@hkfire.co.uk](mailto:MatthewC.Jones@hkfire.co.uk) • Website: [www.hkfire.co.uk](http://www.hkfire.co.uk)

**Certificate No. CFSI-009 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

**Interserve FS (UK) Limited**

Ingenuity House, Elmdon Trading Estate, Bickenhill Lane, Birmingham B37 7HQ, United Kingdom

Tel: +44 (0)1646 623900 • Fax: +44 (0)1646 687869

E-mail: [Neil.Lewis@interserve.com](mailto:Neil.Lewis@interserve.com) • Website: [www.initial.co.uk/fire-services/](http://www.initial.co.uk/fire-services/)

**Certificate No. CFSI-023 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and issue LPCB Certificates of Conformity for these systems.

---

**Mercury Engineering**

Mercury House, Sandyford Industrial Estate, Foxrock, Dublin 18 D18 XH79, Ireland

Tel: +353 1 216 3000 • Fax: +353 1 216 3006

E-mail: [fireprotection@mercuryeng.com](mailto:fireprotection@mercuryeng.com) • Website: [www.mercuryeng.com](http://www.mercuryeng.com)

**Certificate No. CFSI-016 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases, Liquefied halocarbon gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

---

**Protec Camerfield Limited (Firepro Division)**

5 Churchill Way, Nelson, Lancashire BB9 6RT, United Kingdom

Tel: +44 (0)870 442 2644 • Fax: +44 (0)870 442 2645

E-mail: [camerfield.firepro@protec.co.uk](mailto:camerfield.firepro@protec.co.uk) • Website: [www.protec.co.uk](http://www.protec.co.uk)

**Certificate No. CFSI-015 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases, Liquefied halocarbon gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

---

**Siemens Plc, Smart Infrastructure (Regional Solutions & Service)**

Brunel House, Sir William Siemens Square, Frimley, Camberley, Surrey GU16 8QD, United Kingdom

Tel: +44 (0)1276 696000 • Fax: +44 (0)1276 696133

E-mail: [sales.uk.sbt@siemens.com](mailto:sales.uk.sbt@siemens.com) • Website: [www.siemens.co.uk/buildingtechnologies](http://www.siemens.co.uk/buildingtechnologies)

**Certificate No. CFSI-004 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases, Liquefied halocarbon gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

---

## **PART 4: SECTION 1**

LPS 1204 CERTIFICATED GAS EXTINGUISHING SYSTEM FIRMS

---

### **Spectrum Fire Protection (UK) Limited**

Middlemore Lane, Aldridge, Walsall, West Midlands WS9 8SP, United Kingdom

Tel: +44 (0)1922 744 466 • Fax: +44 (0)1922 744 477

E-mail: [TechSupport@spectrumfire.co.uk](mailto:TechSupport@spectrumfire.co.uk) • Website: [www.spectrumfire.co.uk](http://www.spectrumfire.co.uk)

**Certificate No. CFSI-028 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **Trinity Fire & Security Systems Limited**

Little Bridge Business Park, Oil Mill Lane, Clyst St Mary, Exeter, Devon EX5 1AU, United Kingdom

Tel: +44 (0)1392 874455 • Fax: +44 (0)1392 875546

E-mail: [info@trinityprotection.co.uk](mailto:info@trinityprotection.co.uk) • Website: [www.trinityprotection.co.uk](http://www.trinityprotection.co.uk)

**Certificate No. CFSI-024 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

All offices listed on Trinity Fire and Security Systems Ltd's website as shown above are covered by this certificate.

---

### **Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

Security House, The Summit, Hanworth Road, Sunbury on Thames, Middlesex TW16 5DB, United Kingdom

Tel: +44 (0)1753 574111 • Fax: +44 (0)1753 824226

Website: [www.tycofis.com](http://www.tycofis.com)

**Certificate No. CFSI-011 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

180 Aztec West, Almondsbury, Bristol BS32 4TU, United Kingdom

Tel: +44 (0)1454 240071 • Fax: +44 (0)1454 626443

Website: [www.tycofis.com](http://www.tycofis.com)

**Certificate No. CFSI-013 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

### **Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

Mucklow Office Park, Mucklow Hill, Halesowen, West Midlands B62 8DA, United Kingdom

Tel: +44 (0)121 255 6000 • Fax: +44 (0)121 255 6100

Website: [www.tycofis.com](http://www.tycofis.com)

**Certificate No. CFSI-005 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

---

**Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

Tyco Park, Grimshaw Lane, Newton Heath, Manchester M40 2WL, United Kingdom

Tel: +44 (0)161 205 2321 • Fax: +44 (0)161 455 4459

Website: [www.tycofis.com](http://www.tycofis.com)

**Certificate No. CFSI-002 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

**Ultra Surefire Limited**

Lexham House, 14 Hill Avenue, Amersham, Buckinghamshire HP6 5BW, United Kingdom

Tel: +44 (0)345 600 8330

E-mail: [info@ultrasurefire.co.uk](mailto:info@ultrasurefire.co.uk) • Website: [www.ultrasurefire.co.uk](http://www.ultrasurefire.co.uk)

**Certificate No. CFSI-030 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases and Liquefied halocarbon gases and issue LPCB Certificates of Conformity for these systems.

---

**Vipond Fire Protection Limited**

10-12 Glenfield Road, Kelvin Industrial Estate, East Kilbride, Lanarkshire G75 0RA, United Kingdom

Tel: +44 (0)1355 2375 25/80/88 • Fax: +44 (0)1355 263399

E-mail: [admin.uk@vipondltd.co.uk](mailto:admin.uk@vipondltd.co.uk) • Website: [www.vipondfire.co.uk](http://www.vipondfire.co.uk)

**Burntwood:**

Unit 7C, Zone 2 Burntwood Business Park, Burntwood, Staffordshire WS7 3JQ, United Kingdom

Tel: +44 (0)1543 471417

**Certificate No. CFSI-027 to LPS 1204**

Certificated to design, install, commission and service Non-liquefied inert gases, Liquefied halocarbon gases and Carbon dioxide and issue LPCB Certificates of Conformity for these systems.

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

The equipment listed in this section has been assessed and tested to a test schedule, suitable for the product, containing tests from both LPS and EN standards for gaseous system components. The production facilities have also been assessed to ensure that the components meet and continue to meet these standards

Where a component is not covered by a published part of EN 12094 it will be evaluated against an LPCB Schedule of Requirements.

In order to function correctly the approved components must be used in accordance with the manufacturer's technical instructions.

**Component approval does not mean LPCB system approval. LPCB system approval requirements are set out in Section 2.2.**

#### **AIR Fire S.p.A.**

Via Tenuta della Mistica - 33/37, Rome 00155, Italy

Tel: +34 680395217

E-mail: [info@airfire.eu](mailto:info@airfire.eu) • Website: [www.airfire.eu](http://www.airfire.eu)

Certificate No: 1239Ca to EN12094-4

#### **Container Valves**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
071251	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	1239Ca/01
071221	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	
071231	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	
072201	DN12 Container Valve 250 bar, CO <sub>2</sub>	
072231	DN12 Container Valve 190 bar, CO <sub>2</sub>	
072211	DN12 Container Valve 190 bar, CO <sub>2</sub>	
072221	DN12 Container Valve 190 bar, CO <sub>2</sub>	
073221	DN12 Container Valve 270 bar, Inert	
073201	DN12 Container Valve 270 bar, Inert	
073211	DN12 Container Valve 270 bar, Inert	
073222	DN12 Container Valve 405 bar, Inert	
073202	DN12 Container Valve 405 bar, Inert	
073212	DN12 Container Valve 405 bar, Inert	

Certificate No: 1239Ca to EN12094-4

#### **Container Valve Actuators**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
072202	Pneumatic actuator	1239Ca/02
072203	Manual actuator	
022001	Electrical actuator	
072213	Pneumatic /manual actuator	

#### **Carrier Airconditioning & Refrigeration Ltd**

Narsinghpur, Kherki Daula Post, Gurgaon 122 004, Haryana, India

Tel: +91-124-4825500 • Fax: +91 124 2372230

E-mail: [customersupport.india@carrier.utc.com](mailto:customersupport.india@carrier.utc.com) • Website: [www.bis.utc.com](http://www.bis.utc.com)

Certificate No: 273Cd to EN 12094 series and Schedule of Requirements

#### **ARGONITE FIXED FIRE FIGHTING COMPONENTS**

# PART 4: SECTION 2.1

## GASEOUS SYSTEM COMPONENTS

### ARGONITE FIXED FIRE FIGHTING COMPONENTS

- <sup>1</sup> This range of equipment is suitable for storage temperatures from -20°C to +50°C and is approved for use with Argonite.  
<sup>2</sup> This range of equipment is approved for use in conjunction with the Kidde Products Design manual reference MA-01-9006-0100 (Revision 10 dated January 2008)  
<sup>3</sup> System pressure is specified at 150 bar, 200 bar and 300 bar @ 15°C.

Certificate No: 273Cd to a Schedule of Requirements

### ARGONITE Container and Container Bracket Assemblies

Product Name	Description	Capacity (ltr)	System pressure (bar)	LPCB Ref. No.
01-1331-5900	15.9 Litre Cylinder	15.9	150 (4), (5)	273Cd/01
01-1311-5900	67.5 Litre Cylinder	67.5	150 (4), (5)	
01-1321-5900	80.0 Litre Cylinder	80.0	150 (4), (5)	273Cd/19
01-1332-5900	15.9 Litre Cylinder	15.9	200 (4), (5)	
01-1312-5900	67.5 Litre Cylinder	67.5	200 (4), (5)	273Cd/19
01-1322-5900	80.0 Litre Cylinder	80.0	200 (4), (5)	
01-1334-5900	15.9 Litre Cylinder	15.9	300 (4), (5)	273Cd/19
01-1314-5900	67.5 Litre Cylinder	67.5	300 (4), (5)	
01-1324-5900	80.0 Litre Cylinder	80.0	300 (4), (5)	273Cd/19
01-1322-7100	80.0 Litre Cylinder	80.0	200 (5), (6)	

4. Cylinder is designed and manufactured in accordance with European Directive 2010/35/EU (TPED) through compliance with ISO 9809-2  
5. A range of wall brackets, clamping bas, spacers and clamping bolts for secure container installation are also available  
6. Cylinder is designed and manufactured in accordance with BS 5045-1 and is for Indian service only. Cylinder is not compliant with European Directive 84/225/EEC and the TPED.

Certificate No: 273Cd to EN12094 Part 8

### ARGONITE C Series and ARGONITE Hoses

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-3260-0100/1000	Actuation Hose (7)	DN5	150, 200 & 300	273Cd/03
01-3261-0100/1000	Actuation Hose (7)	DN5	150, 200 & 300	
01-3271-1100/1200	Actuation Hose (7)	DN5	150, 200 & 300	
01-3272-1100/1200	Actuation Hose (7)	DN5	150, 200 & 300	
01-3273-1100/1200	Actuation Hose (7)	DN5	150, 200 & 300	

7. Hoses are available in a variety of lengths

Certificate No: 273Cd to EN12094 Part 8

### ARGONITE Hoses

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-3284-0100/0200	Discharge Hose (7)	DN9	150, 200 & 300	273Cd/03

7. Hoses are available in a variety of lengths

Certificate No: 273Cd to a Schedule of Requirements

### ARGONITE Pressure Restrictor Assemblies

Product Name	Description	Orifice size (mm)	System pressure (bar)	LPCB Ref. No.
01-370X-1030/1070 (8), (9), (10)	½" Restrictor Assembly	3-7	150, 200 & 300	273Cd/04
01-370X-3050/3180 (9)	1.0 Restrictor Assembly	5-18	150, 200 & 300	
01-370X-4120/4270 (9)	1½" Restrictor Assembly	12-27	150, 200 & 300	
01-370X-5200/5360 (9)	2.0 Restrictor Assembly	20-36	150, 200 & 300	

8. Not available with NPT Female/NPT Female or NPT Female/BSP Female connections  
9. Where X can be 1 for NPT Male/ NPT Female, 2 for NPT Female/NPT Female, 3 for NPT Male/BSP Female or 4 for NPT Female/BSP Female

**PART 4: SECTION 2.1**  
**GASEOUS SYSTEM COMPONENTS**

10. Also available with BSP Male/BSP Female (part no. 01-3706-1030/1070) or BSP Male/NPT Female connections (part no. 01-3705-1030/1070)

Certificate No: 273Cd to a Schedule of Requirements

**ARGONITE C SERIES and ARGONITE Pressure Regulator Assemblies**

Product Name	Description	Orifice size (mm)	System pressure (bar)	LPCB Ref. No.
01-6017-0000	Pressure Regulator	N/A	150, 200 & 300	273Cd/04

Certificate No: 273Cd to prEN12094 Part 7

**ARGONITE C SERIES and ARGONITE Discharge Nozzles**

Product Name	Description	Orifice size (mm)	System pressure (bar)	LPCB Ref. No.
01-3465-X2030/X2100 (11)	½" Nozzle Assembly	3-10	60	273Cd/05
01-3465-X3070/X3140 (11)	¾" Nozzle Assembly	7-14	60	
01-3465-X4100/X4180 (11)	1 Nozzle Assembly	10-18	60	
01-3465-X5150/X5260 (11)	1½" Nozzle Assembly	15-26	60	

11. Where X can be 1 for BSP or 2 for NPT connections

Certificate No: 273Cd to a Schedule of Requirements

**ARGONITE Single Area Manifolds**

Product Name	Description	No. cylinders	System pressure (bar)	LPCB Ref. No.
01-3506-2011 to 01-3506-2019	Single Row Discharge Manifold	1 to 10	150, 200	273Cd/06
01-3506-2021 to 01-3506-2029	Double Row Discharge Manifold	4 to 20	150, 200	
01-3506-3011 to 01-3506-3019	Single Row Discharge Manifold	1 to 10	300	
01-3506-3021 to 01-3506-3029	Double Row Discharge Manifold	4 to 20	300	

Certificate No: 273Cd to a Schedule of Requirements

**ARGONITE C SERIES and ARGONITE Multi-Area Manifold Accessories**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-3508-0002	Pilot Manifold (2 Diverter Valves)	150, 200, 300 (12)	273Cd/06
01-3508-0003	Pilot Manifold (3 Diverter Valves)	150, 200, 300 (12)	
01-3508-0004	Pilot Manifold (4 Diverter Valves)	150, 200, 300 (12)	
01-3508-0005	Pilot Manifold (5 Diverter Valves)	150, 200, 300 (12)	

12. Working Pressure Outlet 8 bar

Certificate No: 273Cd to EN12094 Part 5

**ARGONITE C SERIES and ARGONITE Diverter Valves**

Product Name	Description	Size	System pressure (bar)	LPCB Ref. No.
01-6240-1000	Diverter Valve	½"	150, 200 & 300	273Cd/08
01-6242-1000	Diverter Valve	1	150, 200 & 300	
01-6244-1000	Diverter Valve	1½"	150, 200 & 300	
01-6246-1000	Diverter Valve	2	150, 200 & 300	

Certificate No: 273Cd to EN12094 Part 13

**ARGONITE Manifold Check Valves**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6454-0000	Manifold Check Valve	½" BSP & ¾" NPT	150, 200 & 300	273Cd/09



**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 273Cd to EN12094 Part 4

**ARGONITE Container Valves**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-6471-0150	Pneumatic Argonite Valve	150	273Cd/10
01-6471-0200	Pneumatic Argonite Valve	200	
01-6471-0300	Pneumatic Argonite Valve	300	

Certificate No: 273Cd to EN12094 Part 4

**ARGONITE Release Valves**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7172-1150	Release Unit	150	273Cd/11
01-7172-1200	Release Unit	200	
01-7172-1300	Release Unit	300	
01-7173-1150	Release Unit	150	
01-7173-1200	Release Unit	200	
01-7173-1300	Release Unit	300	

Certificate No: 273Cd to EN12094 Part 10

**ARGONITE C SERIES and ARGONITE Pressure Monitoring Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7221-0300	Manifold Pressure Gauge ½	150, 200 & 300	273Cd/15
03-5713-0000	Discharge Pressure Switch	Max operating pressure 90 bar	

Certificate No: 273Cd to EN12094 Part 10

**ARGONITE Pressure Monitoring Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7171-1500	Pressure Gauge Unit	150	273Cd/15
01-7171-1200	Pressure Gauge Unit	200	
01-7171-1300	Pressure Gauge Unit	300	

Certificate No: 273Cd to a Schedule of Requirements

**ARGONITE C SERIES and ARGONITE Pressure Relief Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-6653-0001/0101	Pressure Relief Device	150	273Cd/17
01-6653-0002/0102	Pressure Relief Device	200	
01-6653-0003/0103	Pressure Relief Device	300	

Certificate No: 273Cd to EN12094 part 13 and a Schedule of Requirements

**ARGONITE C SERIES and ARGONITE Pilot Line Equipment**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6363-0000	Pilot Line Check Valve	¼" BSP	150, 200 & 300	273Cd/18
01-3388-0000	Actuation Line Leak Bleeder Unit	-	150, 200 & 300	
15-8685-0651	Actuation Line T-Piece	DN5	150, 200 & 300	
01-4130-000	Actuation Line Cross	DN5	150, 200 & 300	

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

#### **Ceasefire Industries Pvt. Ltd**

Plot No. 4, Second Floor, Sector - 135, Noida, Uttar Pradesh 201301, India  
Tel: +91 120 4255800 • Fax: +91 120 4255801  
E-mail: amit@ceasefire.in • Website: www.ceasefire.in

Certificate No: 980Aa to EN 12094-10:2003

#### **Ceasefire Pressure gauges with switch**

Product Name	Description	LPCB Ref. No.
TI-000826	0-60 bar range, 22.5 bar switch contact	980Aa/01
TI-000827	0-60 bar range, 22.5 bar switch contact	
TI-000828	0-100 bar range, 38 bar switch contact	
TI-000829	0-100 bar range, 38 bar switch contact	

Certificate No: 1239Ba to EN12094-4

#### **Ceasefire Container Valves DN33 and DN50 for use with HFC227ea.**

Product Name	Description	LPCB Ref. No.
SM-RM1994	DN33 container valve 25 bar, (60 bar burst disc)	1239Ba/01
SM-RM2132	DN33 container valve 42 bar, (95 bar burst disc)	
SM-RM2121	DN50 container valve 25 bar, (60 bar burst disc)	
SM-RM2122	DN50 container valve 42 bar, (95 bar burst disc)	

Certificate No: 1239Ba to EN12094-4

#### **Ceasefire Container Valve Actuators**

Product Name	Description	LPCB Ref. No.
SM-RM1996	Manual actuator	1239Ba/02
SM-RM2109	Pneumatic/manual actuator	
SM-RM2166	Pneumatic actuator	
SM-RM2169	Pneumatic/manual actuator (with plug)	
SM-RM2167	Pneumatic actuator (with plug)	
SM-RM2168	Pneumatic actuator	
SM-RM1995	Solenoid actuator	

Certificate No: 1239Ba to EN12094-13

#### **Ceasefire Check Valves**

Product Name	Description	LPCB Ref. No.
SM-RM2130	DN50 HFCs (70 bar)	1239Ba/03
SM-RM2080	DN33 HFCs (70 bar)	

Certificate No: 1239Ba to EN12094-8

#### **Ceasefire Pilot and Discharge Connectors**

Product Name	Description	LPCB Ref. No.
SM-RM2170x	Pilot hose DN5 F/F end couplings, 150mm long	1239Ba/04
SM-RM2192x	Pilot hose DN5 M/F end couplings, 150mm long	
SM-RM2214x	Straight discharge hose DN38 17/8 12UN F turnable/G 1 1/2 M, 300mm long	
SM-RM2226x	Discharge hose with 90° bend DN38 – 17/8" 12UN F turnable/G 1 1/2" M, 350mm long	
SM-RM2237x	Straight discharge hose DN51 – M24 x1.5mm/G 3/4" 340mm long	
SM-RM2126x	Discharge hose with 90° bend, DN51 – M24 x1.5mm/G 3/4" 400mm long	

Certificate No: 1329f to FprEN12094-7 and LPCB schedule of requirements

**Ceasefire Nozzles for HFC227ea.**

Product Name	Description	LPCB Ref. No.
XE115008	15 NB Discharge nozzle	1329f/01
XE115009	20 NB Discharge nozzle	
XE115010	25 NB Discharge nozzle	
XE115011	32 NB Discharge nozzle	
XE115012	40 NB Discharge nozzle	
XE115013	50 NB Discharge nozzle	

Note:  
180° and 360° nozzles

Certificate No: 1329f to an LPCB schedule of requirements

**Ceasefire Manifolds**

Product Name	Description	LPCB Ref. No.
CF/Manifold/L-002	80 NB 2-Way Manifold	1329f/02
CF/Manifold/L-003	80 NB 3-Way Manifold	
CF/Manifold/L-004	80 NB 4-Way Manifold	

Note:  
All manifolds are supplied with sockets to accept either DN33 or DN50 check valves

**Ceodeux Extinguisher Valves Technology S.A. (ROTAREX FIRETEC)**

24 rue de Diekirch, L-7440 Lintgen, Luxembourg  
Tel: +352 32 78 32-1 • Fax: +352 32 78 32-326  
E-mail: [info@firetec.rotarex.com](mailto:info@firetec.rotarex.com) • Website: [www.rotarex.com](http://www.rotarex.com)

Certificate No: 724a to EN 12094-4

**Ceodeux CO2 Container valves**

Product Name	Description	LPCB Ref. No.
B0480 0005	CO <sub>2</sub> Container Valve	724a/01
B0480 0007	CO <sub>2</sub> Container Valve	
B0480 0106	CO <sub>2</sub> Container Valve	
B0480 0107	CO <sub>2</sub> Container Valve	
B0480 0108	CO <sub>2</sub> Container Valve	
B0480 0110	CO <sub>2</sub> Container Valve	
B0480 0111	CO <sub>2</sub> Container Valve	
B0480 0112	CO <sub>2</sub> Container Valve	
B0480 0113	CO <sub>2</sub> Container Valve	

Certificate No: 724a to EN 12094-4

**Ceodeux 200 bar Inert Container valves**

Product Name	Description	LPCB Ref. No.
B0480 1208	200 bar Inert Container Valve	724a/02
B0480 1209	200 bar Inert Container Valve	
B0480 1210	200 bar Inert Container Valve	
B0480 1211	200 bar Inert Container Valve	
B0480 1212	200 bar Inert Container Valve	
B0480 1213	200 bar Inert Container Valve	
B0480 1219	200 bar Inert Container Valve	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 724a to EN 12094-4

**Ceodeux 300 bar Inert Container valves**

Product Name	Description	LPCB Ref. No.
B0480 2007	300 bar Inert Container Valve	724a/03
B0480 2010	300 bar Inert Container Valve	
B0480 2012	300 bar Inert Container Valve	
B0480 2014	300 bar Inert Container Valve	
B0480 2021	300 bar Inert Container Valve	

Certificate No: 724a to EN 12094-4

**Ceodeux Inert Container Valves Discharge Regulator**

Product Name	Description	LPCB Ref. No.
B08400002	Inertech Discharge Constant Pressure Regulator	724a/05
B08400003	Inertech Discharge Constant Pressure Regulator	
B08400004	Inertech Discharge Constant Pressure Regulator	
B08400005	Inertech Discharge Constant Pressure Regulator	
B08400006	Inertech Discharge Constant Pressure Regulator	
B08400007	Inertech Discharge Constant Pressure Regulator	
B08400009	Inertech Discharge Constant Pressure Regulator	
NF311250	Discharge Constant Pressure Regulator	

Certificate No: 724a to EN 12094-4

**Ceodeux Actuators**

Product Name	Description	LPCB Ref. No.
B04420092	Pneumatic / Manual Actuator	724a/04
B04420093	Pneumatic Actuator	
B04420096	Pneumatic Actuator	
B04420097	Pneumatic Actuator	
B04425131	Electrical Actuator	
B04425132	Electrical Actuator	
B04425146	Electrical Actuator	
B04425147	Electrical Actuator	
B04425148	Electrical Actuator	
B04425149	Electrical Actuator	
B04420065	Pneumatic / Manual Actuator	
B04420066	Pneumatic Actuator	
B04420076	Pneumatic Actuator	
B04420081	Pneumatic Actuator	
B04420082	Pneumatic Actuator	
B04420083	Pneumatic / Manual Actuator	
B04425137	Electrical Actuator	

**Eurotech Fire Protection Ltd, in collaboration with Firetec Systems Ltd**

Unit 6, The Business Centre, Molly Millars Lane, Wokingham, Berkshire RG41 2QZ, United Kingdom

Tel: +44 1252 860606 • Fax: +44 1252 860606

E-mail: keith.goodall@firetec-systems.com • Website: www.firetec-systems.com

Certificate No: 1222f to an LPCB Schedule of requirements

**Inertech Manifolds**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
NF33x*1xx*2x*3x*4	Inertech Manifold	60	1222f/01

According to the following:

x\*1 = 5 for 267 +/- 5mm or 6 for 356 +/- 5mm diameter cylinders

xx\*2 = 50 for DN50 or 80 for DN80  
 x\*3 = 1 for single row or 2 for double row  
 x\*4 = blank for BSPT or N for NPT

**Notes:**

Inertech manifolds are only for use with Inertech container valves when fitted with the 60 bar constant discharge regulator (Model Ref NF311250).

**Eurotech227, Eurosafe227, Eurotech1230 & Eurosafe1230 Fire Fighting Components**

- a. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with HFC227ea and FK 5-1-12 (Novec™ 1230)
- b. HFC227ea equipment is approved for use in conjunction with Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Fire HFC227 Manual' - Issue 13-03
- c. FK 5-1-12 equipment is approved for use in conjunction with Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Fire Novec1230 Manual' - Issue 13-04
- d. Nominal system pressure for HFC227ea components at 20°C is stated at 25 bar or 42 bar.
- e. Nominal system pressure for FK 5-1-12 components at 20°C is stated at 25 bar or 42 bar.

Certificate No: 1222b to EN 12094-4

**Eurotech227, Eurosafe227, Eurotech1230 & Eurosafe1230 Container Valves**

Product Name	Description	LPCB Ref. No.
NF21330x (1)	33mm Container Valve	1222b/01
NF21331x (1)	33mm Container Valve with Integral Solenoid Actuator	1222b/02
NF21490x (1)	49mm Container Valve	1222b/03
NF21491x (1)	49mm Container Valve with Integral Solenoid Actuator	1222b/04

1. Where 'x' in container valve part number is replaced with '2' for 25 bar nominal charge pressure or '4' for 42 bar nominal charge pressure.

Certificate No: 1222b to EN 12094-8

**Eurotech227, Eurosafe227, Eurotech1230 & Eurosafe1230 Flexible Connectors**

Product Name	Description	LPCB Ref. No.
NF271xxx (1)	Pilot hose (Type 3 Connector)	1222b/09
NF2333xxx (1)	33mm Discharge hose (Type 1 Connector)	1222b/10
NF2349xxx (1)	49mm Discharge hose (Type 1 Connector)	1222b/11

**Notes:**

1. Where 'xxx' in connector part number is replaced with the connector length in mm, up to a maximum of 999mm.

Certificate No: 1222b to EN 12094-13

**Eurotech227, Eurosafe227, Eurotech1230 & Eurosafe1230 Check and Non Return Valves**

Product Name	Description	LPCB Ref. No.
NF2433x (2)	33mm Discharge Check Valve	1222b/12
NF2449x (2)	49mm Discharge Check Valve	1222b/13

**Notes:**

2. Where 'x' in connector part number is replaced with replaced with '1' for BSPT thread or '2' for NPT thread.

Certificate No: 1222c to prEN 12094-7

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

***Eurotech227, Eurosafe227, Eurotech1230 & Eurosafe1230 Nozzles***

Product Name	Description	LPCB Ref. No.
NF25152x	15mm Nozzle BSPP	1222c/01
NF25202x	20mm Nozzle BSPP	1222c/02
NF25252x	25mm Nozzle BSPP	1222c/03
NF25322x	32mm Nozzle BSPP	1222c/04
NF25402x	40mm Nozzle BSPP	1222c/05
NF25502x	50mm Nozzle BSPP	1222c/06
NF25152xN	15mm Nozzle NPT	1222c/01
NF25202xN	20mm Nozzle NPT	1222c/02
NF25252xN	25mm Nozzle NPT	1222c/03
NF25322xN	32mm Nozzle NPT	1222c/04
NF25402xN	40mm Nozzle NPT	1222c/05
NF25502xN	50mm Nozzle NPT	1222c/06

***Inertech Firefighting Components***

- This Range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with IG-01, IG-55, IG-100 and IG-541.
- Inertech equipment is approved for use in conjunction with Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Inertech Manual' Issue June 13
- Nominal system pressure for Inertech components at 15°C is stated at 200 bar or 300 bar

Certificate No: 1222d to EN 12094-4

***Inertech Container Valves and Regulator***

Product Name	Description	LPCB Ref. No.
NF311202	Inertech 200 bar Container Valve	1222d/02
NF311203	Inertech 300 bar Container Valve	1222d/03
NF311250	Inertech Discharge Constant Pressure Regulator	1222d/05

Certificate No: 1222d to EN 12094-4

***Eurotech227, Eurosafe227, Eurotech1230, Eurosafe1230 & Inertech Container Valve Actuators***

Product Name	Description	LPCB Ref. No.
NF26010	Solenoid Actuator	1222d/04
NF26011	Solenoid Actuator with reverse EMF diode	
NF26020	Pneumatic Actuator	
NF26030	Pneumatic/Manual Actuator	

Certificate No: 1222b to EN 12094-8

***Inertech Flexible Connectors***

Product Name	Description	LPCB Ref. No.
NF3312xxx (1)	Inertech Discharge Hose	1222b/14
NF370xxx (1)	Inertech Actuation Hose	1222b/15

**Note:**

1. Where 'xxx' in connector part number is replaced with the connector length in mm; i.e. 300, 400 and 500mm for discharge connectors and 350, 450 and 600mm for actuation connectors.

Certificate No: 1222b to EN 12094-13

***Inertech Check Valve***

Product Name	Description	LPCB Ref. No.
NF34131	Inertech Check Valve	1222b/16

Certificate No: 1222c to prEN 12094-7

***Inertech Nozzles***

Product Name	Description	LPCB Ref. No.
NF35151 (1)	Inertech Nozzle DN15 180° & 360°	1222c/07
NF35152 (1)	Inertech Nozzle DN15 180° & 360°	
NF35201	Inertech Nozzle DN20 180° & 360°	1222c/08
NF35251	Inertech Nozzle DN25 180° & 360°	1222c/09
NF35321	Inertech Nozzle DN32 180° & 360°	1222c/10
NF35401	Inertech Nozzle DN40 180° & 360°	1222c/11
NF35501	Inertech Nozzle DN50 180° & 360°	1222c/12

Certificate No: 1222b to EN 12094-5

***Selector Valves***

Product Name	Description	Working Pressure	LPCB Ref. No.
NF34015 (1)	Inertech Selector Valve DN15	60 bar	1222b/17
NF34020 (1)	Inertech Selector Valve DN20	60 bar	
NF34025 (1)	Inertech Selector Valve DN25	60 bar	
NF34032 (1)	Inertech Selector Valve DN32	60 bar	
NF34040 (1)	Inertech Selector Valve DN40	60 bar	
NF34050 (1)	Inertech Selector Valve DN50	60 bar	

**Firefighting Components - Selector Valves:**

- a. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for used with IG-01, IG-55, IG-100 and IG-541.
- b. Inertech equipment is approved for use in conjunction with Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Inertech Manual' Issue June 2013.
- c. Nominal system pressure for Inertech components at 15°C is stated at 200 bar or 300 bar.
- d. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with HFC227ea and FK 5-1-12 (Novec™ 1230).
- e. HFC227ea equipment is approved for use in conjunction with 'Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Fire HFC227 Manual' - Issue 13-03.
- f. FK 5-1-12 equipment is approved for use in conjunction with 'Eurotech Fire Protection Ltd Design Manual Reference 'Eurotech Fire Novec1230 Manual' - Issue 13-04.
- g. Nominal system pressure for HFC227ea components at 20°C is stated at 25 bar or 42 bar. Nominal system pressure for FK 5-1-12 components at 20°C is stated at 25 bar or 42 bar.

**Notes:**

Selector valves are only for use with Inertech agents when the container valves are fitted with the 60 bar constant discharge regulator (Model Ref NF311250). The Working Pressure is specified as ≤ 60 bar for all agents and temperatures in accordance with the Note in Table 1 of EN 12094-5.

Certificate No: 1222e to IS 7285-2:2004

***Inertech Cylinders - PESO (Seamless)***

Product Name	Description	LPCB Ref. No.
51152677-1-xxx (1,4,6)	Inertech 300 bar WP nominal 267mm diameter Seamless Cylinder (PESO)	1222e/01
51173568-1-yyy (2,4,7)	Inertech 300 bar WP nominal 356mm diameter Seamless Cylinder (PESO)	1222e/02
51126726-2-zzz (3,5,8)	Inertech 200 bar WP nominal 267mm diameter Seamless Cylinder (PESO)	1222e/03

**Notes:**

1. Cylinders are approved for use in the Indian service market only in accordance with IS 7285-2:2004 by Chief Controller of Explosives (Reference G3(42)530/II) fitted with Valve Reference G3(4)201 [P/N NF311203]. The cylinders do not comply with European Directive 84/225/EEC or TPED.

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

2. Cylinders are approved for use in the Indian service market only in accordance with IS 7285-2:2004 by Chief Controller of Explosives (Reference G3(42)530/III) fitted with Valve Reference G3(4)201. [P/N NF311203] The cylinders do not comply with European Directive 84/225/EEC or TPED.
3. Cylinders are approved for use in the Indian service market only in accordance with IS 7285-2:2004 by Chief Controller of Explosives (Reference G3(42)530/I) fitted with Valve Reference G3(4)201. [P/N NF311203]The cylinders do not comply with European Directive 84/225/EEC or TPED.
4. Maximum Working Pressure 300 Bar @ 15°C.
5. Maximum Working Pressure 200 Bar @ 15°C.
6. Where, 'xxx' in the seamless cylinder part number is replaced with the cylinder capacity in litres; applicable sizes are 90, 95 or 100 litres only.
7. Where, 'yyy' in the seamless cylinder part number is replaced with the cylinder capacity in litres; applicable sizes are 120, 125, 130, 135, 140, 145, 150, 155, 160, 165, 170, 175, 180 litres only.
8. Where, 'zzz' in the seamless cylinder part number is replaced with the cylinder capacity in litres; applicable sizes are 35, 40, 45, 50, 56, 60, 68, 80 litres only.

### **Fike Safety Technology Ltd**

Unit 31, Springvale Industrial Estate, Cwmbran, Gwent NP44 5BD, United Kingdom

Tel: +44 (0)1633 865558 • Fax: +44 (0)1633 866656

E-mail: [fstinfo@fike.com](mailto:fstinfo@fike.com) • Website: [www.fikesafetytechnology.co.uk](http://www.fikesafetytechnology.co.uk)

Certificate No: 980Ba to EN12094-10

#### ***Pressure gauges with switch***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
02-12391	0-40 bar range	980Ba/01
02-14229	0-250 bar range	
02-14694	0-250 bar range	
02-12562	0-250 bar range	
02-12561	0-315 bar range	
02-12560	0-400 bar range	

Certificate No: 331v

#### ***Prolnert Fixed Gas System Components***

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

Certificate No: 331v

#### ***PROINERT Container Valves***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
IG71-001-1	300 bar	331v/01
IG71-001-2	200 bar	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2



**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

Certificate No: 331v

**PROINERT Container Valve Assemblies**

Product Name	Description	LPCB Ref. No.
IG71-006-300	10L-300 bar	331v/09
IG71-067-200	67L-200 bar	
IG71-080-200-01	80L-200 bar	
IG71-080-300-01	80L-300 bar	
IG71-080-200-55	80L-200 bar	
IG71-080-300-55	80L-300 bar	
IG71-080-200-100	80L-200 bar	
IG71-080-300-100	80L-300 bar	
IG71-080-200-541	80L-200 bar	
IG71-080-300-541	80L-300 bar	
IG71-103-200-55	80L-300 bar	
IG71-103-300-55	80L-300 bar	
IG71-103-200-100	80L-200 bar	
IG71-103-300-100	80L-300 bar	
IG71-103-200-541	80L-200 bar	
IG71-103-300-541	80L-300 bar	
IG71-140-200-01	140L-200 bar	
IG71-140-300-01	140L-300 bar	
IG71-140-200-55	140L-200 bar	
IG71-140-300-55	140L-300 bar	
IG71-140-200-100	140L-200 bar	
IG71-140-300-100	140L-300 bar	
IG71-140-200-541	140L-200 bar	
IG71-140-300-541	140L-300 bar	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar

Certificate No: 331v

**PROINERT Actuators**

Product Name	Description	LPCB Ref. No.
IG71-002	Pneumatic actuator	331v/02
02-13571	Electrical/manual actuator	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar

Certificate No: 331v

**PROINERT Pressure Gauges**

Product Name	Description	LPCB Ref. No.
02-14229/14964	200 bar gauge	331v/03
02-12562	160 bar gauge	
02-12560	300 bar gauge	
02-12561	200 bar gauge	

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

**Certificate No: 331v**

#### ***PROINERT Pilot Actuation Packages***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
70-325-2 (1)	Nitrogen Actuator Assembly (Normally Open Pressure Switch Contacts)	331v/04
70-325-4 (1)	Nitrogen Actuator Assembly (Normally Closed Pressure Switch Contacts)	
IG71-120 (1)	Relay Actuator	
IG71-118	Primary Prolnert Actuator Kit	
IG71-119	Secondary Prolnert Actuator Kit	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

**Note:**

(1) These items are also approved for use with Fike clean agent container valves 331x/03, 331x/04 and 331x/05

**Certificate No: 331v**

#### ***PROINERT Flexible Connectors***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
02-10721	Discharge hose - Inert gas	331v/05
02-10798	Pneumatic hose - Valve actuator	
02-10801	Pneumatic hose - Pilot actuator	
02-13713	Pneumatic hose - Pilot connector	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

**Certificate No: 331v to EN 12094-13**

#### ***PROINERT Check Valve***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
IG71-008	Check valve	331v/06
02-10927	Non-Return Valve	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- Prolnert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541

- System pressure downstream of container valves is specified as 42 bar nominal

Certificate No: 331v

**PROINERT Manifold**

Product Name	Description	LPCB Ref. No.
IG71-004-2	2-way manifold	331v/07
IG71-004-3	3-way manifold	
IG71-004-4	4-way manifold	
IG71-004-5	5-way manifold	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- ProInert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

Certificate No: 331v

**PROINERT Nozzles**

Product Name	Description	LPCB Ref. No.
IG71-010-XXX	15mm	331v/08
IG71-011-XXX	20mm	
IG71-012-XXX	25mm	
IG71-013-XXX	40mm	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- ProInert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal

Certificate No: 331v

**PROINERT Selector Valves**

Product Name	Description	Working Pressure(bar)	LPCB Ref. No.
IG71-025-SV3	25mm selector valve	64	331v/10
IG71-040-SV3	40mm selector valve	64	
IG71-050-SV3	50mm selector valve	64	
IG71-080-SV3	80mm selector valve	64	

- This range of equipment is suitable for storage from -20° to 50°C
- This range of equipment is approved for use in conjunction with Fike Design, Installation, Maintenance and User Manual P/N 06-677 rev 2, 06-678 rev 2, 06-679 rev 2 & 06-680 rev 2
- ProInert is supplied in Containers at either 200 or 300 bar @ 15°C
- These components are suitable for use with IG-01, IG-55, IG-100 and IG-541
- System pressure downstream of container valves is specified as 42 bar nominal
- A manifold relief valve, rated at 55 bar, must be incorporated in any Fike ProInert system that includes any of these selector valves.
- Minimum pneumatic operating pressure required is 8 bar.

Certificate No: 331x

**CLEAN AGENT Pilot Actuation Packages**

Product Name	Description	LPCB Ref. No.
70-339	Primary Clean Agent Actuator Completer Kit	331x/01
70-340	Secondary Clean Agent Actuator Completer Kit	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 331x

**CLEAN AGENT Flexible connectors**

Product Name	Description	LPCB Ref. No.
02-4977	Actuator hose - Pilot Actuator	331x/02

Certificate No: 331x

**CLEAN AGENT 12mm Container Valve**

Product Name	Description	LPCB Ref. No.
70-187-X	12mm Container Master Valve	331x/03
70-188	12mm Container Slave Valve	

Certificate No: 331x

**CLEAN AGENT SAV Container Valve**

Product Name	Description	LPCB Ref. No.
70-144-X	SAV Container Valve	331x/04

Certificate No: 331x

**CLEAN AGENT Impulse Container Valves**

Product Name	Description	LPCB Ref. No.
70-242 (1)	1" Impulse Container Valve	331x/05
70-243 (1)	3" Impulse Container Valve	
70-354 (2)	1" Impulse Container Valve	
70-355 (2)	3" Impulse Container Valve	

Certificate No: 331x

**CLEAN AGENT Container Valve Actuators**

Product Name	Description	LPCB Ref. No.
02-12728-E	Electronic/manual actuator	331x/06
02-12729	Pneumatic actuator	
70-290	Impulse Releasing Interface	
02-14231	Direct Impulse Valve actuator	

Certificate No: 331x

**CLEAN AGENT Impulse Valve and Container Assemblies**

Product Name	Description	LPCB Ref. No.
70-348	1 Valve 5L HFC227ea	331x/07
70-349	1 Valve 9L HFC227ea	
70-350	1 Valve 16L HFC227ea	
70-278	1" Valve 26L HFC227ea	
70-255	1" Valve 45L HFC227ea	
70-256	3" Valve 83L HFC227ea	
70-257	3" Valve 150L HFC227ea	
70-377-R-NA-NV	1" Valve 5L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	
70-378-R-NA-NV	1" Valve 9L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	
70-379-R-NA-NV	1" Valve 16L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	
70-380-R-NA-NV	1" Valve 26L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	
70-381-R-NA-NV	1" Valve 45L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	
70-382-R-NA-NV	3" Valve 83L – 3M™ Novec™ 1230 Fire Protection Fluid (FK-5-1-12)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	LPCB Ref. No.
70-383-R-NA-NV	3" Valve 150L – 3M™ Novac™ 1230 Fire Protection Fluid (FK-5-1-12)	

**Fire Eater A/S**

Vølundsvej 17, 3400 Hillerød, Denmark  
 Tel: +45 7022 2769 • Fax: +45 7023 2769  
 E-mail: go@fire-eater.dk • Website: www.fire-eater.com

Certificate No: 1287a

**Fire Eater Containers and Hand Wheel Valve Assemblies for INERGEN (200 bar) and (300 bar)**

Product Name	Description	Hand Wheel Valve Outlet Thread	LPCB Ref. No.
200604	20 litre cylinder (200 bar)	W24.32 x 1¼	1287a/01
200606	30 litre cylinder (200 bar)	W24.32 x 1¼	
200610	50 litre cylinder (200 bar)	W24.32 x 1¼	
200616	80 litre cylinder (200 bar)	W24.32 x 1¼	
200609	30 litre cylinder (300 bar)	M25 x 1.5	
200615	50 litre cylinder (300 bar)	M25 x 1.5	
200624	80 litre cylinder (300 bar)	M25 x 1.5	
200642	140 litre cylinder (300 bar)	M25 x 1.5	

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1287a to EN12094-4

**Fire Eater Discharge Valves**

Product Name	Description	LPCB Ref. No.
305421	Ci IV8 container valve (200 bar)	1287a/02
305411	Ci IV8 container valve (300 bar)	
305420	Ci IV8 container valve (200 bar) + Manoswitch	1287a/03
305410	Ci IV8 container valve (300 bar) + Manoswitch	

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.
3. The above discharge valves may be actuated by any of the actuators listed below or by built-in pneumatic actuator via pilot or manifold back-pressure.

Certificate No: 1287a to EN12094-4

**Fire Eater Discharge Valve Actuators**

Product Name	Description	LPCB Ref. No.
305450	Ci IS8B solenoid actuator	1287a/04
305451	Ci IS8B solenoid and manual actuator	
305442	Ci IM8 manual actuator	
305448	Ci PA8 pneumatic actuator	

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

# PART 4: SECTION 2.1

## GASEOUS SYSTEM COMPONENTS

Certificate No: 1287a to EN12094-10

### **Fire Eater Pressure Gauge and Switch**

Product Name	Description	LPCB Ref. No.
305373	Manoswitch 0-284 bar	1287a/05
305374	Manoswitch 0-431 bar	

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1287a to EN12094-8

### **Fire Eater Connectors**

Product Name	Description	LPCB Ref. No.
303302	Ci DN10 discharge hose with straight ends, 0.5 m	1287a/06
303304	Ci DN10 discharge hose with straight ends, 1 m	
303306	Ci DN10 discharge hose with straight ends, 1.5 m	
303308	Ci DN10 discharge hose with straight ends, 2 m	
303309	Ci DN10 discharge hose with straight ends, 2.5 m	
303311	Ci DN10 discharge hose with straight ends, 3 m	
303313	Ci DN10 discharge hose with straight ends, 4 m	
303102	Ci DN10 discharge hose with 90° elbow one end, 0.5 m	
303104	Ci DN10 discharge hose with 90° elbow one end, 1 m	
303106	Ci DN10 discharge hose with 90° elbow one end, 1.5 m	
303108	Ci DN10 discharge hose with 90° elbow one end, 2 m	1287a/07
303109	Ci DN10 discharge hose with 90° elbow one end, 2.5 m	
303111	Ci DN10 discharge hose with 90° elbow one end, 3 m	
303113	Ci DN10 discharge hose with 90° elbow one end, 4 m	
303162	Ci DN6 pilot hose PA1 with straight ends, 0.18 m	
303166	Ci DN6 pilot hose PA1 with straight ends, 0.22 m	
303169	Ci DN6 pilot hose PA1 with straight ends, 0.25 m	
303172	Ci DN6 pilot hose PA1 with straight ends, 0.28 m	
303174	Ci DN6 pilot hose PA1 with straight ends, 0.33 m	
303180	Ci DN6 pilot hose PA1 with straight ends, 0.5 m	
205064	Ci DN6 pilot hose PA1 with straight ends, 0.4 m	
205063	Ci DN6 pilot hose PA1 with straight ends, 1.0 m	
303182	Ci DN6 pilot hose PA2 with 90° elbow one end, 1 m	
303183	Ci DN6 pilot hose PA2 with 90° elbow one end, 3 m	
303184	Ci DN6 pilot hose PA2 with 90° elbow one end, 0.4 m	
303155	Ci DN6 pilot hose PA3 with 90° elbow each end, 0.35 m	
303156	Ci DN6 pilot hose PA3 with 90° elbow each end, 0.45 m	

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1287a to EN12094-13

### **Fire Eater Manifold and Check Valve / Non Return Valve Assemblies**

Product Name	Description	LPCB Ref. No.
3057xx	Ci MT manifold assembly	1287a/08
30517n	SV22 manifold kit	
305302	DN6 pilot line non-return valve	

xx = number of discharge connectors up to a maximum of 10. Each connection is fitted with an integral check valve device  
n = number of discharge connectors up to a maximum of 8. Each connection is fitted with an integral non-return valve device

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).
2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1287a to prEN12094-7 and LPCB schedule

**Fire Eater Nozzles**

Product Name	Description	LPCB Ref. No.
210203	DN15 360° nozzle (1-3mm DN orifices) (1)	1287a/09
210204	DN15 360° nozzle (1)	
210206	DN20 360° nozzle (1)	
210208	DN25 360° nozzle (1)	
210210	DN32 360° nozzle (1)	
210223	DN15 360° nozzle (1-3mm DN orifices) (2)	
210224	DN15 360° nozzle (2)	
210226	DN20 360° nozzle (2)	
210228	DN25 360° nozzle (2)	
210230	DN32 360° nozzle (2)	
210123	½" IN nozzle silencer 112	
210125	½" IN nozzle silencer	
210126	¾" IN nozzle silencer	
210128	1 IN nozzle silencer	

(1) = ISO7/1 thread

(2) = NPT thread

1. This range of equipment is suitable for storage and environmental conditions from -20°C to +65°C and is approved for use with INERGEN (IG541).

2. Nominal system pressure is specified as 200 bar and 300 bar at 15°C.

**FiWaRec Valves & Regulators GmbH & Co. KG**

Europa-Allee 12, D54343 Fohren, Germany

Tel: +49/6502 939512-16 • Fax: +49/6502 939512-12

E-mail: felten.frank@fiwarec.de • Website: www.fiwarec.de

Certificate No: 1239a to an LPCB Schedule of Requirements

**Constant Pressure Regulator**

Product Name	Description	Container Pressure (bar)	Outlet Pressure (bar)	LPCB Ref. No.
F2120010	Constant pressure regulator - manifold installation	200 & 300	Static: 60 (+2 / -6) Dynamic: Max. 60	1239a/08
F2120011	Constant pressure regulator - cylinder installation	200 & 300	Static: 60 (+2 / -6) Dynamic: Max. 60	
F2120012	Constant pressure regulator	200 & 300	Static: 60 (+2 / -6) Dynamic: Max. 60	

Certificate No: 1239a to EN12094-4

**Container Valves DN12**

Product Name	Description	LPCB Ref. No.
F2020001	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	1239a/01
F2020003	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	
F2020005	DN12 Container Valve 50 bar, HFC227ea & FK-5-1-12	
F2021000	DN12 Container Valve 250 bar, CO <sub>2</sub>	
F2021001	DN12 Container Valve 190 bar, CO <sub>2</sub>	
F2021002	DN12 Container Valve 190 bar, CO <sub>2</sub>	
F2021003	DN12 Container Valve 190 bar, CO <sub>2</sub>	
F2021004	DN12 Container Valve 190 bar, CO <sub>2</sub>	
F2022000	DN12 Container Valve 270 bar, Inert	
F2022001	DN12 Container Valve 270 bar, Inert	
F2022002	DN12 Container Valve 270 bar, Inert	
F2023000	DN12 Container Valve 405 bar, Inert	
F2023001	DN12 Container Valve 405 bar, Inert	
F2023002	DN12 Container Valve 405 bar, Inert	
F2023003	DN12 Container Valve 405 bar, Inert	

# PART 4: SECTION 2.1

## GASEOUS SYSTEM COMPONENTS

All above items to be used in accordance with the relevant Instruction Manual

Certificate No: 1239a to EN12094-4

### Container Valves DN33 and DN50 for use HFC125, HFC227ea & FK-5-1-12

Product Name	Description	LPCB Ref. No.
F2050003	DN33 Container Valve 50 bar, (60 bar burst disc)	1239a/03
F2050004	DN33 Container Valve 50 bar, (95 bar burst disc)	
F2050005	DN33 Container Valve 50 bar, (95 bar burst disc)	
F2050006	DN33 Container Valve 50 bar, (95 bar burst disc)	
F2050007	DN33 Container Valve 50 bar, (60 bar burst disc)	
F2050008	DN33 Container Valve 50 bar, (60 bar burst disc)	
F2050009	DN33 Container Valve 50 bar, (95 bar burst disc)	1239a/04
F2060004	DN50 Container Valve 50 bar, (60 bar burst disc)	
F2060005	DN50 Container Valve 50 bar, (95 bar burst disc)	
F2060007	DN50 Container Valve 50 bar, (95 bar burst disc)	
F2060008	DN50 Container Valve 50 bar, (95 bar burst disc)	
F2060009	DN50 Container Valve 50 bar, (60 bar burst disc)	
F2060010	DN50 Container Valve 50 bar, (60 bar burst disc)	
F2060011	DN50 Container Valve 50 bar, (95 bar burst disc)	

All above items to be used in accordance with the relevant Instruction Manual

Certificate No: 1239a to EN12094-4

### Container Valve Actuators

Product Name	Description	LPCB Ref. No.
F1120004	Electrical actuator	1239a/02
F1120005	Manual actuator	
F1120006	Pneumatic /manual actuator	
F1120007	Pneumatic actuator	
F1120008	Pneumatic actuator	
F1120009	Pneumatic /manual actuator (with plug)	
F1120010	Pneumatic actuator (with plug)	
F1120011	Pneumatic actuator	
F1120015	Pneumatic actuator	
F1120016	Pneumatic actuator	
F1120019	Pneumatic actuator	
F1120020	Manual actuator	
F1120021	Electrical actuator	
F1120023	Pneumatic /manual actuator	
F1120030	Electrical actuator	

All above items to be used in accordance with the relevant Instruction Manual

Certificate No: 1239a to EN12094-8

### Connectors

Product Name	Description	LPCB Ref. No.
F104xxxx	Pilot connector (type 3) inert gas (360 bar) DN5 150-1500mm	1239a/05
F105xxxx	Discharge connector (type 1) inert gas (360 bar) DN12 250-1200mm	
F106xxxx	Discharge connector (type 1) inert gas (360 bar) DN16 250-1200mm	
F107xxxx	Discharge connector (type 1) HFCs (70 bar) DN38 300-1500mm	
F108xxxx	Discharge connector (type 1) HFCs (70 bar) DN50 300-1500mm	

Note:  
Various combinations of 0° and 90° end fittings are available for the above items

Certificate No: 1239a to EN12094-13



**Check Valves**

Product Name	Description	LPCB Ref. No.
F017	DN12 inert gas (360 bar)	1239a/06
F018	DN50 HFCs (70 bar)	
F019	DN33 HFCs (70 bar)	

Certificate No: 1239a to EN12094-13

**Non-Return Valve**

Product Name	Description	LPCB Ref. No.
F016	DN4 (360 bar)	1239a/07

**Haci Ayvaz End. Mam. San. Ve Tic. A.S.**

Ataturk Sanayi Bolgesi, Mustafa Inan Cd. No:44, Arnavutkoy, Istanbul 34555, Turkey

Tel: +90 212 771 0145

E-mail: [ealtug@ayvaz.com](mailto:ealtug@ayvaz.com) • Website: [www.ayvaz.com](http://www.ayvaz.com)

Certificate No: 331Ax to EN 12094-4

**CLEAN AGENT Impulse Container Valves**

Product Name	Description	LPCB Ref. No.
AZ-70-242	1" Impulse Container Valve	331Ax/05
AZ-70-243	3" Impulse Container Valve	

Notes:

- The range of equipment is approved for use in conjunction with Ayvaz Equipment, Design & Service Manual P/N AZ-06-439 (Rev. 0 / October, 2018)
- The following equipment is suitable for use at storage temperatures from -20°C to 50°C
- Containers are superpressurised to 25bar at 21°C
- Maximum system working pressure at 50°C for HFC227ea is 34.6 bar; fill ratios 0.5 kg/l min. to 1.1 kg/l max.

Certificate No: 331Ax to EN 12094-4

**CLEAN AGENT Container Valve Actuators**

Product Name	Description	LPCB Ref. No.
AZ-02-12728	Electronic/manual actuator	331Ax/06
AZ-02-12729	Pneumatic actuator	
AZ-70-290	Impulse Releasing Interface	
AZ-02-14231	Direct Impulse Valve actuator	

Notes:

- The range of equipment is approved for use in conjunction with Ayvaz Equipment, Design & Service Manual P/N AZ-06-439 (Rev. 0 / October, 2018)
- The following equipment is suitable for use at storage temperatures from -20°C to 50°C
- Containers are superpressurised to 25bar at 21°C
- Maximum system working pressure at 50°C for HFC227ea is 34.6 bar; fill ratios 0.5 kg/l min. to 1.1 kg/l max.

Certificate No: 331Ax to EN 12094-4

## PART 4: SECTION 2.1

### GASEOUS SYSTEM COMPONENTS

#### **CLEAN AGENT Impulse Valve and Container Assemblies**

Product Name	Description	LPCB Ref. No.
AZ-70-348	1" Valve 5L - HFC227ea	331Ax/07
AZ-70-349	1" Valve 9L - HFC227ea	
AZ-70-350	1" Valve 16L - HFC227ea	
AZ-70-278	1" Valve 26L - HFC227ea	
AZ-70-255	1" Valve 45L - HFC227ea	
AZ-70-256	3" Valve 83L - HFC227ea	
AZ-70-257	3" Valve 150L - HFC227ea	

Notes:

- The range of equipment is approved for use in conjunction with Ayvaz Equipment, Design & Service Manual P/N AZ-06-439 (Rev. 0 / October, 2018)
- The following equipment is suitable for use at storage temperatures from -20°C to 50°C
- Containers are superpressurised to 25bar at 21°C
- Maximum system working pressure at 50°C for HFC227ea is 34.6 bar; fill ratios 0.5 kg/l min. to 1.1 kg/l max.

**Certificate No: 331Av to EN 12094-4 & an LPCB schedule of requirements**

#### **Actuator Assemblies**

Product Name	Description	LPCB Ref. No.
AZ-71-120	Relay actuator	331Av/04
AZ-70-325-2	Nitrogen Actuator Assembly (Normally Open Pressure Switch Contacts)	
AZ-70-325-4	Nitrogen Actuator Assembly (Normally Closed Pressure Switch Contacts)	

Notes:

- The range of equipment is approved for use in conjunction with Ayvaz Equipment, Design & Service Manual P/N AZ-06-439 (Rev. 0 / October, 2018)
- The following equipment is suitable for use at storage temperatures from -20°C to 50°C
- Containers are superpressurised to 25bar at 21°C
- Maximum system working pressure at 50°C for HFC227ea is 34.6 bar; fill ratios 0.5 kg/l min. to 1.1 kg/l max.

## **Kidde Fire Protection**

Station Road, High Bentham, Lancaster LA2 7NA, United Kingdom  
 Tel: +44 (0)1494 480 410 • Fax: +44 (0)1494 480 449  
 E-mail: [general.enquiries@kiddeuk.co.uk](mailto:general.enquiries@kiddeuk.co.uk) • Website: [www.kfp.co.uk](http://www.kfp.co.uk)

#### **KIDDE GX20 RANGE OF FM200 FIXED FIRE FIGHTING COMPONENTS**

- a. This range of equipment is suitable for storage temperatures from -20°C to +54°C and is approved for use with FM200.
- b. This range of equipment is approved for use in conjunction with the Kidde Fire Protection Ltd, FM200 Design Manual.
- c. System pressure is specified at 25 bar @ 20°C and max service pressure of 34.5 bar @ 55°C.
- d. Nitrogen pilot pressure is specified as 124 bar @ 20°C.

<sup>1</sup> Cylinders are designed and manufactured to 84/525/EEC or TRG 330

<sup>2</sup> Vertical mount cylinder with straight syphon tube

<sup>3</sup> Horizontal mount cylinder with angled syphon tube continued

#### **KIDDE GX20 Container Valve, Container and Container Bracket Assemblies**

Product Name	Description	Capacity (ltr)	Strap	Bracket No.
E7763-102	Cyl & GCV40 Valve Assy	8 (1), (2)	C6331-103	D1162-002
E7763-122	Cyl & GCV40 Valve Assy	8 (1), (3)	C6331-103	D1162-002
E7763-103	Cyl & GCV40 Valve Assy	16 (1), (2)	C6331-104	D1162-003
E7763-123	Cyl & GCV40 Valve Assy	16 (1), (3)	C6331-104	D1162-003
E7763-104	Cyl & GCV40 Valve Assy	28 (1), (2)	C6331-104	D1162-004

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	Capacity (ltr)	Strap	Bracket No.
E7763-124	Cyl & GCV40 Valve Assy	28 (1), (3)	C6331-104	D1162-004
E7763-105	Cyl & GCV40 Valve Assy	51 (1), (2)	C6331-105	
E7763-106	Cyl & GCV50 Valve Assy	81 (1), (2)	C6331-105	
E7763-108	Cyl & GCV50 Valve Assy	142 (1), (2)	C6331-106	
B6793-720	Nitrogen Pilot Cylinder	1.77		B6793-721
E7763-101	Cyl & GCV40 Valve Assy	5 (1), (2)	C6331-103	D1162-001
E7763-121	Cyl & GCV40 Valve Assy	5 (1), (3)	C6331-103	D1162-001

**KIDDE GX20 Container Valves**

Product Name	Description
B6793-793	GCV40 valve
B6793-792	GCV50 valve

**KIDDE GX20 Discharge Hoses, Outlet Adapters, Discharge Manifolds, including Check Valves and Bracket**

Product Name	Description	Nominal bore (mm)
B6793-760	GCV40 Outlet Hose	40
B6793-761	GCV50 Outlet Hose	50
K63497-02	GCV40 Outlet Adaptor	40
K63497-03	GCV50 Outlet Adaptor	50
B6793-762	Elbow Check	50
D1511-006	2 Port Manifold	50
D1511-007	2 Port Manifold	80
D1511-009	2 Port Manifold	100
D1511-008	3 Port Manifold	80
D1511-010	3 Port Manifold	100

**KIDDE GX20 Pressure Switches and Devices**

Product Name	Description
B6793-730	Cylinder Contents Supervisory Pressure Switch
B6793-731	Discharge Pressure Switch
B6793-732	Discharge Pressure Switch (Explosion Proof)
	Pressure Switch
B6793-733	Pressure Trip

**KIDDE GX20 Discharge Nozzles**

Product Name	Description	Nominal bore (mm)
C3333-301-xx	180° Nozzle (4), (5)	15
C3333-302-xx	180° Nozzle (4), (5)	20
C3333-303-xx	180° Nozzle (4), (5)	25
C3333-304-xx	180° Nozzle (4), (5)	32
C3333-305-xx	180° Nozzle (4), (5)	40
C3333-306-xx	180° Nozzle (4), (5)	50
C3333-307-xx	360° Nozzle (4), (5)	15
C3333-308-xx	360° Nozzle (4), (5)	20
C3333-309-xx	360° Nozzle (4), (5)	25
C3333-310-xx	360° Nozzle (4), (5)	32
C3333-311-xx	360° Nozzle (4), (5)	40
C3333-312-xx	360° Nozzle (4), (5)	50

<sup>4</sup> Nozzles drilled in accordance with system calculations.

<sup>5</sup> Nozzles are manufactured from brass.

**KIDDE GX20 Valve Actuators**

Product Name	Description
B6793-701	Electric Control Head
B6793-702	Electric & Cable Control Head
B6793-703	Cable & Electric Control Head (Flameproof)
B6793-704	Cable Operated Control Head
B6793-705	Lever Operated Control Head

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

<b>Product Name</b>	<b>Description</b>
B6793-706	Pressure & Lever Operated Control Head
B6793-707	Pressure Operated Control Head
B6793-708	Pressure Operated Control Head (6)
B6793-709	Electric Control Head (6)

<sup>6</sup> Stackable configuration

#### **KIDDE GX20 Pilot Equipment**

<b>Product Name</b>	<b>Description</b>
B6793-770	Master Cylinder Adaptor Kit
B6793-771	559mm Long Pilot hose
B6793-772	762mm Long Pilot hose
B6793-773	Male Straight Adaptor
B6793-774	Male Elbow Adaptor
B6793-775	Male Branch Tee

Certificate No: 273a/01

#### **Kidde GX20 Check Valves**

<b>Product Name</b>	<b>LPCB Ref. No.</b>
B6793-808	273a/01
B6793-809	
B6793-810	
B6793-811	
B6793-812	

Notes:

- 1) This range of equipment is suitable for storage temperatures from -20°C to +50°C and is approved for use with HFC227ea (FM200).
- 2) This range of equipment is approved in conjunction with the Kidde GX20 Design, Installation, Operation and Maintenance Manual Ref. No. 59812-422 Issue D.
- 3) System pressure is specified as 25 bar @ 20°C and max. service pressure is 30 bar @ 50°C.

#### **ARGONITE C SERIES FIXED FIRE FIGHTING COMPONENTS**

1. This range of equipment is suitable for storage temperatures from -20°C to +50°C and is approved for use with Argonite.
2. This range of equipment is approved for use in conjunction with the Kidde Products Design manual reference: c60;- MA-01-9008-0100 (revision 1 dated November 2011)
3. System pressure is specified at 200 bar or 300 bar @ 15°C.
4. Cylinder is designed and manufactured in accordance with European Directive 2010/35/EU (TPED) through compliance with ISO 9809-2
5. A range of wall brackets, clamping bars, spacers and clamping bolts for secure container installation are also available.

Certificate No: 273b

#### **ARGONITE C Series Container/Valve Assemblies**

<b>Product Name</b>	<b>Description</b>	<b>Capacity (ltr)</b>	<b>System Pressure (bar)</b>	<b>LPCB Ref. No.</b>
01-1524-5900	C60 - 80.0 Litre Cylinder	80.0	300 (3), (4), (5)	273b/01

Certificate No: 273b

#### **ARGONITE C Series Single Area Manifolds**

<b>Product Name</b>	<b>Description</b>	<b>No. cylinders</b>	<b>System pressure (bar)</b>	<b>LPCB Ref. No.</b>
01-3506-5112 to 01-3506-5116	Single Row Argonite C Series Discharge Manifold	2 to 6	60	273b/04
01-3506-5124 to 01-3506-5128	Double Row Argonite C Series Discharge Manifold	4 to 8	60	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 273b to EN 12094-13

**ARGONITE C Series Manifold Check Valves**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6546-0000	Manifold Check Valve	1" BSPT x ¾" BSPP	300	273b/05

Certificate No: 273b to EN 12094-8

**ARGONITE C Series Hoses**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-3288-0100	Discharge Hose	DN15	300	273b/06

Certificate No: 273b to EN 12094-4

**ARGONITE C Series Container Valves**

Product Name	Description	System Pressure (bar)	LPCB Ref. No.
01-6481-0300	Argonite C60 Valve	300	273b/02

Certificate No: 273b to EN 12094-4

**ARGONITE C Series Valve Actuators & Release Units**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-4181-0000	Pneumatic Actuator	300	273b/03
01-7172-8300	Manual/Electrical Release Unit	300	

Certificate No: 273b to EN12094 Part 10

**Argonite C Series Pressure Monitoring Devices**

Product Name	Description	System Pressure (bar)	LPCB Ref. No.
01-7171-8300	Pressure Gauge Unit	300	273b/07

**KIDDE INERT GAS FIXED FIRE FIGHTING COMPONENTS**

1. This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with Argonite® (IG55), IG01, IG100 and IG541.
2. This range of equipment is approved for use in conjunction with Kidde Products Design manual reference MA-01-9006-0100 (Revision 11 dated January 2015)
3. System pressure is specified at 150 bar, 200 bar and 300 bar @ 15°C.

Certificate No: 273d to Schedule of Requirements

**Kidde Inert Gas - Container and Container Bracket Assemblies**

Product Name	Description	Capacity (ltr)	System Pressure (bar)	LPCB Ref. No.
01-1331-590X (7)	15.9 Litre Cylinder	15.9	150 (4), (5)	273d/01
01-1311-590X (7)	67.5 Litre Cylinder	67.5	150 (4), (5)	
01-1321-590X (7)	80.0 Litre Cylinder	80.0	150 (4), (5)	
01-1332-590X (7)	15.9 Litre Cylinder	15.9	200 (4), (5)	
01-1312-590X (7)	67.5 Litre Cylinder	67.5	200 (4), (5)	
01-1322-590X (7)	80.0 Litre Cylinder	80.0	200 (4), (5)	
01-1334-590X (7)	15.9 Litre Cylinder	15.9	300 (4), (5)	
01-1314-590X (7)	67.5 Litre Cylinder	67.5	300 (4), (5)	
01-1324-590X (7)	80.0 Litre Cylinder	80.0	300 (4), (5)	
01-1394-590X (7)	140.0 Litre Cylinder	140.0	300 (4), (5)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

4. Cylinder is designed and manufactured in accordance with European Directive 2010/35/EU (TPED) through compliance with ISO 9809-2
5. A range of wall brackets, clamping bars, spacers and clamping bolts for secure container installation are also available
6. Cylinder is designed and manufactured in accordance with BS 5045-1 and is for Indian service only. Cylinder is not compliant with European Directive 84/225/EEC and the TPED.
7. Where X can be: 0 - Argonite® (IG55), 2 - Nitrogen (IG-100), 4 - Argon (IG-01) & 5 - IG-541.

Certificate No: 273d to EN 12094 part 8

**Kidde Inert Gas and Argonite® C Series - Hoses**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	Length (mm)	LPCB Ref. No.
01-3260-0200/1000	Actuation hose	DN5	150, 200 & 300	200-1000	273d/03
01-3261-0200/1000	Actuation Hose	DN5	150, 200 & 300	200-1000	
01-3271-1100/1200	Actuation Hose	DN5	150, 200 & 300	200-300	
01-3272-1100/1200	Actuation Hose	DN5	150, 200 & 300	250-500	
01-3273-1100/1200	Actuation Hose	DN5	150, 200 & 300	350-700	

Certificate No: 273d to EN 12094 part 8

**Kidde Inert Gas - Hoses**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	Length (mm)	LPCB Ref. No.
01-3284-0100/0200	Discharge Hose	DN9	150, 200 & 300	400-700	273d/03

Certificate No: 273d to Schedule of Requirements

**Kidde Inert Gas - Pressure Restrictor Assemblies**

Product Name	Description	Orifice size (mm)	System pressure (bar)	LPCB Ref. No.
01-370X-1030/1070 (8), (9), (10)	½" Restrictor Assembly	3-7	150, 200 & 300	273d/04
01-370X-3050/3180 (9)	1.0" Restrictor Assembly	5-18	150, 200 & 300	
01-370X-4120/4270 (9)	1½" Restrictor Assembly	12-27	150, 200 & 300	
01-370X-5200/5360 (9)	2.0" Restrictor Assembly	20-36	150, 200 & 300	

<sup>8</sup> Not available with NPT Female/NPT Female or NPT Female/BSP Female connections

<sup>9</sup> Where X can be 1 for NPT Male/NPT Female, 2 for NPT Female/NPT Female, 3 for NPT Male/BSP Female or 4 for NPT Female/BSP Female

<sup>10</sup> Also available with BSP Male/BSP Female (part no. 01-3706-1030/1070) or BSP Male/NPT Female connections (part no. 01-3705-1030/1070)

Certificate No: 273d to Schedule of Requirements

**Kidde Inert Gas and Argonite® C Series - Pressure Regulator Assemblies**

Product Name	Description	Orifice Size (mm)	System pressure (bar)	LPCB Ref. No.
01-6017-0000	Pressure Regulator	N/A	150, 200 & 300	273d/04

Certificate No: 273d to EN 12094 part 7

**Kidde Inert Gas and Argonite® C Series - Discharge Nozzles**

Product Name	Description	Orifice size (mm)	Nozzle pressure (bar)	LPCB Ref. No.
01-3465-X2030/X2100 (11)	½" Nozzle Assembly	3-10	60	273d/05
01-3465-X3070/X3140 (11)	¾" Nozzle Assembly	7-14	60	
01-3465-X4100/X4180 (11)	1" Nozzle Assembly	10-18	60	
01-3465-X5150/X5260 (11)	1½" Nozzle Assembly	15-26	60	

<sup>11</sup> Where X can be 1 for BSP or 2 for NPT connections

Certificate No: 273d to Schedule of Requirements

***Kidde Inert Gas - Single Area Manifolds***

Product Name	Description	No. cylinders	System pressure (bar)	LPCB Ref. No.
01-3506-2011 to 01-3506-2019	Single Row Discharge Manifold	1 to 10	150, 200	273d/06
01-3506-2021 to 01-3506-2029	Double Row Discharge Manifold	4 to 20	150, 200	
01-3506-3011 to 01-3506-3019	Single Row Discharge Manifold	1 to 10	300	
01-3506-3021 to 01-3506-3029	Double Row Discharge Manifold	4 to 20	300	

Certificate No: 273d to Schedule of Requirements

***Kidde Inert Gas and Argonite® C Series - Multi-Area Manifold Accessories***

Product Name	Description	System Pressure (bar)	LPCB Ref. No.
01-3508-0002	Pilot Manifold (2 Diverter Valves)	150, 200, 300 (12)	273d/06
01-3508-0003	Pilot Manifold (3 Diverter Valves)	150, 200, 300 (12)	
01-3508-0004	Pilot Manifold (4 Diverter Valves)	150, 200, 300 (12)	
01-3508-0005	Pilot Manifold (5 Diverter Valves)	150, 200, 300 (12)	

<sup>12</sup> Working Pressure Outlet 8 bar

Certificate No: 273d to EN 12094 part 5

***Kidde Inert Gas and Argonite® C Series - Diverter Valves***

Product Name	Description	Size	System pressure (bar)	LPCB Ref. No.
01-6240-1000	Diverter Valve	½"	150, 200 & 300	273d/08
01-6242-1000	Diverter Valve	1"	150, 200 & 300	
01-6244-1000	Diverter Valve	1½"	150, 200 & 300	
01-6246-1000	Diverter Valve	2"	150, 200 & 300	

Certificate No: 273d to EN 12094 part 13

***Kidde Inert Gas - Manifold Check Valves***

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6454-0000	Manifold Check Valve	½" BSP & ¾" NPT	150, 200 & 300	273d/09

Certificate No: 273d to EN 12094 part 4

***Kidde Inert Gas - Container Valves***

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-6471-0150	Pneumatic Argonite Valve	150	273d/10
01-6471-0200	Pneumatic Argonite Valve	200	
01-6471-0300	Pneumatic Argonite Valve	300	

Certificate No: 273d to EN 12094 part 4

***Kidde Inert Gas - Release Units***

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7172-1150	Release Unit	150	273d/11
01-7172-1200	Release Unit	200	
01-7172-1300	Release Unit	300	
01-7173-1150	Release Unit	150	
01-7173-1200	Release Unit	200	
01-7173-1300	Release Unit	300	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 273d to EN 12094 part 10

**Kidde Inert Gas and Argonite® C Series - Pressure Monitoring Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7221-0300	Manifold Pressure Gauge ½	150, 200 & 300	273d/15
03-5713-0000	Discharge Pressure Switch	Max operating pressure 90 bar	

Certificate No: 273d to EN 12094 part 10

**Kidde Inert Gas - Pressure Monitoring Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7171-1500	Pressure Gauge Unit	150	273d/15
01-7171-1200	Pressure Gauge Unit	200	
01-7171-1300	Pressure Gauge Unit	300	

Certificate No: 273d to Schedule of Requirements

**Kidde Inert Gas and Argonite® C Series - Pressure Relief Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-6653-0001/0101	Pressure Relief Device	150	273d/17
01-6653-0002/0102	Pressure Relief Device	200	
01-6653-0003/0103	Pressure Relief Device	300	

Certificate No: 273d to EN 12094 part 13 and Schedule of Requirements

**Kidde Inert Gas and Argonite® C Series - Pilot Line Equipment**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6363-0000	Pilot Line Check Valve	¼" BSP	150, 200 & 300	273d/18
01-3388-0000	Actuation Line Leak Bleeder Unit	-	150, 200 & 300	
01-4131-0000	Actuation Line T-Piece	DN5	150, 200 & 300	
01-4130-1000	Actuation Line Cross	DN5	150, 200 & 300	

Certificate No: 273e to EN 12094-13

**CO2 FIXED FIREFIGHTING COMPONENTS.**

Product Name	Description	Nominal Bore (mm)	System pressure (bar)	LPCB Ref. No.
D8562-008	Co2 NRV	DN2	140	273e/01

Certificate No: 273f to an LPCB schedule of requirements

**Kidde Inert Gas System (400 Series) Containers**

Product Name	Description	Container pressure, bar	LPCB Ref. No.
38-418021-XXX (3)	80.0 litre cylinder	200 (1) (2)	273f/01
38-418031-XXX (3)	80.0 litre cylinder	300 (1) (2)	273f/02
38-411431-XXX (3)	140.0 litre cylinder	300 (1) (2)	273f/03

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.



**Notes:**

- (1) Cylinder is designed and manufactured in accordance with European Directive 2010/35/EU (TPED) and/or UN (USA) through compliance with ISO 9809-2, ADR and/or DOT
- (2) A range of wall brackets, clamping bars, spacers and clamping bolts for secure container installation are available.
- (3) Where XXX can be: 055" = Argonite® (IG55), "100" = Nitrogen (IG-100), "001" = Argon (IG-01) or "541" = IG-541.

**Certificate No: 273g to EN 12094-4**

***Kidde Inert Gas (M400 Series) Container Valves***

Product Name	Description	LPCB Ref. No.
38-400000-001	Kidde Inert Gas Valve (400 Series) (1) 200/300 bar	273g/01

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) Nominal outlet pressure 55 bar.

**Certificate No: 273h to EN 12094-4**

***Kidde Inert Gas (M400 Series) Release Assemblies***

Product Name	Description	LPCB Ref. No.
38-400001-001	Release Unit (400 Series)-200 bar, manual/electric, N.O. Gauge 160 bar switch (1)	273h/01
38-400001-002	Release Unit (400 Series)-200 bar, manual/electric, N.C. Gauge 160 bar switch (1)	273h/02
38-400001-003	Release Unit (400 Series)-300 bar, manual/electric, N.O. Gauge 240 bar switch (1)	273h/03
38-400001-004	Release Unit (400 Series)-300 bar, manual/electric, N.C. Gauge 240 bar switch (1)	273h/04

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) Gauge switch type; Normally Closed (N.C.) or Normally Open (N.O.) under pressure at and above the Switchpoint

**Certificate No: 273i to EN 12094-10 and an LPCB schedule of requirements**

***Kidde Inert Gas System(400 Series) Pressure Monitoring Devices***

Product Name	Description	LPCB Ref. No.
38-400005-001	Pressure Gauge Unit, Gauge Switch N.O. 160 bar (1)	273i/01
38-400005-002	Pressure Gauge Unit, Gauge Switch N.C. 160 bar (1)	273i/02
38-400005-003	Pressure Gauge Unit, Gauge Switch N.O. 240 bar (1)	273i/03
38-400005-004	Pressure Gauge Unit, Gauge Switch N.C. 240 bar (1)	273i/04
01-7221-0300	Manifold Pressure Gauge	273i/05
03-5713-0000	Discharge Pressure Switch	273i/06

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) Gauge switch type; Normally Closed (N.C.) or Normally Open (N.O.) under pressure at and above the Switchpoint

**Certificate No: 273j to EN 12094-8:2006**

#### ***Kidde Inert Gas System (400 Series) Discharge and Pilot Connectors***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
38-401ABX-XXX (1)	Pilot Hose, ¼" Quick Connect (2)	273j/01
38-400ABX-XXX (3)	Discharge Hose ¾"	273j/02
01-3273-1000	¼" Straight x 90° for Selector Valve actuation	273j/03

#### **KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) A or B at either end or both ends of the hose is defined as:  
1 = Straight coupling, zinc plated mild steel  
2 = 45°, set 0°, zinc plated mild steel  
3 = 90°, set 0°, zinc plated mild steel  
X-XXX = length of Hose in mm (300-3000)
- (2) Approved for use with Festo couplings
- (3) A or B at either end or both ends of the hose is defined as:  
1 = Straight coupling, zinc plated mild steel  
2 = 45°, set 180°, zinc plated mild steel  
3 = 90°, set 180°, zinc plated mild steel  
X-XXX = length of Hose in mm (300-3000)

**Certificate No: 273k to EN 12094-13**

#### ***Kidde Inert Gas System (400 Series) Pilot Line Equipment***

<b>Product Name</b>	<b>Description</b>	<b>Nominal bore, mm</b>	<b>Working pressure, bar</b>	<b>LPCB Ref. No.</b>
38-400002-003	Pilot Line Non-Return Valve	2	10	273k/01

#### **KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Certificate No: 273l to an LPCB schedule of requirements**

#### ***Kidde Inert Gas System (400 Series) Manifolds***

<b>Product Name</b>	<b>Description</b>	<b>No. cylinders</b>	<b>Working pressure, bar</b>	<b>LPCB Ref. No.</b>
38-351000-004 to 38-351000-008	Single Row, Kidde IGS 400 Series Discharge Manifold (80L cylinders)	2 to 6	70	273l/01
38-351000-009 to 38-351000-011	Double Row, Kidde IGS 400 Series Discharge Manifold (80L cylinders)	4 to 8	70	273l/02

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	No. cylinders	Working pressure, bar	LPCB Ref. No.
38-351140-004 to 38-351140-008	Single Row, Kidde IGS 400 Series Discharge Manifold (140L cylinders)	2 to 6	70	273l/03
38-351140-009 to 38-351140-011	Single Row, Kidde IGS 400 Series Discharge Manifold (140L cylinders)	4 to 8	70	273l/04

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

Certificate No: 273m to EN 12094-13

***Kidde Inert Gas System (400 Series) Manifold Check Valve***

Product Name	Description	Nominal bore, mm	Working pressure, bar	LPCB Ref. No.
38-400002-002	Manifold Check Valve	14	300	273m/01

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

Certificate No: 273n to an LPCB schedule of requirements

***Kidde Inert Gas System(400 Series) Pressure Relief Devices***

Product Name	Description	Working pressure, bar	LPCB Ref. No.
38-400006-002	Manifold Pressure Relief Device	70	273n/01

**KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS**

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

Certificate No: 273s to EN 12094-5

***Kidde Inert Gas (M400 Series) Selector Valves***

Product Name	Description	Max Working pressure, bar	LPCB Ref. No.
22-37140-025	1 Selector Valve	140	273s/01
22-37140-040	1 ½ " Selector Valve	140	273s/02
22-37140-050	2 Selector Valve	140	273s/03
22-37140-080	3 Selector Valve	140	273s/04
22-37140-100	4 Selector Valve	140	273s/05

Certificate No: 273p to an LPCB schedule of requirements

***Kidde Inert Gas System (400 Series) Multi-area Manifold Accessories***

Product Name	Description	LPCB Ref. No.
01-3508-0002	Pilot Manifold (2 Divertor Valves)	273p/01
01-3508-0003	Pilot Manifold (3 Divertor Valves)	273p/02
01-3508-0004	Pilot Manifold (4 Divertor Valves)	273p/03
01-3508-0005	Pilot Manifold (5 Divertor Valves)	273p/04

## PART 4: SECTION 2.1

### GASEOUS SYSTEM COMPONENTS

#### KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

Outlet pressure 8 bar.

Certificate No: 273q to prEN12094-7 and an LPCB schedule of requirements

#### *Kidde Inert Gas System(400 Series) Nozzles*

Product Name	Description	Orifice Size (mm)	LPCB Ref. No.
38-4A7100-XXX (1)(2)	½" Nozzle assembly - 360° Holes	3 10	273q/01
38-4A7200-XXX (1)(2)	¾" Nozzle assembly - 360° Holes	7 13.5	273q/02
38-4A7300-XXX (1)(2)	1" Nozzle assembly - 360° Holes	10 17	273q/03
38-4A7400-XXX (1)(2)	1½" Nozzle assembly - 360° Holes	14 - 26	273q/04
38-4A7500-XXX (1)(2)	½" Nozzle assembly - 180° Holes	3 10	273q/05
38-4A7600-XXX (1)(2)	¾" Nozzle assembly - 180° Holes	7 13.5	273q/06
38-4A7700-XXX (1)(2)	1" Nozzle assembly - 180° Holes	10 17	273q/07
38-4A7800-XXX (1)(2)	1½" Nozzle assembly - 180° Holes	14 - 26	273q/08

#### KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) Where XXX is Orifice size, e.g. 070 = 7mm, 075 = 7.5mm, 115 = 11.5mm, etc  
 (2) Where A can be 1 for BSP and 0 for NPT connections

Certificate No: 273r to an LPCB schedule of requirements

#### *Kidde Inert Gas System (400, 469 & C60 Series) Nozzle Sound Reduction Devices*

Product Name	Description	Orifice Size (mm)	LPCB Ref. No.
01-3470-0015	½" Nozzle Silencer (1)	3 10 (2)	273r/01
01-3470-0020	¾" Nozzle Silencer (1)	7 13.5 (2)	273r/02
01-3470-0025	1 Nozzle Silencer (1)	10 17 (2)	273r/03
01-3470-1015	½" FSN 112 Nozzle Silencer (1)	3 10 (2)	273r/04

#### KIDDE INERT GAS SYSTEM (400) SERIES), FIXED FIRE FIGHTING COMPONENTS

- This range of equipment is suitable for storage temperatures -20°C to +50°C and is approved for use with: Argonite® (IG55), Nitrogen (IG-100), Argon (IG-01) and IG541
- This range of equipment is approved for use in conjunction with Kidde Fire Protection Design manual reference: 06-237518-001 (Revision AA dated May 2018)
- System pressure is specified at 200 bar and 300 bar @ 15°C.

**Notes:**

- (1) BSP thread  
 (2) For use in connection with Kidde with Kidde IGS - 400, 469 & C60 Series 360° Nozzle Assemblies

**Kidde-Fenwal, Inc.**

400 Main Street, Ashland, Massachusetts 01721, USA  
Tel: +1 508 881 2000 • Fax: +1 508 881 6729  
Website: [www.kiddefiresystems.com](http://www.kiddefiresystems.com) and [www.fenwalfire.com](http://www.fenwalfire.com)

Certificate No: 273Bf to an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas (400 Series) Containers**

Product Name	Description	Container pressure, bar	LPCB Ref. No.
38-428021-XXX (3)	80.0 litre cylinder	200 (1) (2)	273Bf/01
38-428031-XXX (3)	80.0 litre cylinder	300 (1) (2)	273Bf/02
38-421431-XXX (3)	140.0 litre cylinder	300 (1) (2)	273Bf/03

Certificate No: 273Bg to EN12094-4

**Kidde Fire Systems Natura™ Inert Gas (400 Series) Container Valves**

Product Name	Description	LPCB Ref. No.
38-400000-001	Natura™ Inert Gas Valve (400 Series) (1) 200/300 bar	273Bg/01

Certificate No: 273Bh to EN12094-4

**Kidde Fire Systems Natura™ Inert Gas (M400 Series) Release Assemblies**

Product Name	Description	LPCB Ref. No.
38-400001-001	Release Unit (400 Series)-200 bar, manual/electric, N.O. Gauge 160 bar switch (1)	273Bh/01
38-400001-002	Release Unit (400 Series)-200 bar, manual/electric, N.C. Gauge 160 bar switch (1)	273Bh/02
38-400001-003	Release Unit (400 Series)-300 bar, manual/electric, N.O. Gauge 240 bar switch (1)	273Bh/03
38-400001-004	Release Unit (400 Series)-300 bar, manual/electric, N.C. Gauge 240 bar switch (1)	273Bh/04

Certificate No: 273Bi to EN12094-10 and an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Pressure Monitoring Devices**

Product Name	Description	LPCB Ref. No.
38-400005-001	Pressure Gauge Unit, Gauge Switch N.O. 160 bar (1)	273Bi/01
38-400005-002	Pressure Gauge Unit, Gauge Switch N.C. 160 bar (1)	273Bi/02
38-400005-003	Pressure Gauge Unit, Gauge Switch N.O. 240 bar (1)	273Bi/03
38-400005-004	Pressure Gauge Unit, Gauge Switch N.C. 240 bar (1)	273Bi/04
01-7221-0300	Manifold Pressure Gauge	273Bi/05
03-5713-0000	Discharge Pressure Switch	273Bi/06

Certificate No: 273Bj to EN 12094-8:2006

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Discharge and Pilot Connectors**

Product Name	Description	LPCB Ref. No.
38-401ABX-XXX (1)	Pilot Hose, ¼" Quick Connect (2)	273Bj/01
38-400ABX-XXX (3)	Discharge Hose ¾"	273Bj/02
01-3273-1000	¼" Straight x 90° for Selector Valve actuation	273Bj/03

Certificate No: 273Bk to EN12094-13

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Pilot Line Equipment**

Product Name	Description	Nominal bore, mm	Working pressure, bar	LPCB Ref. No.
38-400002-003	Pilot Line Non-Return Valve	2	10	273Bk/01

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 273BI to an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Manifolds**

Product Name	Description	No. cylinders	Working pressure, bar	LPCB Ref. No.
38-351000-004 to 38-351000-008	Single Row, Kidde IGS 400 Series Discharge Manifold (80L cylinders)	2 to 6	70	273BI/01
38-351000-009 to 38-351000-011	Double Row, Kidde IGS 400 Series Discharge Manifold (80L cylinders)	4 to 8	70	273BI/02
38-351140-004 to 38-351140-008	Single Row, Kidde IGS 400 Series Discharge Manifold (140L cylinders)	2 to 6	70	273BI/03
38-351140-009 to 38-351140-011	Single Row, Kidde IGS 400 Series Discharge Manifold (140L cylinders)	4 to 8	70	273BI/04

Certificate No: 273m to EN12094-13

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Manifold Check Valve**

Product Name	Description	Nominal bore, mm	Working pressure, bar	LPCB Ref. No.
38-400002-002	Manifold Check Valve	14	300	273Bm/01

Certificate No: 273Bn to an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Pressure Relief Devices**

Product Name	Description	Working pressure, bar	LPCB Ref. No.
38-400006-002	Manifold Pressure Relief Device	70	273Bn/01

Certificate No: 273Bp to an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Multi-area Manifold Accessories**

Product Name	Description	LPCB Ref. No.
01-3508-0002	Pilot Manifold (2 Divertor Valves)	273Bp/01
01-3508-0003	Pilot Manifold (3 Divertor Valves)	273Bp/02
01-3508-0004	Pilot Manifold (4 Divertor Valves)	273Bp/03
01-3508-0005	Pilot Manifold (5 Divertor Valves)	273Bp/04

Certificate No: 273Bq to prEN12094-7

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Nozzles**

Product Name	Description	Orifice Size (mm)	LPCB Ref. No.
38-4A7100-XXX (1)(2)	½" Nozzle assembly - 360° Holes	3 10	273Bq/01
38-4A7200-XXX (1)(2)	¾" Nozzle assembly - 360° Holes	7 13.5	273Bq/02
38-4A7300-XXX (1)(2)	1" Nozzle assembly - 360° Holes	10 17	273Bq/03
38-4A7400-XXX (1)(2)	1½" Nozzle assembly - 360° Holes	14 26	273Bq/04
38-4A7500-XXX (1)(2)	½" Nozzle assembly - 180° Holes	3 10	273Bq/05
38-4A7600-XXX (1)(2)	¾" Nozzle assembly - 180° Holes	7 13.5	273Bq/06
38-4A7700-XXX (1)(2)	1" Nozzle assembly - 180° Holes	10 17	273Bq/07
38-4A7800-XXX (1)(2)	1½" Nozzle assembly - 180° Holes	14 - 26	273Bq/08

Certificate No: 273Br to an LPCB schedule of requirements

**Kidde Fire Systems Natura™ Inert Gas System (400, 469 & C60 Series) Nozzle Sound Reduction Devices**

Product Name	Description	Orifice Size (mm)	LPCB Ref. No.
01-3470-0015	½" Nozzle Silencer (1)	3 10 (2)	273Br/01

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	Orifice Size (mm)	LPCB Ref. No.
01-3470-0020	¾" Nozzle Silencer (1)	7 13.5 (2)	273Br/02
01-3470-0025	1 Nozzle Silencer (1)	10 17 (2)	273Br/03
01-3470-1015	½" FSN 112 Nozzle Silencer (1)	3 10 (2)	273Br/04

Certificate No: 273Bs to EN12094-5

**Kidde Fire Systems Natura™ Inert Gas System (400 Series) Selector Valves**

Product Name	Description	Working pressure, bar	LPCB Ref. No.
22-37140-025	1 Selector Valve	140	273Bs/01
22-37140-040	1 ½" Selector Valve	140	273Bs/02
22-37140-050	2 Selector Valve	140	273Bs/03
22-37140-080	3 Selector Valve	140	273Bs/04
22-37140-100	4 Selector Valve	140	273Bs/05

**ARGONITE C60 FIXED FIRE FIGHTING COMPONENTS**

- <sup>1</sup> This range of equipment is suitable for storage temperatures from -20°C to +50°C and is approved for use with Argonite.  
<sup>2</sup> This range of equipment is approved for use in conjunction with the Kidde Fenwal design manual reference MA-01-9008-0102 (revision 0 dated July 2010)  
<sup>3</sup> System pressure is specified at 300 bar @ 15°C.  
<sup>4</sup> Cylinder is designed and manufactured in accordance with European Directive 1999/36/EEC (TPED) through compliance with EN1964-2  
<sup>5</sup> Actuation hoses are available in a variety of lengths

Certificate No: 594Ba

**ARGONITE Hoses**

Product Name	Description	Nominal bore (mm)	System pressure (bar)	LPCB Ref. No.
01-3260-0100/1000	Actuation Hose <sup>(5)</sup>	DN5	300	594Ba/03
01-3261-0100/1000	Actuation Hose <sup>(5)</sup>	DN5	300	
01-3271-1100/1200	Actuation Hose <sup>(5)</sup>	DN5	300	
01-3272-1100/1200	Actuation Hose <sup>(5)</sup>	DN5	300	
01-3273-1100/1200	Actuation Hose <sup>(5)</sup>	DN5	300	

Certificate No: 594Ba

**ARGONITE Pilot Line Equipment**

Product Name	Description	Nominal Bore (mm)	System pressure (bar)	LPCB Ref. No.
01-6363-0000	¼" Pilot Line Check Valve	-	300	594Ba/18
01-3388-0000	Actuation Line Leak Bleeder Unit	-	300	
15-8685-0651	Actuation Line T-Piece	DN5	-	

Certificate No: 594Ba  
Certificate No: 594Ba

**ARGONITE Divertor Valves**

Product Name	Description	System pressure (bar)
--------------	-------------	-----------------------

Certificate No: 594Ba

**ARGONITE Pressure Relief Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-6653-0003/0103	Pressure Relief Device	300	594Ba/17

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 594Ba

**ARGONITE Pressure Monitoring Devices**

Product Name	Description	System pressure (bar)	LPCB Ref. No.
01-7221-0300	Manifold Pressure Gauge (½")	300	594Ba/15
03-5713-0000	Discharge Pressure Switch	300	

**Macron Safety Systems (UK) Ltd**

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom

Tel: +44 (0)1493 417600 • Fax: +44 (0)1493 417700

E-mail: [infogy@tycoint.com](mailto:infogy@tycoint.com) • Website: [www.macron-safety.com](http://www.macron-safety.com)

Certificate No: 587a

**FM-200® 25 bar CONTAINER ASSEMBLIES - DOT (WELDED)**

Product Name	Description	LPCB Ref. No.
303.205.026	4.5 litre container assembly (DOT) (Welded)	587a/01
303.205.015	8 litre container assembly (DOT) (Welded)	
303.205.016	16 litre container assembly (DOT) (Welded)	
303.205.017	32 litre container assembly (DOT) (Welded)	
303.205.018	52 litre container assembly (DOT) (Welded)	
303.205.019	106 litre container assembly (DOT) (Welded)	
303.205.020	147 litre container assembly (DOT) (Welded)	587a/02
303.205.021	180 litre container assembly (DOT) (Welded)	
303.205.068	4.5 litre container assembly (DOT) (Welded) (ATEX)	
303.205.069	8 litre container assembly (DOT) (Welded) (ATEX)	
303.205.070	16 litre container assembly (DOT) (Welded) (ATEX)	
303.205.071	32 litre container assembly (DOT) (Welded) (ATEX)	
303.205.072	52 litre container assembly (DOT) (Welded) (ATEX)	
303.205.073	106 litre container assembly (DOT) (Welded) (ATEX)	
303.205.074	147 litre container assembly (DOT) (Welded) (ATEX)	
303.205.075	180 litre container assembly (DOT) (Welded) (ATEX)	

Certificate No: 587a

**FM-200® 25 bar CONTAINER ASSEMBLIES - TPED (WELDED)**

Product Name	Description	LPCB Ref. No.
303.205.002	8 litre container assembly (TPED)	587a/03
303.205.003	16 litre container assembly (TPED)	
303.205.004	32 litre container assembly (TPED)	
303.205.012	52 litre container assembly (TPED)	
303.205.013	106 litre container assembly (TPED)	
303.205.014	147 litre container assembly (TPED)	
303.205.005	180 litre container assembly (TPED)	587a/04
303.205.076	8 litre container assembly (TPED) (ATEX)	
303.205.077	16 litre container assembly (TPED) (ATEX)	
303.205.078	32 litre container assembly (TPED) (ATEX)	
303.205.079	52 litre container assembly (TPED) (ATEX)	
303.205.080	106 litre container assembly (TPED) (ATEX)	
303.205.081	147 litre container assembly (TPED) (ATEX)	
303.205.082	180 litre container assembly (TPED) (ATEX)	

Certificate No: 587a

**FM-200® 25bar CONTAINER ASSEMBLIES - TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303205300	15 litre container assembly (TPED)	587a/05



**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	LPCB Ref. No.
303205301	30 litre container assembly (TPED)	
303205302	45 litre container assembly (TPED)	
303205303	60 litre container assembly (TPED)	
303205304	120 litre container assembly (TPED)	
303205305	150 litre container assembly (TPED)	
303205306	180 litre container assembly (TPED)	
303205330	15 litre container assembly (TPED) (ATEX)	587a/06
303205331	30 litre container assembly (TPED) (ATEX)	
303205332	45 litre container assembly (TPED) (ATEX)	
303205333	60 litre container assembly (TPED) (ATEX)	
303205334	120 litre container assembly (TPED) (ATEX)	
303205335	150 litre container assembly (TPED) (ATEX)	
303205336	180 litre container assembly (TPED) (ATEX)	

Certificate No: 587a

**FM-200® 25bar CONTAINER ASSEMBLIES – DOT/TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303205310	15 litre container assembly (DOT/TPED)	587a/07
303205311	30 litre container assembly (DOT/TPED)	
303205312	45 litre container assembly (DOT/TPED)	
303205313	60 litre container assembly (DOT/TPED)	
303205314	120 litre container assembly (DOT/TPED)	
303205315	150 litre container assembly (DOT/TPED)	
303205316	180 litre container assembly (DOT/TPED)	
303205340	15 litre container assembly (DOT/TPED) (ATEX)	587a/08
303205341	30 litre container assembly (DOT/TPED) (ATEX)	
303205342	45 litre container assembly (DOT/TPED) (ATEX)	
303205343	60 litre container assembly (DOT/TPED) (ATEX)	
303205344	120 litre container assembly (DOT/TPED) (ATEX)	
303205345	303205345	
303205346	180 litre container assembly (DOT/TPED) (ATEX)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25 bar CONTAINER ASSEMBLIES - DOT (WELDED)**

Product Name	Description	LPCB Ref. No.
303.207.010	4.5 litre container assembly (DOT) (Welded)	587a/09
303.207.001	8 litre container assembly (DOT) (Welded)	
303.207.002	16 litre container assembly (DOT) (Welded)	
303.207.003	32 litre container assembly (DOT) (Welded)	
303.207.004	52 litre container assembly (DOT) (Welded)	
303.207.005	106 litre container assembly (DOT) (Welded)	
303.207.006	147 litre container assembly (DOT) (Welded)	
303.207.007	180 litre container assembly (DOT) (Welded)	
303.207.051	4.5 litre container assembly (DOT) (Welded) (ATEX)	587a/10
303.207.052	8 litre container assembly (DOT) (Welded) (ATEX)	
303.207.053	16 litre container assembly (DOT) (Welded) (ATEX)	
303.207.054	32 litre container assembly (DOT) (Welded) (ATEX)	
303.207.055	52 litre container assembly (DOT) (Welded) (ATEX)	
303.207.056	106 litre container assembly (DOT) (Welded) (ATEX)	
303.207.057	147 litre container assembly (DOT) (Welded) (ATEX)	
303.207.058	180 litre container assembly (DOT) (Welded) (ATEX)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25 bar CONTAINER ASSEMBLIES - TPED (WELDED)**

Product Name	Description	LPCB Ref. No.
303.207.015	8 litre container assembly (TPED)	587a/11
303.207.016	16 litre container assembly (TPED)	
303.207.017	32 litre container assembly (TPED)	
303.207.012	52 litre container assembly (TPED)	
303.207.013	106 litre container assembly (TPED)	

**PART 4: SECTION 2.1**  
**GASEOUS SYSTEM COMPONENTS**

Product Name	Description	LPCB Ref. No.
303.207.014	147 litre container assembly (TPED)	587a/12
303.207.018	180 litre container assembly (TPED)	
303.207.059	8 litre container assembly (TPED) (ATEX)	
303.207.060	16 litre container assembly (TPED) (ATEX)	
303.207.061	32 litre container assembly (TPED) (ATEX)	
303.207.062	52 litre container assembly (TPED) (ATEX)	
303.207.063	106 litre container assembly (TPED) (ATEX)	
303.207.064	147 litre container assembly (TPED) (ATEX)	
303.207.065	180 litre container assembly (TPED) (ATEX)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25bar CONTAINER ASSEMBLIES - TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303207300	15 litre container assembly (TPED)	587a/13
303207301	30 litre container assembly (TPED)	
303207302	45 litre container assembly (TPED)	587a/14
303207303	60 litre container assembly (TPED)	
303207304	120 litre container assembly (TPED)	
303207305	150 litre container assembly (TPED)	
303207306	180 litre container assembly (TPED)	
303207330	15 litre container assembly (TPED) (ATEX)	
303207331	30 litre container assembly (TPED) (ATEX)	
303207332	45 litre container assembly (TPED) (ATEX)	
303207333	60 litre container assembly (TPED) (ATEX)	
303207334	120 litre container assembly (TPED) (ATEX)	
303207335	150 litre container assembly (TPED) (ATEX)	
303207336	180 litre container assembly (TPED) (ATEX)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25bar CONTAINER ASSEMBLIES – DOT/TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303207310	15 litre container assembly (DOT/TPED)	587a/15
303207311	30 litre container assembly (DOT/TPED)	
303207312	45 litre container assembly (DOT/TPED)	587a/16
303207313	60 litre container assembly (DOT/TPED)	
303207314	120 litre container assembly (DOT/TPED)	
303207315	150 litre container assembly (DOT/TPED)	
303207316	180 litre container assembly (DOT/TPED)	
303207340	15 litre container assembly (DOT/TPED) (ATEX)	
303207341	30 litre container assembly (DOT/TPED) (ATEX)	
303207342	45 litre container assembly (DOT/TPED) (ATEX)	
303207343	60 litre container assembly (DOT/TPED) (ATEX)	
303207344	120 litre container assembly (DOT/TPED) (ATEX)	
303207345	150 litre container assembly (DOT/TPED) (ATEX)	
303207346	180 litre container assembly (DOT/TPED) (ATEX)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 41 bar CONTAINER ASSEMBLIES - TPED (WELDED)**

Product Name	Description	LPCB Ref. No.
303.207.030	8 litre container assembly (TPED)	587a/17
303.207.031	16 litre container assembly (TPED)	
303.207.032	32 litre container assembly (TPED)	
303.207.033	52 litre container assembly (TPED)	
303.207.034	106 litre container assembly (TPED)	
303.207.035	147 litre container assembly (TPED)	
303.207.036	180 litre container assembly (TPED)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 42bar CONTAINER ASSEMBLIES - TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303207400	15 litre container assembly (TPED)	587a/18
303207401	30 litre container assembly (TPED)	
303207402	45 litre container assembly (TPED)	
303207403	60 litre container assembly (TPED)	
303207404	120 litre container assembly (TPED)	
303207405	150 litre container assembly (TPED)	
303207406	180 litre container assembly (TPED)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 42bar CONTAINER ASSEMBLIES – DOT/TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303207410	15 litre container assembly (DOT/TPED)	587a/19
303207411	30 litre container assembly (DOT/TPED)	
303207412	45 litre container assembly (DOT/TPED)	
303207413	60 litre container assembly (DOT/TPED)	
303207414	120 litre container assembly (DOT/TPED)	
303207415	150 litre container assembly (DOT/TPED)	
303207416	303207416	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 70 bar CONTAINER ASSEMBLIES - TPED (SEAMLESS)**

Product Name	Description	LPCB Ref. No.
303700001	15 litre container assembly (TPED) PG 50C	587a/20
303700002	30 litre container assembly (TPED) PG 50C	
303700003	45 litre container assembly (TPED) PG 50C	
303700004	60 litre container assembly (TPED) PG 50C	
303700005	120 litre container assembly (TPED) PG 50C	
303700006	180 litre container assembly (TPED) PG 50C	
303700007	15 litre container assembly (TPED) PGS 50C	587a/21
303700008	30 litre container assembly (TPED) PGS 50C	
303700009	45 litre container assembly (TPED) PGS 50C	
303700010	60 litre container assembly (TPED) PGS 50C	
303700011	120 litre container assembly (TPED) PGS 50C	
303700012	180 litre container assembly (TPED) PGS 50C	

Certificate No: 587a

**CONTAINERS BRACKETS (WELDED CONTAINERS)**

Product Name	Description	LPCB Ref. No.
311700013	4.5 litre container bracket (strap style)	587a/22
311700014	8/16/32 litre container bracket (strap style)	
311700006	52/106/147/180 litre container bracket (strap style)	

Certificate No: 587a

**CONTAINER BRACKETS (SEAMLESS CONTAINERS)**

Product Name	Description	LPCB Ref. No.
311700002	15 litre container bracket 204mm Dia. (strap style)	587a/23
311700003	30 litre container bracket 229mm Dia (strap style)	
311700004	45 & 60 litre container bracket 267mm Dia (strap style)	
311700005	120 litre container bracket 360mm Dia (strap style)	
311700006	180 litre container bracket 406mm Dia (strap style)	
311700007	120 & 150 litre container multi-bracket Assy x 4 360mm Dia (strap style)	
		587a/24

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	LPCB Ref. No.
311700008	120 & 150 litre container multi-bracket Assy x 6 360mm Dia (strap style)	
311700009	120 & 150 litre container multi-bracket Assy x 8 360mm Dia (strap style)	
311700010	180 litre container multi-bracket Assy x 4 406mm Dia (strap style)	
311700011	180 litre container multi-bracket Assy x 6 406mm Dia (strap style)	
311700012	180 litre container multi-bracket Assy x 8 406mm Dia (strap style)	

Certificate No: 587a

**CONTAINERS BRACKETS (PILOT CONTAINERS)**

Product Name	Description	LPCB Ref. No.
30620310	3 litre PILOT container bracket 100mm diam.	587a/25
30621310	13 litre PILOT container bracket 140mm diam.	
30625010	50 litre PILOT container bracket 229mm diam.	

Certificate No: 587a

**CONTAINER VALVES & ACTUATORS 25/41/70 bar**

Product Name	Description	LPCB Ref. No.
302.209.001	25mm container valve (25bar)	587a/26
302.209.002	50mm container valve (25bar)	
302.209.015	25mm container valve (25bar) (ATEX)	587a/27
302.209.016	50mm container valve (25bar) (ATEX)	
302.209.006	25mm container valve (42bar)	587a/28
302.209.007	50mm container valve (42bar)	
302.209.022	25mm container valve (alternative burst disc) (41bar)	587a/29
302.209.023	50mm container valve (alternative burst disc) (41bar)	
302700001	25mm container valve (70bar)	587a/30
304.001.001	Electrical actuator - DIN plug and lead (suppression diode) (25/41bar)	587a/31
302700002	50mm container valve (70bar)	587a/30
304.001.002	Electrical actuator - DIN plug and lead (bridge rectifier) (25/41bar)	587a/31
304.205.001	Electrical actuator - standard (suppression diode) (25/41bar)	
304.209.001	Electrical actuator - standard (bridge rectifier UL) (25/41bar)	
304.205.002	Electrical actuator - flameproof (ATEX) (25bar)	
304.205.010	Electrical actuator - standard (suppression diode UL) (25/41bar)	
304205030	Electrical actuator (TLX) (25/41bar)	
304205040	Electrical actuator (TLX) (25/41bar)	
304.209.002	Local manual actuator (25/41bar)	587a/32
304.209.004	Pneumatic actuator	
304700001	Electrical actuator TLX (70bar)	587a/33
304700002	Electrical actuator Barnbrook (70bar)	
304700003	Manual/Pneumatic actuator	587a/34
304.209.011	ATEX electrical actuator - 25 mm valve support brackets (25bar)	587a/35
304.209.012	ATEX electrical actuator - 50 mm valve support brackets (25bar)	

Certificate No: 587a

**PRESSURE GAUGES and PRESSURE SWITCHES**

Product Name	Description	LPCB Ref. No.
304.205.006	Supervisory pressure switch - standard (open on fall) (25bar)	587a/36
305.209.005	Supervisory pressure switch - special (close on fall) (25bar)	
305.209.007	Supervisory pressure switch - conduit (open or close on fall) (25bar)	
305.205.004	Supervisory pressure switch - ATEX (25bar)	
305.207.001	Supervisory pressure switch - (open or close on fall) (41/42bar)	
305.209.009	Discharge pressure switch - standard (25/41/70bar)	587a/37
305.205.003	Discharge pressure switch- ATEX (25bar)	
302.205.022	Pressure Gauge (50mm) FM-200® 0-60 bar (25bar)	587a/38
302.207.010	Pressure Gauge (50mm) Sapphire™ (Novac 1230) 0-60 bar (25bar)	
302.205.026	Pressure Gauge (50mm) FM-200® 0-60 bar (25bar) UL/FM/CE - WIKA	587a/39
302.207.017	Pressure Gauge (50mm) SAPPHIRE™ (Novac 1230) 0-60 bar (25bar) UL/FM/CE	
302.207.011	Pressure Gauge (50mm) Sapphire™ (Novac 1230) 0-100 bar (41bar)	
302.209.012	Pilot Pressure Gauge (50mm) 0-100 bar (50bar)	
302.209.027	Pressure Gauge (50mm) 0-40 bar (VdS dial) (25bar)	587a/40

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Product Name	Description	LPCB Ref. No.
302.209.026	Pressure Gauge (50mm) 0-60 bar (VdS dial) (41bar)	
302209028	Contacted Pressure Gauge (50mm) SAPPHIRE™ (Novec 1230) 0-60bar (41/42bar) open on fall 38bar	587a/41
302209029	Contacted Pressure Gauge (50mm) SAPPHIRE™ (Novec 1230) 0-60bar (41/42bar) close on fall 38bar	
302700003	Pressure Gauge (50mm) SAPPHIRE™ PLUS (Novec 1230) 0-160bar (50C) (70bar)	587a/42
302700004	Contacted Pressure Gauge (50mm) SAPPHIRE™ PLUS (Novec 1230) 0-160bar (50C) (70bar) open on fall 63bar	
302700005	Pressure Gauge (50mm) SAPPHIRE™ PLUS (Novec 1230) 0-160bar (70bar) (50C) (with UL/FM 65C marking)	
302700006	Contacted Pressure Gauge (50mm) SAPPHIRE™ PLUS (Novec 1230) 0-160bar (70bar) (50C) (with UL/FM 65C marking) open on fall 65bar	
30116054	Contacted Pressure Gauge (40mm) Pilot 0-160 bar (50C) (100bar) open on fall (90bar)	587a/43

Certificate No: 587a

**VALVE UNION ADAPTORS**

Product Name	Description	LPCB Ref. No.
309002016	25mm Valve Union Adaptor (BSPP X NPT)	587a/44
309002017	50mm Valve Union Adaptor (BSPP X NPT)	
309002018	25mm Valve Union Adaptor (BSPP X BSPT)	
309002019	50mm Valve Union Adaptor (BSPP X BSPT)	

Certificate No: 587a

**PILOT HOSES**

Product Name	Description	LPCB Ref. No.
306.205.003	Flexible pilot/actuation hose x 710mm	587a/45
306205010	Flexible pilot/actuation hose x 815mm	
306205011	Flexible pilot/actuation hose x 1070mm	

Certificate No: 587a

**DISCHARGE HOSES 25 to 42bar**

Product Name	Description	LPCB Ref. No.
306.207.002	25 mm discharge hose	587a/46
306.207.003	50 mm discharge hose	

Certificate No: 587a

**DISCHARGE HOSES 70 bar**

Product Name	Description	LPCB Ref. No.
306700001	25mm discharge hose	587a/47
306700002	50mm discharge hose	

Certificate No: 587a

**CHECK VALVES & ADJUSTABLE HEIGHT ADAPTORS**

Product Name	Description	LPCB Ref. No.
302.209.004	25mm manifold check valve	587a/48
302.209.005	50mm manifold check valve	
306700003	25mm Adjustable height adaptor	587a/49
306700004	50mm Adjustable height adaptor	

# PART 4: SECTION 2.1

## GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

### MANIFOLDS

Product Name	Description	LPCB Ref. No.
307.209.001-003	65 mm manifold NPT - 2 to 4 Port 4.5-45L	587a/50
307700004-008	80 mm manifold NPT - 2 to 6 Port 500mm centres 52-180L	587a/51
307700009-013	100 mm manifold NPT - 2 to 6 Port 500mm centres 52-180L	
307209050 - 057	150 mm manifold Flanged - 3 to 10 Port 500mm centres 52-180L (25 to 42bar)	
307700014-021	150 mm manifold Flanged - 3 to 10 Port 500mm centres 60-180L (70bar)	

Certificate No: 587a

### MANIFOLD UNIONS

Product Name	Description	LPCB Ref. No.
30888001	Manifold union 3/4 NPT x NPT, 140bar WP (with no drilled plate)	587a/52
30888002	Manifold union 1 NPT x NPT, 140bar WP (with no drilled plate)	
30888003	Manifold union 1 1/4 NPT x NPT, 140bar WP (with no drilled plate)	
30888004	Manifold union 1 1/2 NPT x NPT, 140bar WP (with no drilled plate)	
30888005	Manifold union 2 NPT x NPT, 140bar WP (with no drilled plate)	
30888006	Manifold union 2 1/2 NPT x NPT, 140bar WP (with no drilled plate)	
30888007	Manifold union 3 NPT x NPT, 140bar WP (with no drilled plate)	
30888008	Manifold union 4 NPT x NPT, 140bar WP (with no drilled plate)	
30888027	Manifold union 3/4 NPT x BSPT, 140bar WP (with no drilled plate)	
30888028	Manifold union 1 NPT x BSPT, 140bar WP (with no drilled plate)	
30888029	Manifold union 1 1/4 NPT x BSPT, 140bar WP (with no drilled plate)	
30888030	Manifold union 1 1/2 NPT x BSPT, 140bar WP (with no drilled plate)	
30888031	Manifold union 2 NPT x BSPT, 140bar WP (with no drilled plate)	
30888032	Manifold union 2 1/2 NPT x BSPT, 140bar WP (with no drilled plate)	
30888033	Manifold union 3 NPT x BSPT, 140bar WP (with no drilled plate)	
30888034	Manifold union 4 NPT x BSPT, 140bar WP (with no drilled plate)	

Certificate No: 587a

### SELECTOR VALVE MANIFOLDS

Product Name	Description	LPCB Ref. No.
36266000	65mm selector valve manifold bracket NPT 2 Port	587a/53
36366600	65mm selector valve manifold bracket NPT 3 Port	
36466600	65mm selector valve manifold bracket NPT 4 Port	
36566600	65mm selector valve manifold bracket NPT 5 Port	
36666600	65mm selector valve manifold bracket NPT 6 Port	
36277000	80mm selector valve manifold bracket NPT 2 Port	
36377700	80mm selector valve manifold bracket NPT 3 Port	
36477000	80mm selector valve manifold bracket NPT 4 Port	
36577000	80mm selector valve manifold bracket NPT 5 Port	
36677000	80mm selector valve manifold bracket NPT 6 Port	
36288000	100mm selector valve manifold bracket NPT 2 Port	
36388800	100mm selector valve manifold bracket NPT 3 Port	
36488000	100mm selector valve manifold bracket NPT 4 Port	
36588000	100mm selector valve manifold bracket NPT 5 Port	
36688000	100mm selector valve manifold bracket NPT 6 Port	

Certificate No: 587a

### MANIFOLD DROP SECTIONS

Product Name	Description	LPCB Ref. No.
19263006	65mm manifold drop section 900 mm centres	587a/54
19263014	65mm manifold drop section 1500 mm centres	
19263007	80mm manifold drop section 900 mm centres	
19263015	80mm manifold drop section 1500 mm centres	
19263008	100mm manifold drop section 900 mm centres	
19263016	100mm manifold drop section 1500 mm centres	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**VENT VALVE**

Product Name	Description	LPCB Ref. No.
302700014	20mm Vent valve NPT threaded	587a/55

Certificate No: 587a

**MANIFOLD BRACKET ASSEMBLIES**

Product Name	Description	LPCB Ref. No.
311.205.015	65mm manifold bracket assembly	587a/56
311.205.010	80mm manifold bracket assembly	
311.205.011	100mm manifold bracket assembly	
311700001	150mm manifold bracket assembly 500mm centres	587a/57

Certificate No: 587a

**SELECTOR VALVES 25/41 bar**

Product Name	Description	Connection	LPCB Ref. No.
308.209.001	40mm Selector valve	NPT Threaded	587a/19
308.209.002	50mm Selector valve	NPT Threaded	
308.209.003	65mm Selector valve	NPT Threaded	
308.209.004	80mm Selector valve	NPT Threaded	
308.209.005	100mm Selector valve	NPT Threaded	
308.209.007	40mm Selector valve	BSPT Threaded	
308.209.008	50mm Selector valve	BSPT Threaded	
308.209.009	65mm Selector valve	BSPT Threaded	
308.209.010	80mm Selector valve	BSPT Threaded	
308.209.011	100mm Selector valve	BSPT Threaded	

Certificate No: 587a

**FM-200® DISCHARGE NOZZLES (Aluminium & Brass)**

Product Name	Description	LPCB Ref. No.
310.205.101/102	Aluminium nozzle - 10mm 180°/360° (BSP)	587a/58
310.205.103/104	Aluminium nozzle - 15 mm 180°/360° (BSP)	
310.205.105/106	Aluminium nozzle - 20mm 180°/360° (BSP)	
310.205.107/108	Aluminium nozzle - 25mm 180°/360° (BSP)	
310.205.109/110	Aluminium nozzle - 32mm 180°/360° (BSP)	
310.205.111/112	Aluminium nozzle - 40mm 180°/360° (BSP)	
310.205.113/114	Aluminium nozzle - 50mm 180°/360° (BSP)	
310.205.115/116	Aluminium nozzle - 10mm 180°/360° (NPT)	
310.205.117/118	Aluminium nozzle - 15mm 180°/360° (NPT)	
310.205.119/120	Aluminium nozzle - 20mm 180°/360° (NPT)	
310.205.121/122	Aluminium nozzle - 25mm 180°/360° (NPT)	
310.205.123/124	Aluminium nozzle - 32mm 180°/360° (NPT)	
310.205.125/126	Aluminium nozzle - 40mm 180°/360° (NPT)	
310.205.127/128	Aluminium nozzle - 50mm 180°/360° (NPT)	
310.205.201/202	Brass nozzle - 10mm 180°/360° (BSP)	587a/59
310.205.203/204	Brass nozzle - 15 mm 180°/360° (BSP)	
310.205.205/206	Brass nozzle - 20mm 180°/360° (BSP)	
310.205.207/208	Brass nozzle - 25mm 180°/360° (BSP)	
310.205.209/210	Brass nozzle - 32mm 180°/360° (BSP)	
301.205.211/212	Brass nozzle - 40mm 180°/360° (BSP)	
310.205.213/214	Brass nozzle - 50mm 180°/360° (BSP)	
310.205.215/216	Brass nozzle - 10mm 180°/360° (NPT)	
310.205.217/218	Brass nozzle - 15mm 180°/360° (NPT)	
310.205.219/220	Brass nozzle - 20mm 180°/360° (NPT)	
310.205.221/222	Brass nozzle - 25mm 180°/360° (NPT)	
310.205.223/224	Brass nozzle - 32mm 180°/360° (NPT)	

## PART 4: SECTION 2.1

### GASEOUS SYSTEM COMPONENTS

Product Name	Description	LPCB Ref. No.
301.205.225/226	Brass nozzle - 40mm 180°/360° (NPT)	
310.205.227/228	Brass nozzle - 50mm 180°/360° (NPT)	

Certificate No: 587a

#### **SELECTOR VALVES 70 bar**

Product Name	Description, Connection, Working Pressure (bar)	LPCB Ref. No.
445043	SV shipping assy ¾" metric, 140bar, manual release	587a/64
445044	SV shipping assy 1 metric, 140bar, manual release	
445045	SV shipping assy 1¼ metric, 140bar, manual release	
445046	SV shipping assy 1½ metric, 140bar, manual release	
445047	SV shipping assy 2 metric, 140bar, manual release	
445048	SV shipping assy 2½ metric, 140bar, manual release	
445049	SV shipping assy 3 metric, 140bar, manual release	
445050	SV shipping assy 4 metric, 140bar, manual release	

Certificate No: 587a

#### **FM-200® DISCHARGE NOZZLES (Stainless Steel)**

Product Name	Description	LPCB Ref. No.
310.205.301/302	Stainless steel nozzle – 10mm 180°/360° (BSP)	587a/60
310.205.303/304	Stainless steel nozzle – 15mm 180°/360° (BSP)	
310.205.305/306	Stainless steel nozzle – 20mm 180°/360° (BSP)	
310.205.307/308	Stainless steel nozzle – 25mm 180°/360° (BSP)	
310.205.309/310	Stainless steel nozzle – 32mm 180°/360° (BSP)	
310.205.311/312	Stainless steel nozzle – 40mm 180°/360° (BSP)	
310.205.313/314	Stainless steel nozzle – 50mm 180°/360° (BSP)	
310.205.315/316	Stainless steel nozzle – 10mm 180°/360° (NPT)	
310.205.317/318	Stainless steel nozzle – 15mm 180°/360° (NPT)	
310.205.319/320	Stainless steel nozzle – 20mm 180°/360° (NPT)	
310.205.321/322	Stainless steel nozzle – 25mm 180°/360° (NPT)	
310.205.323/324	Stainless steel nozzle – 32mm 180°/360° (NPT)	
310.205.325/326	Stainless steel nozzle – 40mm 180°/360° (NPT)	
310.205.327/328	Stainless steel nozzle – 50mm 180°/360° (NPT)	

Certificate No: 587a

#### **SAPPHIRE™ (NOVEC 1230) DISCHARGE NOZZLES (Aluminium & Brass)**

Product Name	Description	LPCB Ref. No.
310.207.101/102	Aluminium nozzle - 15 mm 180°/360° (BSP)	587a/61
310.207.103/104	Aluminium nozzle - 20mm 180°/360° (BSP)	
310.207.105/106	Aluminium nozzle - 25mm 180°/360° (BSP)	
310.207.107/108	Aluminium nozzle - 32mm 180°/360° (BSP)	
310.207.109/110	Aluminium nozzle - 40mm 180°/360° (BSP)	
310.207.111/112	Aluminium nozzle - 50mm 180°/360° (BSP)	
310.207.113/114	Aluminium nozzle - 15mm 180°/360° (NPT)	
310.207.115/116	Aluminium nozzle - 20mm 180°/360° (NPT)	
310.207.117/118	Aluminium nozzle - 25mm 180°/360° (NPT)	
310.207.119/120	Aluminium nozzle - 32mm 180°/360° (NPT)	
310.207.121/122	Aluminium nozzle - 40mm 180°/360° (NPT)	
310.207.123/124	Aluminium nozzle - 50mm 180°/360° (NPT)	
310.207.201/202	Brass nozzle - 15 mm 180°/360° (BSP)	587a/62
310.207.203/204	Brass nozzle - 20mm 180°/360° (BSP)	
310.207.205/206	Brass nozzle - 25mm 180°/360° (BSP)	
310.207.207/208	Brass nozzle - 32mm 180°/360° (BSP)	
310.207.209/210	Brass nozzle - 40mm 180°/360° (BSP)	
310.207.211/212	Brass nozzle - 50mm 180°/360° (BSP)	
310.207.213/214	Brass nozzle - 15 mm 180°/360° (NPT)	
310.207.215/216	Brass nozzle - 20mm 180°/360° (NPT)	
310.207.217/218	Brass nozzle - 25mm 180°/360° (NPT)	
310.207.219/220	Brass nozzle - 32mm 180°/360° (NPT)	
301.207.221/222	Brass nozzle - 40mm 180°/360° (NPT)	
310.207.223/224	Brass nozzle - 50mm 180°/360° (NPT)	



Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) DISCHARGE NOZZLES (Stainless Steel)**

Product Name	Description	LPCB Ref. No.
310.207.301/302	Stainless steel nozzle – 15mm 180°/360° (BSP)	587a/63
310.207.303/304	Stainless steel nozzle – 20mm 180°/360° (BSP)	
310.207.305/306	Stainless steel nozzle – 25mm 180°/360° (BSP)	
310.207.307/308	Stainless steel nozzle – 32mm 180°/360° (BSP)	
310.207.309/310	Stainless steel nozzle – 40mm 180°/360° (BSP)	
310.207.311/312	Stainless steel nozzle – 50mm 180°/360° (BSP)	
310.207.313/314	Stainless steel nozzle – 15mm 180°/360° (NPT)	
310.207.315/316	Stainless steel nozzle – 20mm 180°/360° (NPT)	
310.207.317/318	Stainless steel nozzle – 25mm 180°/360° (NPT)	
310.207.319/320	Stainless steel nozzle – 32mm 180°/360° (NPT)	
310.207.321/322	Stainless steel nozzle – 40mm 180°/360° (NPT)	
310.207.323/324	Stainless steel nozzle – 50mm 180°/360° (NPT)	

Certificate No: 587a

**PILOT CONTAINER AND ACCESSORIES 25 to 70bar**

Product Name	Description	LPCB Ref. No.
20006025	Non return valve 1/4" BSPP	587a/64
302700015	Non return valve 1/2" BSPP (70bar)	587a/65
302700014	Vent valve assembly 1/2" NPT (70bar)	587a/66
13281	Manifold burst disc assembly (25bar)	587a/67
302.200.070	Manifold burst disc assembly (65.5 bar) (41bar)	
302700007	Manifold burst disc assembly (108 bar) (70bar)	587a/68
302.200.076	1/4" NPT female bleed valve (25/41/71bar)	587a/69
302.200.075	1/4" BSPP male bleed valve (70bar)	
30027301	Decompression Screw 1/4" BSPP (70bar)	587a/70
304700008	3L Pilot Container assembly	587a/71
304700016	13L Pilot Container assembly	
304700021	50L Pilot Container assembly	

Certificate No: 587a

**FM-200® CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314205302	GEM Container Label 15, 30, 32, 45, 60, 106, 120, 147 & 180 litre (portrait)	587a/72
314205308	HYGOOD Container Label 15, 30, 32, 45, 60, 106, 120, 147 & 180 litre (portrait)	
314205311	LPG Container Label 15, 30, 32, 45, 60, 106, & 180 litre (portrait)	
314205317	GEM Container Label 4.5, 8, 16 & 52 litre (landscape)	
314205324	HYGOOD Container Label 4.5, 8, 16 & 52 litre (landscape)	
314205327	LPG Container Label 4.5, 8, 16 & 52 litre (landscape)	

Certificate No: 587a

**FM-200® CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314.205.025	HYGOOD Container Label - 32, 106, 147, 180 & 343 litre	587a/73
314.205.026	HYGOOD Container Label - 4.5, 8, 16 & 52 litre	
314.205.029	TSP Container Label - 32, 106, 147, 180 & 343 litre	
314.205.030	TSP Container Label - 4.5, 8, 16 & 52 litre	
304.204.104	LPG Container Label 32, 106, 147, 180 & 343 litre	587a/74
304.204.105	LPG Container Label 4.5, 8, 16 & 52 litre	
304.204.114	LPG Container Label 32, 106, 147, 180 & 343 litre (ESP)	
304.204.115	LPG Container Label 4.5, 8, 16 & 52 litre (ESP)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25/41/42bar CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314207302	GEM Container Label 15, 30, 32, 45, 60, 106, 120, 147 & 180 litre (portrait)	587a/75
314207308	HYGOOD Container Label 15, 30, 32, 45, 60, 106, 120, 147 & 180 litre (portrait)	
314207311	LPG Container Label 15, 30, 32, 45, 60, 106, & 180 litre (portrait)	
314207332	GEM Container Label 4.5, 8, 16 & 52 litre (landscape)	
314207339	HYGOOD Container Label 4.5, 8, 16 & 52 litre (landscape)	
314207342	LPG Container Label 4.5, 8, 16 & 52 litre (landscape)	

Certificate No: 587a

**SAPPHIRE PLUS (NOVEC 1230) 70 bar CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314700003	Cont. label GEM (European)	587a/77
314700009	Cont. label HYGOOD (European)	
314700012	Cont. label LPG (European)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 25 bar CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314.207.017	HYGOOD Container Label - 32, 106, 147, 180 & 343 litre	587a/78
314.207.018	HYGOOD Container Label - 4.5, 8, 16 & 52 litre	
314.207.023	TSP Container Label - 32, 106, 147, 180 & 343 litre	
314.207.024	TSP Container Label - 4.5, 8, 16, 52 litre	
314.207.073	LPG Container Label - 32, 106, 147, 180 & 343 litre	
314.207.074	LPG Container Label - 4.5, 8, 16, 52 litre	
314.207.064	LPG Container Label - 32, 106, 147, 180 litre (ESP)	
314.207.065	LPG Container Label - 4.5, 8, 16, 52 litre (ESP)	

Certificate No: 587a

**SAPPHIRE™ (NOVEC 1230) 41 bar CONTAINER LABELS**

Product Name	Description	LPCB Ref. No.
314.207.058	HYGOOD Container Label - 32, 106, 147 & 180 litre	587a/79
314.207.059	HYGOOD Container Label - 8, 16 & 52 litre	
314.207.099	HYGOOD (India) Container Label - 80 & 120 litre	
314.207.056	TSP Container Label - 32, 106, 147 & 180 litre	
314.207.057	TSP Container Label - 8, 16, 52 litre	
314.207.087	LPG Container Label - 32, 106, 147 & 180 litre	
314.207.088	LPG Container Label - 8, 16, 52 litre	
314.207.091	LPG Container Label - 32, 106, 147, 180 litre (ESP)	
314.207.092	LPG Container Label - 8, 16, 52 litre (ESP)	

Certificate No: 587a

**SELECTOR VALVES**

Product Name	Description	LPCB Ref. No.
21100050V	3/4", Selector Valve (Shipping Assembly 445043)	587a/80
21100060V	1", Selector Valve (Shipping Assembly 445044)	
21100070V	1 1/4", Selector Valve (Shipping Assembly 445045)	
21100080V	1 1/2", Selector Valve (Shipping Assembly 445046)	
21100090V	2", Selector Valve (Shipping Assembly 445047)	
62116006V	2 1/2", Selector Valve (Shipping Assembly 445048)	
62116004V	3", Selector Valve (Shipping Assembly 445049)	
62116005V	4", Selector Valve (Shipping Assembly 445050)	
30130250V	Selector Valve Actuator (Manual/Solenoid) (Shipping Assembly 452461)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**SELECTOR VALVE ACCESSORIES**

Product Name	Description	LPCB Ref. No.
30650022	Bracket for 2x actuator for selector valves	587a/81
30650013	Bracket for 3x actuator for selector valves	
30650014	Bracket for 4x actuator for selector valves	
30116011	Selector Valve Microswitch	

Certificate No: 587a

**LPG Discharge Valves for Inert (200 bar) and Inert (300 bar)**

Product Name	Description	LPCB Ref. No.
2000306V	128-60 container valve (200 bar)	587a/82
26512800	128-65 container valve (300 bar)	

Certificate No: 587a

**LPG Container Valve Assemblies for Inert (200 bar)**

Product Name	Description	LPCB Ref. No.
73131018	80L Container Valve Assembly, LPG128-60 IG541 (1)	587a/83
73131018H	80L Container Valve Assembly, LPG128-60 IG541 (1)	
73131018T	80L Container Valve Assembly, LPG128-60 IG541 (1)	
73119039	80L Container Valve Assembly, LPG128-60 IG55 (1)	
73119039H	80L Container Valve Assembly, LPG128-60 IG55 (1)	
73119039T	80L Container Valve Assembly, LPG128-60 IG55 (1)	
73119039F	80L Container Valve Assembly, LPG128-60 IG55 (1)	
73106035	80L Container Valve Assembly, LPG128-60 IG01 (1)	
73106035T	80L Container Valve Assembly, LPG128-60 IG01 (1)	
73121036	80L Container Valve Assembly, LPG128-60 IG100 (1)	
76131009	140L Container Valve Assembly, LPG128-60 IG541 (1)	
76131009H	140L Container Valve assembly, LPG128-60 IG541 (1)	
76131009T	140L Container Valve assembly, LPG128-60 IG541 (1)	
76119012	140L Container Valve Assembly, LPG128-60 IG55 (1)	
76119012H	140L Container Valve Assembly, LPG128-60 IG55 (1)	
76119012T	140L Container Valve Assembly, LPG128-60 IG55 (1)	
76119012F	140L Container Valve Assembly, LPG128-60 IG55 (1)	
76106008	140L Container Valve Assembly, LPG128-60 IG01 (1)	
76106008T	140L Container Valve Assembly, LPG128-60 IG01 (1)	
76121010	140L Container Valve assembly, LPG128-60 IG100 (1)	
73106034	80L Container Valve assembly, LPG128-60 IG01 (2)	
73106034T	80L Container Valve assembly, LPG128-60 IG01 (2)	
73121035	80L Container Valve assembly, LPG128-60 IG100 (2)	
76131015	140L Container Valve assembly, LPG128-60 IG100 (2)	

Certificate No: 587a

**LPG Container Valve Assemblies for Inert (300 bar)**

Product Name	Description	LPCB Ref. No.
73130002	80L Container Valve Assembly, LPG128-65 IG541 (1)	587a/84
73130002H	80L Container Valve Assembly, LPG128-65 IG541 (1)	
73130002T	80L Container Valve Assembly, LPG128-65 IG541 (1)	
73120025	80L Container Valve Assembly, LPG128-65 IG55 (1)	
73120025H	80L Container Valve Assembly, LPG128-65 IG55 (1)	
73120025T	80L Container Valve Assembly, LPG128-65 IG55 (1)	
73120025F	80L Container Valve Assembly, LPG128-65 IG55 (1)	
73107018	80L Container Valve Assembly, LPG128-65 IG01 (1)	
73107018T	80L Container Valve Assembly, LPG128-65 IG01 (1)	
73122018	80L Container Valve Assembly, LPG128-65 IG100 (1)	
76130002	140L Container Valve Assembly, LPG128-65 IG541 (1)	

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
76130002H	140L Container Valve Assembly, LPG128-65 IG541 (1)	
76130002T	140L Container Valve Assembly, LPG128-65 IG541 (1)	
761200005	140L Container Valve Assembly, LPG128-65 IG55 (1)	
76120005H	140L Container Valve Assembly, LPG128-65 IG55 (1)	
76120005T	140L Container Valve Assembly, LPG128-65 IG55 (1)	
76120005F	140L Container Valve Assembly, LPG128-65 IG55 (1)	
76107001	140L Container Valve Assembly, LPG128-65 IG01 (1)	
76107001T	140L Container Valve Assembly, LPG128-65 IG01 (1)	
76122005	140L Container Valve assembly, LPG128-65 IG100 (1)	
73107017	80L Container Valve assembly, LPG128-65 IG01 (2)	
73107017T	80L Container Valve assembly, LPG128-65 IG01 (2)	
73122017	80L Container Valve assembly, LPG128-65 IG100 (2)	
76130004	140L Container Valve assembly, LPG128-65 IG541 (2)	
76130007	140L Container Valve assembly, LPG128-65 IG100 (2)	
73130030	80L PESO Container Valve Assembly, LPG128-65 IG541 (1)	
73130030H	80L PESO Container Valve assembly, LPG128-65 IG541 (1)	
73130030T	80L PESO Container Valve assembly, LPG128-65 IG541 (1)	
73120017	80L PESO Container Valve assembly, LPG128-65 IG55 (1)	

Certificate No: 587a

#### ***LPG Restrictors for Inert (200 bar) and Inert (300 bar)***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
61350005	¾" Restrictor NPT x NPT	587a/85
61350006	1 Restrictor NPT x NPT	
61350007	1 ¼" Restrictor NPT x NPT	
61350008	1 ½" Restrictor NPT x NPT	
61350009	2 Restrictor NPT x NPT	
61350012	2 ½" Restrictor NPT x NPT (1)	
61350013	3 Restrictor NPT x NPT (1)	
61350014	4 Restrictor NPT x NPT (1)	
61016121	¾" Restrictor NPT x BSPT	
61016122	1 Restrictor NPT x BSPT	
61016123	1 ¼" Restrictor NPT x BSPT	
61016124	1 ½" Restrictor NPT x BSPT	
61016125	2 Restrictor NPT x BSPT	
61016126	2 ½" Restrictor NPT x BSPT (1)	
61016127	3 Restrictor NPT x BSPT (1)	
61016128	4 Restrictor NPT x BSPT (1)	

Certificate No: 587a

#### ***LPG Discharge Hoses for Inert (200 bar) and Inert (300 bar)***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
30522010	¾" flexible hose	587a/86

Certificate No: 587a

#### ***LPG Discharge Containers for Inert (200 bar) and Inert (300 bar)***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
10800080	80 litre cylinder (200 bar)	587a/87
11400060	140 litre cylinder (200 bar)	
10800300	80 litre cylinder (300 bar)	
11400300	140 litre cylinder (300 bar)	

Certificate No: 587a

#### ***LPG Check Valves for Inert (200 bar) and Inert (300 bar)***

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
20006050	¾" check valve	587a/88

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

***LPG Inerts Pressure Gauges for Inert (200 bar) and Inert (300 bar)***

Product Name	Description	LPCB Ref. No.
30245003	0-400 gauge + switch set 270 bar	587a/89
30116035	0-315 gauge + switch set 180 bar	
30116043	0-450 bar pressure gauge	
3021316B	0-315 bar pressure gauge	

Certificate No: 587a

***LPG Nozzles for Inert (200 bar),(300 bar), HFC23, HFC125 and HFC227ea***

Product Name	Description	LPCB Ref. No.
30400000	3/8" 360° nozzle	587a/90
30400001	1/2" 360° nozzle	
30400002	3/4" 360° nozzle	
30400003	1" 360° nozzle	
30400004	1 1/4" 360° nozzle	
30400005	1 1/2" 360° nozzle	
30400006	2" 360° nozzle	
30400007	3/8" 180° nozzle	
30400008	1/2" 180° nozzle	
30400009	3/4" 180° nozzle	
30400010	1" 180° nozzle	
30400011	1 1/4" 180° nozzle	
30400012	1 1/2" 180° nozzle	
30400013	2" 180° nozzle	

Certificate No: 587a

***LPG HFCS Discharge Valves, including syphon tube for HFC23***

Product Name	Description	LPCB Ref. No.
2131910B	LPG190-13	587a/91
2131450B	LPG145-13	
2131280B	LPG128-13	

Certificate No: 587a

***LPG HFCS Discharge Valves, including syphon tube for HFC125 and HFC227ea***

Product Name	Description	LPCB Ref. No.
2001910B	LPG190-00	587a/92
2001450B	LPG145-00	
2001280B	LPG128-00	

Certificate No: 587a

***LPG HFCS Discharge Containers for HFC23, HFC125 and HFC227ea***

Product Name	Description	LPCB Ref. No.
10120100	120 l. container	587a/93
10950100	100 l. container	
10750100	75 l. container	
10670080	67 l. container	
10400080	40.2 l. container	
10260060	26.8 l. container	
10130060	13.4 l. container	
10050060	5.0 l. container	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**LPG HFC227ea Container Valve Assemblies**

Product Name	Description	LPCB Ref. No.
70102070	5L Container Valve Assembly, LPG128-00 (1)	587a/94
70102076	13.4L Container Valve Assembly, LPG128-00 (1)	
70102079	13.4L Container Valve Assembly, LPG128-00 (2)	
70102057	26.8L Container Valve Assembly, LPG128-00 (1)	
70102060	26.8L Container Valve Assembly, LPG128-00 (2)	
70102063	40.2L Container Valve Assembly, LPG145-00 (1)	
70102066	40.2L Container Valve Assembly, LPG145-00 (2)	
71102019	67L Container Valve Assembly, LPG145-00 (1)	
71102022	67L Container Valve Assembly, LPG145-0 (3)	
71102024	67L Container Valve Assembly, LPG145-00 (2)	
72102019	75L Container Valve Assembly, LPG190-00 (1)	
72102023	75L Container Valve Assembly, LPG190-00 (3)	
72102017	75L Container Valve Assembly, LPG190-00 (2)	
74102016	100L Container Valve Assembly, LPG190-00 (1)	
74102019	100L Container Valve Assembly, LPG190-00 (3)	
74102020	100L Container Valve Assembly, LPG190-00 (2)	
75102018	120L Container Valve Assembly, LPG190-00 (1)	
75102021	120L Container Valve Assembly, LPG190-00 (3)	
75102023	120L Container Valve Assembly, LPG190-00 (2)	

Certificate No: 587a

**LPG HFCS Discharge Hoses for HFC23, HFC125 and HFC227ea**

Product Name	Description	LPCB Ref. No.
30508HFC	Rigid telescopic hose 1.5" (1)	587a/95
30508080	Rigid hose 1½" HG/MF (1)	
30508000	Rigid hose 1½" HG/HG (1)	
30506HFC	Rigid hose 1" (1)	
30502140	R2F hose 400 G 1" HG/HF (1)	
30506000	R2F hose 320 G 1" HG/HG (1)	
30506070	R2F hose 400 G ¾" HG/HF (1)	

Certificate No: 587a

**LPG HFCS Manifolds for HFC23, HFC125 and HFC227ea**

Product Name	Description	LPCB Ref. No.
3811VCCD	Single Row manifold	587a/96

Certificate No: 587a

**LPG Discharge Pressure Switches for Inert 200 bar, Inert 300 bar, HFC23, HFC125 and HFC227ea**

Product Name	Description	LPCB Ref. No.
30330010	Discharge Pressure Switch	587a/97

Certificate No: 587a

**LPG HFCS Pressure Gauges for HFC23**

Product Name	Description	LPCB Ref. No.
30216010	0-160 pressure gauge short socket	587a/98
3021160B	0-160 pressure gauge, long socket	
30116052	0-160 pressure gauge + switch, short socket, set 90 bar	
30116053	0-160 pressure gauge + switch, long socket, set 90 bar	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

Certificate No: 587a

**LPG HFCS Pressure Gauges for HFC125 and HFC227ea**

Product Name	Description	LPCB Ref. No.
30210100	0-100 pressure gauge short socket	587a/99
3021100B	0-100 pressure gauge long socket	
30116040	0-100 pressure gauge + switch, short socket	
30116037	0-100 pressure gauge + switch, long socket	

Certificate No: 587a

**LPG Pressure Gauge for Inert (100 bar)**

Product Name	Description	LPCB Ref. No.
30116054	0-160 pressure gauge + switch	587a/100

Certificate No: 587a

**LPG Check Valves for HFC23, HFC125 & HFC227ea**

Product Name	Description	LPCB Ref. No.
20006060	Ball check valve 1.0" (brass) (1)	587a/101
20006067	Ball check valve 1" (steel) (1)	
20006HFC	Ball telescopic check valve 1.0" (brass) (1)	587a/101
20007HFC	Ball telescopic check valve 1" (steel) (1)	
20008000	Piston check valve 2"(1)	587a/101
20008HFC	Piston telescopic check valve 2" (1)	
21006302	Pistonvalve 2" (U. L. version) (1)	587a/101
21006303	Piston telescopic check valve 2" (U.L. version) (1)	

Certificate No: 587a

**LPG HFCS Brackets for HFC23, HFC125 and HFC227ea**

Product Name	Description	LPCB Ref. No.
30620310	Modular 3L	587a/102
30621310	Modular 5/7/13L	
30625010	Modular 26/40L	
30626711	Modular 67/75L	
30621010	Modular 100/120L	
306XX6SS(1)	Single row 67L	
306XX7SN(1)	Single row 75L	
306021002	Kit 2 bottles 100/120L single row	
306031002	Kit 3 bottles 100/120L single row	

Certificate No: 587a

**LPG Pneumatic Line Actuation for Inert 200 bar, Inert 300 bar, HFC23, HFC125 and HFC 227ea**

Product Name	Description	LPCB Ref. No.
3023024B	Solenoid actuator 13W/24V	587a/103
30130197	Solenoid actuator 1/8 output	
30180APB	Manual actuator	
3018NAPB	Dual manual actuator	

Certificate No: 587a

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

#### **LPG Pneumatic Line Actuation for Inert 200 bar, Inert 300 bar, HFC23, HFC125 and HFC 227ea**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
30027200	Pneumatic cone (used with HFCs)	587a/104
30027201	Pneumatic cone (used with Inerts)	
35116429	Tee for pneumatic cone (3 way + ¼" plug)	
302.200.075	¼" relief valve	
30027301	Decompression screw (short)	
30506014	PTFE hose ¼" x 580mm (1)	587a/105
30522001	PTFE hose ¼" x 700mm (1)	
29012804	128-90 pilot container valve with pressure gauge + switch	587a/106
29012804.SOL	128-90 pilot container valve with pressure gauge and std solenoid	
2901280B	128-90 pilot container valve with pressure gauge	
2901280B.SOL	128-90 pilot container valve with pressure gauge and std solenoid	
21114045	128-97 pilot container valve with pressure gauge + switch	
21114045.SOL	128-97 pilot container valve with pressure gauge + switch and std solenoid	
21114008	128-97 pilot container valve with pressure gauge	
21114008.SOL	128-97 pilot container valve with pressure gauge and std solenoid	

Certificate No: 587a

#### **LPG Pilot Valve Assemblies (100 bar Nitrogen)**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
70100075	3L Pilot Valve Assembly, LPG128-90, W28.8, DIN477	587a/107
70100082	13L Pilot Valve Assembly, LPG128-90, DIN 477	
70121011	50L Pilot Valve Assembly, LPG128-90, DIN 477	
70100083	13L PESO Pilot Valve Assembly, LPG128-90, DIN 477	
70121012	50L PESO Pilot Valve Assembly, LPG128-90, DIN 477	

## **RG Green Systems**

P.I.Villalonquejar, Calle Merindad De Montija No.6, Burgos 09001, Spain

Tel: +34.947.281.108 - 115 • Fax: +34.947.281.112

E-mail: jgonzalez@komtes.com

Certificate No: 1475a to EN 12094-4;2004

#### **Constant Flow Container Valves**

<b>Product Name</b>	<b>Description</b>	<b>Max. Working Pressure, bar</b>	<b>Max. Outlet Pressure, bar</b>	<b>LPCB Ref. No.</b>
RGS-MAM-RD9	max free cross sectional area 70.9mm <sup>2</sup>	360	60	1475a/01
RGS-MAM-RD11	max free cross sectional area 103.9mm <sup>2</sup>	360	60	1475a/02

#### **Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.

Container pressure is specified as 150, 200 or 300 bar at 15°C.

System pressure downstream of the container valves is specified as a maximum of 60bar.

Certificate No: 1475b to EN 12094-4;2004

#### **Container Valve Actuators**

<b>Product Name</b>	<b>Description</b>	<b>Max. Working Pressure, bar</b>	<b>LPCB Ref. No.</b>
RGS-MAM-03	Pilot cartridge valve adaptor	190	1475b/01
227 SOLR	Electrical (mounted on RGS-MAM-03)	65	1475b/02
227 SOLCR	Electrical (mounted on RGS-MAM-03)	200	1475b/03
227 DM	Manual (mounted on electrical actuator)	360	1475b/04
227 DMS	Manual (mounted on electrical actuator)	360	1475b/05



**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.  
Container pressure is specified as 150, 200 or 300 bar at 15°C.  
System pressure downstream of the container valves is specified as a maximum of 60bar.

**Certificate No: 1475c to EN 12094-4:2004**

**Pilot Cylinder Valves**

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
RGS-MAM-11-4	max free cross sectional area 113mm <sup>2</sup>	190	1475c/01
RGS-MAM-12-4*	max free cross sectional area 113mm <sup>2</sup>	190	1475c/02

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.  
Container pressure is specified as 150, 200 or 300 bar at 15°C.  
System pressure downstream of the container valves is specified as a maximum of 60bar.  
\*with additional pressure switch port and pilot port

**Certificate No: 1475d to EN 12094-4:2004**

**Pilot Cylinder Valve Actuators**

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
227 SOL	Electrical	65	1475d/01
227 SOLC	Electrical	200	1475d/02
227 CN	Pneumatic	360	1475d/03

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.  
Container pressure is specified as 150, 200 or 300 bar at 15°C.  
System pressure downstream of the container valves is specified as a maximum of 60bar.

**Certificate No: 1475e to EN 12094-10:2003**

**Pressure Gauges & Pressure Gauges + Switch**

Product Name	Description	Pressure ranges, bar	LPCB Ref. No.
PGS.11.040	Pressure gauge + switch 1/8 NPT	0-60, 0-100, 0-250, 0-315 and 0-400	1475e/01

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.  
Container pressure is specified as 150, 200 or 300 bar at 15°C.  
System pressure downstream of the container valves is specified as a maximum of 60bar.

**Certificate No: 1475g to EN 12094-8:2006**

**Connectors**

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
FH-15CO	Flexible discharge connector (type 1)	275	1475g/01
FH-20HC	Flexible discharge connector (type 1)	215	1475g/02
FH-20A	Flexible discharge connector (type 1)	360	1475g/03
FH-21A	Flexible discharge connector (type 1)	360	1475g/04
DH 21	Flexible discharge connector (type 1)	280	1475g/05

## PART 4: SECTION 2.1

### GASEOUS SYSTEM COMPONENTS

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
DH 211*	Flexible discharge connector (type 1)	280	1475g/06
FH-6PO	Flexible actuator hose (type 3)	224	1475g/07
FH-7PO	Flexible actuator hose (type 3)	360	1475g/08
DH 10	Flexible actuator hose (type 3)	280	1475g/09
DH 101*	Flexible actuator hose (type 3)	280	1475g/10
DH 11	Flexible actuator hose (type 3)	450	1475g/11
DH 111*	Flexible actuator hose (type 3)	450	1475g/12

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.

Container pressure is specified as 150, 200 or 300 bar at 15°C.

System pressure downstream of the container valves is specified as a maximum of 60bar.

\*connections made with AISI 306 stainless steel

Certificate No: 1475h to EN 12094-13:2001

#### Check Valves and Non-Return Valves

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
VALAN-15CO	Check valve ½"	240	1475h/01
VALAN-21A	Check valve ¾"	360	1475h/02
VALAN-22A	Check valve ¾"	360	1475h/03
VALAN-WFR8	Non-return valve ¼"	240	1475h/04
VALAN-WFR8-316	Non-return valve ¼"	240	1475h/05

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.

Container pressure is specified as 150, 200 or 300 bar at 15°C.

System pressure downstream of the container valves is specified as a maximum of 60bar.

Certificate No: 1475i to EN 12094-5:2006

#### Selector Valves for IG55 & IG541

Product Name	Description	Max. Working Pressure, bar	LPCB Ref. No.
SVD20	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/01
SVD25	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/02
SVD32	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/03
SVD40	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/04
SVD50	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/05
SVD65	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/11
SVD80	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/12
SVD100	Selector Valve, CO <sub>2</sub> , HFC-125, HFC-227ea, FK-5-1-12	140	1475i/13
SVDA25	Selector Valve, inert gas	360	1475i/06
SVDA32	Selector Valve, inert gas	360	1475i/07
SVDA40	Selector Valve, inert gas	360	1475i/08
SVDA50	Selector Valve, inert gas	360	1475i/09
SVDA65	Selector Valve, inert gas	360	1475i/10

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.

Container pressure is specified as 150, 200 or 300 bar at 15°C.

System pressure downstream of the container valves is specified as a maximum of 60bar.

Certificate No: 1475j & 1475k to prEN 12094-7:2006

**Nozzles**

Product Name	Description	Size	LPCB Ref. No.
FEDR10	360°nozzle	G 3/8	1475j/01
FEDR10A	360°nozzle	G 3/8	1475j/02
FEDR15	360°nozzle	G 1/2	1475j/03
FEDR15A	360°nozzle	G 3/4	1475j/04
FEDR20	360°nozzle	G 3/4	1475j/05
FEDR20A	360°nozzle	G 3/4	1475j/06
FEDR25	360°nozzle	G 1	1475j/07
FEDR25A	360°nozzle	G 1	1475j/08
FEDR32	360°nozzle	G 1 1/4	1475j/09
FEDR32A	360°nozzle	G 1 1/4	1475j/10
FEDR40	360°nozzle	G 1 1/2	1475j/11
FEDR40A	360°nozzle	G 1 1/2	1475j/12
FEDR50	360°nozzle	G 2	1475j/13
FEDR10180	180°nozzle	G 3/8	1475k/01
FEDR10180A	180°nozzle	G 3/8	1475k/02
FEDR15180	180°nozzle	G 1/2	1475k/03
FEDR15180A	180°nozzle	G 1/2	1475k/04
FEDR20180	180°nozzle	G 3/4	1475k/05
FEDR20180A	180°nozzle	G 3/4	1475k/06
FEDR25180	180°nozzle	G 1	1475k/07
FEDR25180A	180°nozzle	G 1	1475k/08
FEDR32180	180°nozzle	G 1 1/4	1475k/09
FEDR32180A	180°nozzle	G 1 1/4	1475k/10
FEDR40180	180°nozzle	G 1 1/2	1475k/11
FEDR40180A	180°nozzle	G 1 1/2	1475k/12
FEDR50180	180°nozzle	G 2	1475k/13

**Notes:**

The above components are suitable for use with IG55 and IG541 at service temperatures of -20°C to +50°C.  
 Container pressure is specified as 150, 200 or 300 bar at 15°C.  
 System pressure downstream of the container valves is specified as a maximum of 60bar.

**Safety Hi-Tech Srl**

Via Cavour, 96 - 67051 Avezzano (AQ), Italy  
 Tel: +39 0863 1940720 • Fax: +39 0863 1940724  
 E-mail: mail@safetyhitech.com • Website: www.safetyhitech.com

Certificate No: 969a

**NAF S 125 & NAF S 227 Container Valves**

Product Name	Description	Agent	LPCB Ref. No.
SH20025128	SHT V20	NAF S 125	969a/01
SH20025129	SHT V20	NAF S 227	
SH20025145	SHT V25	NAF S 125	
SH20025146	SHT V25	NAF S 227	
SH20025190	SHT V40	NAF S 125	
SH20025191	SHT V40	NAF S 227	
SH20012128	SHT V20-N2	Nitrogen	

- a. This range of equipment is suitable for storage from -20° to 50°C (HFC125) or 0° to 50°C (HFC227ea), (See Note 2).
- b. Nominal system pressure for HFC 227ea and HFC 125 components at 21°C is stated at 42 bar.

Certificate No: 969a

**NAF S 125 & NAF S 227 Container Valve Actuators**

Product Name	Description	LPCB Ref. No.
SH31009401	Manual actuator	969a/02
SH30027302	1 way high pressure cone	
SH30027303	2 way high pressure cone	
SH21006403	Solenoid actuator	

## **PART 4: SECTION 2.1**

### **GASEOUS SYSTEM COMPONENTS**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
SH21006404	Solenoid actuator 1/8" connection	
SH31009402	Manual / Pneumatic actuator	

- This range of equipment is suitable for storage from -20° to 50°C (HFC125) or 0° to 50°C (HFC227ea), (See Note 2).
- Nominal system pressure for HFC 227ea and HFC 125 components at 21°C is stated at 42 bar.

Certificate No: 969a

#### **NAF S 125 & NAF S 227 Discharge Connectors**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
SH30506000	1 x 320 mm flexible connector type 1 <sup>(1)</sup>	969a/03
SH30502140	1 x 400 mm flexible connector type 1 <sup>(2)</sup>	
SH30506070	¾" x 400 mm flexible connector type 1 <sup>(3)</sup>	
SH30503290	1/8 x 160 mm PTFE flexible connector type 3 <sup>(4)</sup>	
SH30506014	¼" x 580 mm PTFE flexible connector type 3 <sup>(4)</sup>	
SH30522001	¼" x 700 mm PTFE flexible connector type 3 <sup>(4)</sup>	
SH30508080	1 ½" rigid connector type 5 <sup>(4)</sup>	
SH30508000	1 ½" rigid connector type 5 <sup>(4)</sup>	

- Max Working Pressure 69 bar
- Max Working Pressure 185 bar
- Max Working Pressure 240 bar
- Max Working Pressure 132 bar

Certificate No: 969a

#### **NAF S 125 & NAF S 227 Check Valves**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
SH20006060	1 Check Valve	969a/04
SH21006302	2 Check Valve	

### **Siemens Switzerland Limited**

Dornierstrasse, 9423. Altenrhein, Switzerland  
 Tel: +41 71 858 23 23 • Fax: +41 71 858 23 20  
 Website: [www.sbt.siemens.com](http://www.sbt.siemens.com)

#### **Siemens Sinorix™ CO2 Fire Fighting Components**

- This range of equipment is suitable for storage temperatures from -20°C to +60°C and is approved for use with CO2
- This range of equipment is approved for use with Siemens Building Technologies data sheet 04-01-902 Revision: 0
- System pressure is specified as 60 bar at +20°C

Certificate No: 126z

#### **Siemens Sinorix™ CO2 Container valves**

<b>Product Name</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
CX505127	CO2 Container Valve	126z/10

#### **Siemens Sinorix™ Cerexen® Fire Fighting Components**

- This range of equipment is suitable for storage temperatures from -20°C to +60°C and is approved for use with 200 bar inert gas
- This range of equipment is approved for use with Siemens Building Technologies data sheet 04-02-901 Revision: 0
- System pressure is specified as 200 bar at +15°C

Certificate No: 126z

**Siemens Sinorix™ Cerexen® 200 bar Inert Container valves**

Product Name	Description	LPCB Ref. No.
CX505120	200 bar Inert Container Valve	126z/07

**Siemens Sinorix™ Cerexen® 300 bar Inert Container valves**

4. This range of equipment is suitable for storage temperatures from -20°C to +60°C and is approved for use with 300 bar inert gas
5. This range of equipment is approved for use with Siemens Building Technologies data sheet 04-02-902 Revision: 0
6. System pressure is specified as 300 bar at +15°C

Certificate No: 126z

**Siemens Sinorix™ Cerexen® 300 bar Inert Container valves**

Product Name	Description	LPCB Ref. No.
CX505135	300 bar Inert Container Valve	126z/08

Certificate No: 724a

**Siemens Sinorix Cerexen Inert Container Valves Discharge Regulator**

Product Name	Description	LPCB Ref. No.
S54476-B263-A1	Discharge Constant Pressure Regulator	724a/05

**Siemens Sinorix™ Cerexen® Actuators**

7. This range of equipment is suitable for storage temperatures from -20°C to +60°C and is approved for use with Siemens CX505127, CX505120 and CX505135 Container Valves.
8. This range of equipment is approved for use with Siemens Building Technologies data sheet 04-03-900 Revision: 0

Certificate No: 126z

**Siemens Sinorix™ Cerexen® Actuators**

Product Name	Description	LPCB Ref. No.
CX505131	Pneumatic Actuator	126z/09
CX505130	Pneumatic Actuator	
CX505132	Pneumatic/Manual Actuator	
CX505134	Electrical Actuator	

Certificate No: 126z

**Siemens Sinorix™ Cerexen® 200 bar and 300 bar Inert Container Valve Assemblies**

Product Name	Description	LPCB Ref. No.
S54476-C3-C2	10 litre Container Valve Assembly - (Nitrogen/200 bar)	126z/06
S54476-C1-C5	80 litre Container Valve Assembly - (Nitrogen/200 bar)	
S54476-C2-C1	140 litre Container Valve Assembly - (Nitrogen/200 bar)	
S54476-C1-C15	80 litre Container Valve Assembly - (Nitrogen/300 bar)	
S54476-C140-A1	140 litre Container Valve Assembly - (Nitrogen/300 bar)	
S54476-C8-C2	80 litre Container Valve Assembly - (Argon/200 bar)	
S54476-C9-C1	140 litre Container Valve Assembly - (Argon/200 bar)	
S54476-C8-C4	80 litre Container Valve Assembly - (Argon/300 bar)	
S54476-C140-A2	140 litre Container Valve Assembly - (Argon/300 bar)	
S54476-C9-A1	80 litre Container Valve Assembly - (IG541/300 bar)	
S54476-C140-A3	140 litre Container Valve Assembly - (IG541/300 bar)	

**PART 4: SECTION 2.1**  
GASEOUS SYSTEM COMPONENTS

**Siemens Sinorix™ Cerexen ® Nozzles**

9. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with Cerexen  
 10. This range of equipment is approved for us in conjunction with Siemens Design manual reference 000010\_a. - Revision: March 2005  
 11. Nominal system pressure at 15°C is stated at 200 bar.

Certificate No: 126z

**Siemens Sinorix™ Cerexen ® Nozzles**

Product Name	Description	LPCB Ref. No.
Cerexen Type Nozzle - 2 Hole	Nozzle	126z/02
	1/2" Nozzle	
	3/4" Nozzle	
	1 Nozzle	
	1 1/4" Nozzle	
	1 1/2" Nozzle	
Cerexen Type Nozzle - 4 Hole	2 Nozzle	126z/03
	Nozzle	
	1/2" Nozzle	
	3/4" Nozzle	
	1 Nozzle	
	1 1/4" Nozzle	
	1 1/2" Nozzle	
	2 Nozzle	

**Siemens Sinorix™ Cerexen ® Flexible Connectors**

9. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with Cerexen  
 10. This range of equipment is approved for us in conjunction with Siemens Design manual reference 000010\_a. - Revision: March 2005  
 11. Nominal system pressure at 15°C is stated at 200 bar.

Certificate No: 126z

**Siemens Sinorix™ Cerexen ® Flexible Connectors**

Product Name	Description	LPCB Ref. No.
MTD2040N-P 1006KP	Pilot line hose (Type 3)	126z/04
MTD2040N-P 1010KP	Pilot line hose (Type 3)	
MTKH60000-P 1112KZ2P	Manifold hose (Type 1)	

**Siemens Sinorix™ Cerexen ® Pressure Reduction Devices**

9. This range of equipment is suitable for storage temperatures of -20°C to 50°C and is approved for use with Cerexen  
 10. This range of equipment is approved for us in conjunction with Siemens Design manual reference 000010\_a. - Revision: March 2005  
 11. Nominal system pressure at 15°C is stated at 200 bar.

Certificate No: 126z

**Siemens Sinorix™ Cerexen ® Pressure Reduction Devices**

Product Name	Description	LPCB Ref. No.
Cerexen Blende Type 1 1/2"	1 1/2" Orifice Plate	126z/05
Cerexen Blende Type 2"	2 Orifice Plate	

**Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

Tyco Park, Grimshaw Lane, Newton Heath, Manchester M40 2WL, United Kingdom

Tel: +44 (0)161 205 2321 • Fax: +44 (0)161 455 4459

Website: [www.tycofis.com](http://www.tycofis.com)

***Inergen Fire Fighting Components***

- a. This range of equipment is suitable for storage temperatures of -20°C to +50°C and is approved for use with Inergen.
- b. This range of equipment is approved for use in conjunction with Tyco Fire and Integrated Solutions Design Manual Reference 'Inergen 300 bar Manual'.
- c. System pressure is specified as 300 bar at 15°C.
- d. A range of mounting brackets and retention assemblies for secure container are also available.

Certificate No: 014a

***INERGEN Container and Container Bracket Assemblies***

Product Name	Description	Capacity (ltr)	LPCB Ref. No.
SL93035	80 litre	80	014a/01
SL93036	67 litre	67	
SL93037	40 litre	40	
SL93038	27 litre	27	

Certificate No: 014a

***INERGEN Discharge Manifolds***

Product Name	Description	Nominal Bore (mm)	LPCB Ref. No.
SL94063	560-6 Manifold	50	014a/02
SL94064	840-9 Manifold	50	
SL94065	1120-12 Manifold	50	
SL94066	1400-15 Manifold	50	
SL94146	DOS Manifold 900-3	25	
SL94147	DOS Manifold 1200-4	25	
SL94148	DOS Manifold 1500-5	25	

Certificate No: 014a

***INERGEN Check Valves***

Product Name	Description	Nominal Bore (mm)	LPCB Ref. No.
SL94228	Check Valve	DN7	014a/03
SL93812	Pilot Cylinder Assembly	-	

Certificate No: 014a

***INERGEN Orifice Units***

Product Name	Description	Orifice Size	LPCB Ref. No.
SL94076	2" Orifice Unit	3mm - 30mm	014a/04
SL94092	3" Orifice Unit	20mm 56mm	
SL94143	DOS Orifice Unit	1mm 5mm	

Certificate No: 014a

## **PART 4: SECTION 2.1**

### GASEOUS SYSTEM COMPONENTS

#### **INERGEN Nozzles**

Product Name	Description	Orifice Size	LPCB Ref. No.
SL93943	½" 360° NPT	3mm - 10mm	014a/05
SL93938	1" 360° NPT	10mm - 20mm	
SL93773	1½" 360° NPT	8mm - 28mm	

Nozzles sized in accordance with system calculations.

Certificate No: 014a

#### **INERGEN Connectors**

Product Name	Description	Nominal Bore (mm)	LPCB Ref. No.
SL94061	Discharge Hose	DN10	014a/06
SL94049	Actuation Hose	DN8	
SL94050	Pilot hose	DN6	

Certificate No: 724Aa

#### **INERGEN Container Valves**

Product Name	Description	LPCB Ref. No.
BL0480 2007	300 bar Inert Container Valve	724Aa/03

Certificate No: 724Aa

#### **INERGEN Actuators**

Product Name	Description	LPCB Ref. No.
SL94045	Electric Actuator	724Aa/04
SL94046	Pneumatic Actuator	
SL94047	Pneumatic/Manual Actuator	
SL942124	Manual Actuator	014a/07

Certificate No: 014a

#### **INERGEN Pressure Gauge**

Product Name	Description	LPCB Ref. No.
SL94059	Cylinder 300 bar	014a/08

### **WIKA Alexander Wiegand SE & Co. KG**

Alexander Wiegand-Strasse 30, Klingenberg 63911, Germany

Tel: +49 9372 132-5367

E-mail: christian.luley@wika.com • Website: www.wika.de

Certificate No: 980a/01 to EN12094-10

#### **Wika Pressure gauges with switch**

Product Name	Description	LPCB Ref. No.
PGS 21.050	0-40 bar range 0-60 bar range 0-100 bar range 0-160 bar range 0-250 bar range 0-315 bar range 0-400 bar range	980a/01



Approved with cable connection; PG9 Cable gland; DIN Snap connector or M8 Plug and cable electrical connectors.

## **PART 4: SECTION 2.2**

### GASEOUS SYSTEMS

- LPCB approval of system components (Part 4: Section 2.1);
- Assessment to the relevant parts of ISO 14520 - *Gaseous fire-extinguishing systems* or EN 15004 - *Fixed Firefighting Systems - Gas Extinguishing Systems*;
- Testing to LPS 1230: *Requirements for Fire Testing of Fixed Gaseous Fire Extinguishing Systems*; and
- Review of the system design manual, software programme and installation & maintenance manual specified in the system approval Listing

#### Notes:

1. Gases used for extinguishing fires are generally hazardous to health. In selecting a system, specifiers are advised to carry out proper risk assessments based on the latest health and safety datasheets.
2. LPCB strongly recommends that the design and installation of these systems be carried out by a Certificated LPS 1204 company (see Part 4, Section 1).

### **Carrier Airconditioning & Refrigeration Ltd**

Narsinghpur, Kherki Daula Post, Gurgaon 122 004, Haryana, India

Tel: +91-124-4825500 • Fax: +91 124 2372230

E-mail: [customersupport.india@carrier.utc.com](mailto:customersupport.india@carrier.utc.com) • Website: [www.bis.utc.com](http://www.bis.utc.com)

Certificate No: 594Cb to LPS 1230

#### **ARGONITE 150, 200, 300 bar Fixed Gaseous Fire Extinguishing System**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
ARGONITE	Class A Standard (Solid fires e.g. Paper, wood, plastics)	40.1%	Design concentration includes 30% safety factor	594Cb/01
	Class A Cables (Solid fire risks including Cables)	47.6%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	47.1%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 206880.

Extinguishing concentrations are as tested in BRE Test Report Numbers 206879 and 216485 (ISO 14520-1 tests).

#### **This system uses:**

Design, Installation, Maintenance and User Manual:

General Manual - Argonite System, MA-01-9006-0100, Revision 10 dated February 2008

Software Programme: VdS-Version 7.2 (2007)

- a) This system is suitable for storage in environmental conditions from -20°C to +55°C
- b) System pressure is specified as 150 bar, 200 bar and 300 bar @ 15°C

### **Ceasefire Industries Pvt. Ltd**

Plot No. 4, Second Floor, Sector - 135, Noida, Uttar Pradesh 201301, India

Tel: +91 120 4255800 • Fax: +91 120 4255801

E-mail: [amit@ceasefire.in](mailto:amit@ceasefire.in) • Website: [www.ceasefire.in](http://www.ceasefire.in)

Certificate No: 1329e to LPS 1230

**Ceasefire HFC227ea 25 bar and 42 bar Fixed Gaseous Fire Extinguishing System**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Ceasefire HFC227ea 25 bar and 42 bar Fixed Gaseous Fire Extinguishing System	Class A Standard (Solid fires e.g. Paper, wood, plastics)	7.8 %	Design concentration includes 30% safety factor	1329e/01
	Class A Cables (Solid fire risks including Cables)	8.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	9.2 %	Design concentration includes 30% safety factor	

**Notes:**

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 300712.

Extinguishing concentrations are as verified in BRE Test Report Number 300712

This system is suitable for storage in environmental conditions from -20°C to +50°C

System pressure is specified as 25 bar or 42 bar @ 21°C

**This system uses:**

Components as listed in Part 4, Section 2.1 and described in Handbook of Design, Installation, Operation and System Maintenance of Ceasefire HFC227ea: - CF/HFC/MAN/001, dated 12.04.2017, Version 01, Revision 00 which utilises

Software Programme:

Hughes Associates Inc., S/N000001 CFG: 705161

For 25 bar system; AgentCalcs for HFC227ea-25 bar GEN 3.02; Copyright Hughes Associates, Inc.; S/N000001 -408AEC6C CFG: 705161400 Rev:3.0.261

For 42 bar system; AgentCalcs for HFC227ea-42 bar GEN 3.12 Copyright Hughes Associates, Inc.; S/N000001 -36E48F9A CFG: 705161400 Rev:3.0.263

**Eurotech Fire Protection Ltd, in collaboration with Firetec Systems Ltd**

Unit 6, The Business Centre, Molly Millars Lane, Wokingham, Berkshire RG41 2QZ, United Kingdom

Tel: +44 1252 860606 • Fax: +44 1252 860606

E-mail: keith.goodall@firetec-systems.com • Website: www.firetec-systems.com

Certificate No: 1222a to LPS 1230

**Eurotech227 & Eurosafe227 - 25 bar & 42 bar HFC 227ea Gaseous Fire Suppression Systems**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Eurotech227 & Eurosafe227	Class A Standard (Solid fires e.g. paper, wood, plastics)	7.8%	Design concentration includes 30% safety factor	1222a/01
	Class A Cables (Solid fires risks including cables)	8.2%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g.heptane)	9.2%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentrations are as tested to LPS 1230 In BRE Test Report Numbers 231870 (25 bar) & 254632 (42 bar) (Class A and B risks) and Test Letter 282069 (Class A Cables risks)

Extinguishing concentrations are as tested in BRE Test Report Number 231870 (ISO 14520-1 tests).

**This system uses:**

Design Manual: 'Eurotech Fire HFC227 Manual' - Issue 13-03

Software Programme : Vds Schadenverhutung calculation package version 7.3

This system is suitable for storage and environmental conditions from -20° to 50°C.

System pressure is specified as 25 bar and 42 bar at 20°.

Certificate No: 1222a to LPS 1230

## **PART 4: SECTION 2.2**

### **GASEOUS SYSTEMS**

#### ***Eurotech1230 & Eurosafe1230 - 25 bar & 42 bar FK 5-1-12 (Novec™ 1230) Gaseous Fire Suppression Systems***

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
Eurotech1230 & Eurosafe1230	Class A Standard (Solid fires e.g. paper, wood, plastics)	5.3%	Design concentration includes 30% safety factor	1222a/02
	Class A Cables (Solid fires risks including cables)	5.5%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g.heptane)	6.5%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Numbers 231870 (25 bar) & 254632 (42 bar) (Class A and B risks) and Test Letter 282069 (Class A Cables risks)  
Extinguishing concentrations are as tested in BRE Test Report Number 231870 (ISO 14520-1 tests).

This system uses:

Design Manual: 'Eurotech Fire Novec1230 Manual' - Issue 13-04  
Software Program: VdS Schadenverhütung calculation package version 7.2  
This system is suitable for storage and environmental conditions from -20° to 50°C.  
System pressure is specified as 25 bar and 42 bar at 20°C.

**Certificate No: 1222a to LPS 1230**

#### ***Inertech IG-01 200 bar & 300 bar Gaseous Fire Suppression Systems***

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
Inertech IG-01	Class A Standard (Solid fires e.g. paper, wood, plastics)	45.5%	Design concentration includes 30% safety factor	1222a/03
	Class A Cables (Solid fires risks including cables)	49.6%	Confirmation that 'minimum safety factor' is adequate	
	Class B (Liquid Fires e.g.heptane)	52.7%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Numbers 270432  
Extinguishing concentrations are as tested in BRE Test Report Number 270432 (EN 15004-1 tests).

This system uses:

Design Manual: 'Eurotech Inertech System Manual' Issue June 2013  
Software Program: VdS Flow Calc Version 2.2 .  
This system is suitable for storage and environmental conditions from -20° to 50°C.  
System pressure is specified as 200 bar and 300 bar at 15°C.

**Certificate No: 1222a to LPS 1230**

#### ***Inertech IG-55 200 bar & 300 bar Gaseous Fire Suppression Systems***

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
Inertech IG-55	Class A Standard (Solid fires e.g. paper, wood, plastics)	40.0%	Design concentration includes 30% safety factor	1222a/04
	Class A Cables (Solid fires risks including cables)	43.8%	Confirmation that 'minimum safety factor' is adequate	
	Class B (Liquid Fires e.g.heptane)	47.1%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Numbers 270432  
Extinguishing concentrations are as tested in BRE Test Report Number 270432 (EN 15004-1 tests).

This system uses:

Design Manual: 'Eurotech Inertech System Manual' Issue June 2013  
Software Program: VdS Flow Calc Version 2.2 .  
This system is suitable for storage and environmental conditions from -20° to 50°C.  
System pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1222a to LPS 1230

***Inertech IG-100 200 bar & 300 bar Gaseous Fire Suppression Systems***

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Inertech IG-100	Class A Standard (Solid fires e.g. paper, wood, plastics)	38.9%	Design concentration includes 30% safety factor	1222a/05
	Class A Cables (Solid fires risks including cables)	42.8%	Confirmation that 'minimum safety factor' is adequate	
	Class B (Liquid Fires e.g.heptane)	46.3%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Numbers 270432  
Extinguishing concentrations are as tested in BRE Test Report Number 270432 (EN 15004-1 tests).

This system uses:

Design Manual: 'Eurotech Inertech System Manual' Issue June 2013.  
Software Program: VdS Flow Calc Version 2.2 .  
This system is suitable for storage and environmental conditions from -20° to 50°C.  
System pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 1222a to LPS 1230

***Inertech IG-541 200 bar & 300 bar Gaseous Fire Suppression Systems***

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Inertech IG-541	Class A Standard (Solid fires e.g. paper, wood, plastics)	38.5%	Design concentration includes 30% safety factor	1222a/06
	Class A Cables (Solid fires risks including cables)	45.7%	Confirmation that 'minimum safety factor' is adequate	
	Class B (Liquid Fires e.g.heptane)	46.5%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 270432  
Extinguishing concentrations are as tested in BRE Test Report Number 270432 (EN 15004-1 tests).

This system uses:

Design Manual: 'Eurotech Inertech System Manual' Issue June 2013  
Software Program: VdS Flow Calc Version 2.2 .  
This system is suitable for storage and environmental conditions from -20° to 50°C.  
System pressure is specified as 200 bar and 300 bar at 15°C.

**Fike Safety Technology Ltd**

Unit 31, Springvale Industrial Estate, Cwmbran, Gwent NP44 5BD, United Kingdom  
Tel: +44 (0)1633 865558 • Fax: +44 (0)1633 866656  
E-mail: [fstinfo@fike.com](mailto:fstinfo@fike.com) • Website: [www.fikesafetytechnology.co.uk](http://www.fikesafetytechnology.co.uk)

Certificate No: 331w to LPS 1230

***Fike ProInert Fixed Gaseous Fire Extinguishing System***

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Fike ProInert Fixed Gaseous Fire Extinguishing System	Class A Standard (Solid fires e.g. paper, wood, plastics)	39.7%	Design concentration includes 30% safety factor	331w/01
	Class A Cables (Solid fire risks including cables)	44.3%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	46.0%	Design concentration includes 30% safety factor	

## PART 4: SECTION 2.2

### GASEOUS SYSTEMS

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 214668.  
Extinguishing concentrations are as tested in BRE Test Report Number 214668 (ISO 14520-1 tests).

#### This system uses:

Design, Installation, Maintenance and User Manual: Fike manual, P/N 06-294, Issue August 2009.  
Software Programme: Fike ProInert flow calculation Software, Version 6.2

- This system is suitable for storage in environmental conditions from -20° to +50°.
- Container pressure is specified as 200 bar or 300 bar @ 15°C

### Fire Eater A/S

Vølundsvej 17, 3400 Hillerød, Denmark  
Tel: +45 7022 2769 • Fax: +45 7023 2769  
E-mail: go@fire-eater.dk • Website: www.fire-eater.com

Certificate No: 1287b to LPS 1230

#### Fire Eater IG541 200 bar & 300 bar

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Fire Eater Control Inert INERGEN	Class A Standard (Solid fires e.g. paper, wood, plastics)	37.2%	Design concentration includes 30% safety factor	1287b/01
	Class A Cables (Solid fires risks including cables)	42.6%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g.heptane)	43.7%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 291411 (200 bar and 300 bar)  
Extinguishing concentrations are as tested in BRE Test Report Number 291410 (EN 15004-1 tests).

#### This system uses:

Design Manual: 'Fire Eater Control Inert Extinguishing System - Design, Installation, Maintenance and User Manual' – Revision 2015-02-23  
Software Program: Fire Eater A/S Inergen Program, IMT version 2.2.x.  
This system is suitable for storage and environmental conditions from -20°C to +65°C.  
System pressure is specified as 200 bar and 300 bar at 15°C.

### Fireater

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom  
Tel: +44 (0)1493 417600 • Fax: +44 (0)1493 417700  
E-mail: macron-info@tycoint.com • Website: www.macron-safety-safety.com

Certificate No: 587Cb to LPS 1230

#### Sapphire™

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Fireater Sapphire™	Class A Standard (Solid fires e.g. paper, wood, plastics)	6.0%	Design concentration includes 30% safety factor	587Cb/01
	Class A Cables (Solid fire risks including cables)	6.1%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid fires e.g. heptane)	6.4%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
 Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
 Design concentrations are as tested to LPS 1230 in BRE Test Report Number 208832 v2.  
 Extinguishing concentrations are as tested in BRE Test Report Number 208831 (ISO 14520-1 tests)

**This system uses:**

Design, Installation, Maintenance and User Manual: Fireater Novtec™ 1230 Total Flooding Systems (Engineered & Pre-engineered) Design Manual Reference 14a-06F Issue 5  
 Software Programme: TSPNovtec 1230 FlowCalc Version FIRE3.60b

- a) This system is suitable for storage in environmental conditions from -20° to +50°.
- b) System pressure is specified as 25 bar @ 20°C

**Kidde Fire Protection**

1st Floor Stokenchurch House, Oxford Road, Stokenchurch, High Wycombe, Buckinghamshire HP14 3SX, United Kingdom

Tel: +44 (0)1494 480410

E-mail: [General.enquiries@kiddeuk.co.uk](mailto:General.enquiries@kiddeuk.co.uk) • Website: [www.kfp.co.uk](http://www.kfp.co.uk)

Certificate No: 594b to LPS 1230

**Argonite 150, 200, 300 bar Fixed Gaseous Fire Extinguishing System**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Argonite	Class A Standard (Solid fires e.g. paper, wood, plastics)	40.1%	Design concentration includes 30% safety factor	594b/01
	Class A Cables (Solid fire risks including cables)	47.6%	Confirmation that minimum safety factor is adequate.	
	Class B (Liquid Fires e.g. heptane)	47.1%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
 Design concentrations Class A Cables System test concentration - where this is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
 Design concentrations are as tested to LPS 1230 in BRE Test Report Number 206880.  
 Extinguishment concentrations are as tested in BRE Test Report Number 206879 & 216485 (ISO 14520-1 tests)

**This system uses:**

Design, Installation, Maintenance and User Manual:  
 General Manual - Argonite System, MA-01-9006-0100, Revision 11 dated January 2015.

Software Programme : VdS-Version 7.3 (2009)

- a) This system is suitable for storage in environmental conditions from -20° to +55°.
- b) System pressure is specified as 150 bar, 200 bar and 300 bar @ 15°C.

Certificate No: 594d to LPS 1230

**Argonite C Series 300 bar Fixed Gaseous Fire Extinguishing System**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Argonite C Series	Class A Standard (Solid fires e.g. paper, wood, plastics)	40.3%	Design concentration includes 30% safety factor	594d/01
	Class A Cables (Solid fire risks including cables)	44.0%	Confirmation that minimum safety factor is adequate.	
	Class B (Liquid Fires e.g. heptane)	47.5%	Design concentration includes 30% safety factor	

**Notes:**

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

## **PART 4: SECTION 2.2**

### **GASEOUS SYSTEMS**

Design concentrations Class A Cables System test concentration - where this is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 253355

Extinguishment concentrations are as tested in BRE Test Report Number 206879 & 216485 (ISO 14520-1 tests).

**This system uses:**

Design, Installation, Maintenance and User Manual: General Manual - Argonite C60 System, MA -01-9008-0100, Revision 1.0 dated November 2011.

Software Programme: Kidde Argonite Program, VdS-Version 1.7 (2009).

- a) This system is suitable for storage in environmental conditions from -20° to +50°.
- b) Container pressure is specified as 300 bar @ 15°C.

**Certificate No: 594e to LPS 1230**

#### ***Kidde Inert Gas System (400 Series) - IG01***

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
IG-01	Class A Standard (Solid fires e.g. Paper, wood, plastics)	42.4 %	Design concentration includes 30% safety factor	594e/01
	Class A Cables (Solid fire risks including Cables)	50.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	51.6 %	Design concentration includes 30% safety factor	

**Notes:**

This system is suitable for storage in environmental conditions from -20°C to +50°C  
Storage pressure is specified as 200 bar or 300 bar @ 15°C. System pressure is specified as 55 bar.

**This system uses:**

Components as listed in Part 4, Section 2.1 and as described in

Kidde Fire Protection Inert Gas System (400 Series) Design, Installation, Operation and Maintenance Manual: P/N 06-237518-001, dated July 2018, Revision AA which utilises the following software

Software Programme: Kidde Fire Protection - Flow Calculation v 4.00,  
Licensed to Kidde Fenwal  
Copyright: Jensen Hughes Inc

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number P102562-1002.  
Extinguishing concentrations are as verified in BRE Test Report Number P102562-1001

**Certificate No: 594e to LPS 1230**

#### ***Kidde Inert Gas System (400 Series) - IG55***

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
IG-55	Class A Standard (Solid fires e.g. Paper, wood, plastics)	38.9 %	Design concentration includes 30% safety factor	594e/02
	Class A Cables (Solid fire risks including Cables)	44.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	45.9 %	Design concentration includes 30% safety factor	

**Notes:**

This system is suitable for storage in environmental conditions from -20°C to +50°C  
Storage pressure is specified as 200 bar or 300 bar @ 15°C. System pressure is specified as 55 bar.

**This system uses:**



Components as listed in Part 4, Section 2.1 and as described in

Kidde Fire Protection Inert Gas System (400 Series) Design, Installation, Operation and Maintenance Manual:  
P/N 06-237518-001, dated July 2018, Revision AA which utilises the following software

Software Programme: Kidde Fire Protection - Flow Calculation v 4.00,  
Licensed to Kidde Fenwal  
Copyright: Jensen Hughes Inc

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number P102562-1002.  
Extinguishing concentrations are as verified in BRE Test Report Number P102562-1001

**Certificate No: 594e to LPS 1230**

***Kidde Inert Gas System (400 Series) - IG100***

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
IG-100	Class A Standard (Solid fires e.g. Paper, wood, plastics)	38.9 %	Design concentration includes 30% safety factor	594e/03
	Class A Cables (Solid fire risks including Cables)	43.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	46.0 %	Design concentration includes 30% safety factor	

**Notes:**

This system is suitable for storage in environmental conditions from -20°C to +50°C  
Storage pressure is specified as 200 bar or 300 bar @ 15°C. System pressure is specified as 55 bar.

**This system uses:**

Components as listed in Part 4, Section 2.1 and as described in

Kidde Fire Protection Inert Gas System (400 Series) Design, Installation, Operation and Maintenance Manual:  
P/N 06-237518-001, dated July 2018, Revision AA which utilises the following software

Software Programme: Kidde Fire Protection - Flow Calculation v 4.00,  
Licensed to Kidde Fenwal  
Copyright: Jensen Hughes Inc

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number P102562-1002.  
Extinguishing concentrations are as verified in BRE Test Report Number P102562-1001

**Certificate No: 594e to LPS 1230**

***Kidde Inert Gas System (400 Series) - IG541***

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
IG-541	Class A Standard (Solid fires e.g. Paper, wood, plastics)	39.1 %	Design concentration includes 30% safety factor	594e/04
	Class A Cables (Solid fire risks including Cables)	42.1 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	44.6 %	Design concentration includes 30% safety factor	

**Notes:**

This system is suitable for storage in environmental conditions from -20°C to +50°C

# **PART 4: SECTION 2.2**

## **GASEOUS SYSTEMS**

Storage pressure is specified as 200 bar or 300 bar @ 15°C. System pressure is specified as 55 bar.

**This system uses:**

Components as listed in Part 4, Section 2.1 and as described in

Kidde Fire Protection Inert Gas System (400 Series) Design, Installation, Operation and Maintenance Manual:  
P/N 06-237518-001, dated July 2018, Revision AA which utilises the following software

Software Programme: Kidde Fire Protection - Flow Calculation v 4.00,  
Licensed to Kidde Fenwal  
Copyright: Jensen Hughes Inc

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number P102562-1002.

Extinguishing concentrations are as verified in BRE Test Report Number P102562-1001

### **Kidde-Fenwal, Inc.**

400 Main Street, Ashland, Massachusetts 01721, USA

Tel: +1 508 881 2000 • Fax: +1 508 881 6729

Website: [www.kiddefiresystems.com](http://www.kiddefiresystems.com) and [www.fenwalfire.com](http://www.fenwalfire.com)

Certificate No: 594Be to LPS 1230: Issue 1.2

### **Kidde Fire Systems Natura™ Inert Gas System**

<b>Product Name</b>	<b>Risk</b>	<b>Design Concentration</b>	<b>Comments</b>	<b>LPCB Ref. No.</b>
IG-01	Class A Standard (Solid fires e.g. Paper, wood, plastics)	42.4 %	Design concentration includes 30% safety factor	594Be/01
	Class A Cables (Solid fire risks including Cables)	50.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	51.6 %	Design concentration includes 30% safety factor	
IG-55	Class A Standard (Solid fires e.g. Paper, wood, plastics)	38.9 %	Design concentration includes 30% safety factor	594Be/02
	Class A Cables (Solid fire risks including Cables)	44.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	45.9 %	Design concentration includes 30% safety factor	
IG-100	Class A Standard (Solid fires e.g. Paper, wood, plastics)	38.9 %	Design concentration includes 30% safety factor	594Be/03
	Class A Cables (Solid fire risks including Cables)	43.2 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	46.0 %	Design concentration includes 30% safety factor	
IG-541	Class A Standard (Solid fires e.g. Paper, wood, plastics)	39.1 %	Design concentration includes 30% safety factor	594Be/04
	Class A Cables (Solid fire risks including Cables)	42.1 %	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	44.6 %	Design concentration includes 30% safety factor	

**LPG Técnicas En Extinción De Incendios, S.L.**

Mestre Joan Corrales 107-109, 08950 Esplugues de Llobregat, Barcelona, Spain

Tel: +34 93 480 2925 • Fax: +34 93 473 7492

E-mail: [marketing@lpg.es](mailto:marketing@lpg.es) • Website: [www.lpg.es](http://www.lpg.es)

Certificate No: 446b to LPS 1230

**LPG FE-13 Fixed gaseous fire extinguishing system**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
LPG FE-13	Class A Standard (Solid Fires e.g. paper, wood, plastics)	15.9%	Design concentration includes 30% safety factor	446b/01
	Class A Cables (Solid fire risks including cables)	16.5%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	16.1%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 206580.

Extinguishment concentrations are as tested in BRE Test Report Number 206579 (ISO 14520-1 tests)

**This system uses:**

Design Manual: MD/FE/IN-01 Rev 5

Software Programme : Firenet version 2.5, LPC, Nov. 2001.

Installation, Maintenance and User Manual for FE-13 Fire Extinguishing Systems, MU/FE/IN\_02 Rev: 00

a) This system is suitable for storage in environmental conditions from -20° to 55°.

b) System pressure is specified as 41 bar @ 20°C and container maximum filling density is 0.85 kg/l.

c) Systems are not superpressurized.

Certificate No: 446b

**LPG 'Inert 55' 200 bar and 300 bar Inert Gaseous Fire Suppression System**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Inert 55	Class A Standard (Solid fires e.g. paper, wood, plastics)	41.0%	Design concentration includes 30% safety factor	446b/02
	Class A Cables (Solid fires risks including cables)	45.6%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g.heptane)	45.2%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 213932

Extinguishing concentrations are as tested in BRE Test Report Number 216936 (ISO 14520-1 tests).

**This system uses:**

Design Manual: MD/55/01/IN

Software Program: VdS Schadenverhütung calculation package version 4.6a.

This system is suitable for storage and environmental conditions from -20° to 50°.

System pressure is specified as 200 bar and 300 bar at 15°C.

Certificate No: 446d to LPS 1230

## PART 4: SECTION 2.2

### GASEOUS SYSTEMS

#### LPG Sapphire

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
LPG Sapphire	Class A Standard (Solid fires e.g. paper, wood, plastics)	6.0%	Design concentration includes 30% safety factor	446d/01
	Class A Cables (Solid fire risks including cables)	6.1%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	6.4%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 208832 v2.

Extinguishing concentrations are as tested in BRE Test Report Number 208831 (ISO 14520-1 tests)

#### This system uses:

Design, Installation, Maintenance and User Manual: LPG Novec™ 1230 Total Flooding Systems (Engineered & Pre-engineered)  
Design Manual Reference 14a-06L Issue 5

Software Programme: TSPNovec 1230 FlowCalc Version TSP3.60b

- This system is suitable for storage in environmental conditions from -20° to +50°.
- System pressure is specified as 25 bar @ 20°C

#### Macron Safety Systems (UK) Ltd

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom

Tel: +44 (0)1493 417600 • Fax: +44 (0)1493 417700

E-mail: [info@tycoint.com](mailto:info@tycoint.com) • Website: [www.macron-safety.com](http://www.macron-safety.com)

Certificate No: 587Bb to LPS 1230

#### Hygood Sapphire™

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Hygood Sapphire™	Class A Standard (Solid fires, e.g. paper, wood, plastics)	6.0%	Design concentration includes 30% safety factor	587Bb/01
	Class A Cables (Solid fire risks including cables)	6.1%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid fires e.g. heptane)	6.4%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).

Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.

Design concentrations are as tested to LPS 1230 in BRE Test Report Number 208832 v2.

Extinguishing concentrations are as tested in BRE Test Report Number 208831 (ISO 14520-1 tests)

#### This system uses:

Design, Installation, Maintenance and User Manual: Hygood Novec™ 1230 Total Flooding Systems (Engineered & Pre-engineered)  
Design Manual Reference 14a-06H Issue 5

Software Programme: Novec 1230 FlowCalc Version HYG3.60b

- This system is suitable for storage in environmental conditions from -20° to +50°.
- System pressure is specified as 24.8 bar @ 20°C

**Thorn Security Limited**

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom

Tel: +44 (0)1493 417600 • Fax: +44 (0)1493 417700

E-mail: [macron-info@tycoint.com](mailto:macron-info@tycoint.com) • Website: [www.tycosafetyproducts-europe.com](http://www.tycosafetyproducts-europe.com)

Certificate No: 587Ab to LPS 1230

**Thorn Sapphire**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Thorn Sapphire™	Class A Standard (solid fires e.g. paper, wood, plastics)	6.0%	Design concentration includes 30% safety factor	587Ab/01
	Class A Cables (solid fire risks including cables)	6.1%	Confirmation that minimum safety factor is adequate	
	Class B (liquid fires e.g. heptane)	6.4%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 208832 v2.  
Extinguishing concentrations are as tested in BRE Test Report Number 208831 (ISO 14520-1 tests)

**This system uses:**

Design, Installation, Maintenance and User Manual: Thorn Novec™ 1230 Total Flooding Systems (Engineered & Pre-engineered) Design Manual Reference 14a-06 Issue 5

Software Programme: ThornNovec 1230 FlowCalc Version TSP3.60b

- a) This system is suitable for storage in environmental conditions from -20° to +50°.
- b) System pressure is specified as 25 bar @ 20°C

**Tyco Fire and Integrated Solutions (the trading company for Tyco Fire and Integrated Solutions (UK) Limited and Tyco Fire and Integrated Solutions (Ireland) Limited)**

Tyco Park, Grimshaw Lane, Newton Heath, Manchester M40 2WL, United Kingdom

Tel: +44 (0)161 205 2321 • Fax: +44 (0)161 455 4459

Website: [www.tycofis.com](http://www.tycofis.com)

Certificate No: 014b to LPS 1230

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Wormald Ansul INERGEN	Class A Standard) Solid fires e.g. paper, wood, plastics)	43%	Design concentration includes 30% safety factor	014b/01
	Class A Cables (Solid fire risks including cables)	47.8%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid fires e.g. heptane)	46.7%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 206885.  
Extinguishing concentrations are as tested in BRE Test Report Number 206884 (ISO 14520-1 tests)

**This system uses:**

Design, Installation, Maintenance and User Manual: INERGEN 300 bar manual, P/N 13646raw, Issue March 2011

## **PART 4: SECTION 2.2**

### GASEOUS SYSTEMS

Software Programme:

C.A.P Version 14.04

- a) This system is suitable for storage in environmental conditions from -20° to +50°C.
- b) System pressure is specified as 300 bar @ 15°C
- c) If this fixed gaseous fire extinguishing system is used with existing pipework (so called drop-in systems) it is the responsibility of the installing company to ensure that:
  - all pipework can withstand system pressures and will be safe during operation;
  - all pipework meets the requirements of the gas system manufacturers design manual; and
  - all applicable legislation is complied with.

### **Tyco Safety Products (Great Yarmouth)**

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom

Tel: +44 (0) 1493 417600 • Fax: +44(0) 1493 417700

E-mail: [macron-info@tycoint.com](mailto:macron-info@tycoint.com) • Website: [www.macron-safety.com](http://www.macron-safety.com)

Certificate No: 587b to LPS 1230

### **Tyco Safety Products Sapphire™**

Product Name	Risk	Design Concentration	Comments	LPCB Ref. No.
Tyco Safety Products Sapphire™	Class A Standard (Solid fires e.g. paper, wood, plastics)	6.0%	Design concentration includes 30% safety factor	587b/01
	Class A Cables (Solid fire risks including cables)	6.1%	Confirmation that minimum safety factor is adequate	
	Class B (Liquid Fires e.g. heptane)	6.4%	Design concentration includes 30% safety factor	

Design concentration Class A Standard and Class B = Extinguishing concentration x safety factor (minimum 1.3).  
Design concentration Class A Cables = System test concentration. Where this value is lower than the Class A Standard value, the Class A Standard value should be used for design purposes.  
Design concentrations are as tested to LPS 1230 in BRE Test Report Number 208832 v2.  
Extinguishing concentrations are as tested in BRE Test Report Number 208831 (ISO 14520-1 tests)

#### **This system uses:**

Design, Installation, Maintenance and User Manual:  
(engineered) Design Manual Reference 14a-06T Issue 5

TSP Novec™ 1230 Total Flooding Systems (Engineered & Pre-

Software Programme:

TSPNovec 1230 FlowCalc Version TSP3.60b

- a) This system is suitable for storage in environmental conditions from -20° to +50°.
- b) System pressure is specified as 25 bar @ 20°C

The LPCB Approval Scheme for fixed fire extinguishing systems for catering equipment has been developed to provide protection against the specific risks posed by oil fires in cooking appliances used in catering or food production establishments.

### **Product Testing**

The listed systems below have been assessed against LPS 1223 *Requirements and Testing Procedures for Approval of Fixed Fire Extinguishing Systems for Catering Equipment*. This standard not only addresses the fire extinguishing performance of the system but also includes the performance of the detection and associated control systems. The requirements of LPS 1223 include:

- Design manual assessment
- Component testing, including pressure testing
- System discharge tests
- System fire detection and extinguishment tests
- Long term ageing tests

Traditional extinguishing agents do not readily extinguish catering equipment oil fires because they do not provide a sufficient cooling effect to reduce the cooking oil to below its auto-ignition temperature. The fire extinguishing tests in LPS 1223 recognise this requirement together with the need to ensure that neither the composition of the agent nor the manner in which it is discharged onto the fire causes flaming oil to be ejected.

All listed systems are subject ongoing audit programmes.

### **Authorised installer requirement**

Such fixed extinguishing systems rely upon competent designers and installers and as such LPS 1223 contains requirements placed upon the listed manufacturers to ensure they maintain adequate control over their authorised installers.

### **Fish and chip ranges**

Fish and chip ranges are a specialised type of catering equipment that require special consideration with regards to protection, based on the position and orientation of the extract system.

Unless otherwise stated in the individual product entries, the listed systems are not approved for protection of fish and chip ranges.

**Note:** LPS 1263:Part 1 *Fire Performance Requirements for Kitchen Extract Systems*. has also been developed to provide additional protection against potential fire spread in the extract ductwork associated with grease filtration systems.

---

### **AIR Fire S.p.A.**

Via Tenuta della Mistica - 33/37, Rome 00155, Italy

Tel: +34 680395217

E-mail: [info@airfire.eu](mailto:info@airfire.eu) • Website: [www.airfire.eu](http://www.airfire.eu)

Certificate No: 1408a to LPS 1223: Issue 2.3

## **PART 4: SECTION 3**

### **FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT**

#### **ARMANfire Chef Fixed Fire Extinguishing System for Catering Equipment**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
ARMANfire Chef "Piccolo" Kitchen Suppression System	ARFCHEF06C	Manual and automatic operation, 11.8 litre cylinder (6 litres wet chemical agent), maximum of 3 discharge nozzles	1408a/01
	ARFCHEF08C	Manual and automatic operation, 11.8 litre cylinder (8 litres wet chemical agent), maximum of 4 discharge nozzles	1408a/02
ARMANfire Chef "Medio" Kitchen Suppression System	ARFCHEF10C	Manual and automatic operation, 15.9 litre cylinder (10 litres wet chemical agent), maximum of 5 discharge nozzles	1408a/03
	ARFCHEF12C	Manual and automatic operation, 15.9 litre cylinder (12 litres wet chemical agent), maximum of 6 discharge nozzles	1408a/04
	ARFCHEF14C	Manual and automatic operation, 25.3 litre cylinder (14 litres wet chemical agent), maximum of 7 discharge nozzles	1408a/05
ARMANfire Chef "Grande" Kitchen Suppression System	ARFCHEF16C	Manual and automatic operation, 25.3 litre cylinder (16 litres wet chemical agent), maximum of 8 discharge nozzles	1408a/06
	ARFCHEF18C	Manual and automatic operation, 25.3 litre cylinder (18 litres wet chemical agent), maximum of 9 discharge nozzles	1408a/07
	ARFCHEF20C	Manual and automatic operation, 25.3 litre cylinder (20 litres wet chemical agent), maximum of 10 discharge nozzles	1408a/08

**Note:**

AIR Fire S.p.A., ARMANfire Chef fixed fire extinguishing system for catering equipment, shall be installed, commissioned and maintained in accordance with the system manual 'ARMANfire Chef Kitchen Fire Suppression Installation and Maintenance User Manual', version 1.7 dated 11 Dec 2017.

#### **Amerex Corporation**

7595 Gadsden Highway, Trussville, Alabama 35173, USA

Tel: +1 205 655 3271 • Fax: +1 205 655 3279

E-mail: [sales@amerex-fire.com](mailto:sales@amerex-fire.com) • Website: [www.amerex-fire.com/fireinfo](http://www.amerex-fire.com/fireinfo)

Certificate No: 407a to LPS 1223

#### **Amerex KP and ZD Fire Suppression System for catering equipment**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
KP	275	Manual and automatic operation, 10.41 litres Amerex Kitchen Wet Chemical Agent	407a/01
	375	Manual and automatic operation, 14.2 litres Amerex Kitchen Wet Chemical Agent	
	475	Manual and automatic operation, 18.17 litres Amerex Kitchen Wet Chemical Agent	
	600	Manual and automatic operation, 23.23 litres Amerex Kitchen Wet Chemical Agent	
ZD	275	Manual and automatic operation, 10.41 litres Kitchen Wet Chemical Agent	407a/02
	375	Manual and automatic operation, 14.2 litres Amerex Kitchen Wet Chemical Agent	
	475	Manual and automatic operation, 18.17 litres Amerex Kitchen Wet Chemical Agent	

KP and ZD system shall be designed, installed and maintained in accordance with Amerex Design, Installation, Maintenance and Recharge Manual No 20150 Rev. MM#20150-12/2008 dated December 2008.

#### **Ansul Incorporated**

One Stanton Street, Marinette, Wisconsin 54143-2542, USA

Tel: +1 715 735 7411 • Fax: +1 715 732 3477

Website: [www.ansul.com](http://www.ansul.com)

Certificate No: 591a to LPS 1223

#### **Ansul R-102 Restaurant Fire Suppression System**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
R-102	Single Tank System (1.5 or 3 US gallon)	Manual and automatic operation, 5.8 or 11.6 litres Ansulex LpH™ liquid agent	591a/01



**PART 4: SECTION 3**  
FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT

Product Name	Designation	Description	LPCB Ref. No.
Piranha	Double Tank System (4.5 or 6 US gallon)	Manual and automatic operation 17.1 or 22.7 litres Ansulex LpH™ liquid agent	591a/02
	Multiple Tank System	Manual and automatic operation, 28.4 - 170 litres Ansulex LpH™ liquid agent	
	Single Tank System (1.5, 2.25 or 3 US gallon)	Manual and automatic operation, 5.7, 8.5 or 11.4 litres PRX™ liquid agent	
	Multiple Tank System	Manual and automatic operation, 11.4 to 34.2 litres PRX™ liquid agent	

### Buckeye Fire Equipment

110 Kings Road, Kings Mountain, 28086, USA  
Tel: +1 704-739-7415 • Fax: +1 704-739-7418  
E-mail: [beuler@buckeyef.com](mailto:beuler@buckeyef.com) • Website: [www.buckeyefire.com](http://www.buckeyefire.com)

Certificate No: 1467a to LPS 1223: Issue 2.3

#### ***Kitchen Mister Fixed Fire Extinguishing System for Catering Equipment***

Product Name	Designation	Description	LPCB Ref. No.
Kitchen Mister Restaurant Cooking Area Fire Suppression System	BFR-5	Manual and automatic operation, 7.2 litres wet chemical agent, maximum of 5 flow points	1467a/01
	BFR-10	Manual and automatic operation, 14.4 litres wet chemical agent, maximum of 10 flow points	1467a/02
	BFR-15	Manual and automatic operation, 21.6 litres wet chemical agent, maximum of 15 flow points	1467a/03
	BFR-20	Manual and automatic operation, 28.8 litres wet chemical agent, maximum of 20 flow points	1467a/04

**Notes:**

Buckeye Fire Equipment, Kitchen Mister Restaurant Cooking Area Fire Suppression System, shall be installed, commissioned and maintained in accordance with the system manual 'BFR-TM', Revision 5 dated January 1, 2013.

### Ceasefire Industries Pvt. Ltd

Plot No. 4, Second Floor, Sector - 135, Noida, Uttar Pradesh 201301, India  
Tel: +91 120 4255800 • Fax: +91 120 4255801  
E-mail: [amit@ceasefire.in](mailto:amit@ceasefire.in) • Website: [www.ceasefire.in](http://www.ceasefire.in)

Certificate No: 1329a to LPS 1223: issue 2.3

#### ***Restaurant Fire Suppression System***

Product Name	Designation	Description	LPCB Ref. No.
Ceasefire wet chemical kitchen suppression system, 11.5 litre capacity (2)	1 x 11.5 litre	Manual and Automatic operation, Wet chemical extinguishant	1329a/4
Ceasefire wet chemical kitchen suppression system, 15.6 litre capacity (2)	1 x 15.6 litre	Manual and Automatic operation, Wet chemical extinguishant	1329a/5
Ceasefire wet chemical kitchen suppression system, 25 litre capacity (2)	1 x 25 litre	Manual and Automatic operation, Wet chemical extinguishant	1329a/6
Ceasefire Kitchen Safe Enviro Series water mist suppression system (3)	11.5 litre	Manual and automatic operation, water mist extinguishant	1329a/7

## **PART 4: SECTION 3**

### **FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
	27 litre	Manual and automatic operation, water mist extinguishant	1329a/8
	56 litre	Manual and automatic operation, water mist extinguishant	1329a/9
Ceasefire Kitchen Safe Ultra Series wet chemical suppression system (4)	11.5 litre	Manual and automatic operation, wet chemical extinguishant	1329a/10
	18 litre	Manual and automatic operation, wet chemical extinguishant	1329a/11
	27 litre	Manual and automatic operation, wet chemical extinguishant	1329a/12
Ceasefire Kitchen Safe Ultra + Series wet chemical suppression system (5)	11.5 litre	Manual and automatic operation, wet chemical extinguishant	1329a/13
	18 litre	Manual and automatic operation, wet chemical extinguishant	1329a/14
	27 litre	Manual and automatic operation, wet chemical extinguishant	1329a/15

#### **Ceodeux Extinguisher Valves Technology S.A. (ROTAREX FIRETEC)**

24 rue de Diekirch, L-7440 Lintgen, Luxembourg

Tel: +352 32 78 32-1 • Fax: +352 32 78 32-326

E-mail: [info@firetec.rotarex.com](mailto:info@firetec.rotarex.com) • Website: [www.rotarex.com](http://www.rotarex.com)

Certificate No: 724b to LPS 1223: Issue 2.3

#### **ROTAREX FIRETEC – TRIPLESTAR wet chemical, restaurant fire suppression system**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
TRIPLESTAR, restaurant fire suppression system.	9 liters wet chemical extinguishant <sup>1</sup>	Manual and Automatic operation, 9 liters of agent, 3 nozzles.	724b/01
	16 liters wet chemical extinguishant <sup>2</sup>	Manual and Automatic operation, 16 liters of agent, 4 to 6 nozzles.	724b/03
	25 liters wet chemical extinguishant <sup>2</sup>	Manual and Automatic operation, 25 liters of agent, 7 to 9 nozzles.	724b/04

#### **Emirates Fire Fighting Equipment Factory L.L.C. (FIREX)**

P.O.Box 22436, Industrial Area 13, Sharjah, United Arab Emirates

Tel: +971 6 5340300 • Fax: +971 6 5340090

E-mail: [firex@emirates.net.ae](mailto:firex@emirates.net.ae) • Website: [www.firexuae.com](http://www.firexuae.com)

Certificate No: 863f to LPS 1223: Issue 2.3

#### **FIREX FX-KHS (Kitchen Hood System) Fixed Fire Extinguishing System for Catering Equipment**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
FIREX FX-KHS Kitchen Hood System	KHSC10	Manual and automatic operation, wet chemical, 1 x 10 litre cylinder.	863f/01
	KHSC20	Manual and automatic operation, wet chemical, 1 x 20 litre cylinder.	863f/02

Note:

Emirates Fire Fighting Equipment Factory L.L.C. (FIREX), FX-KHS (Kitchen Hood System) fixed fire extinguishing system for catering equipment, shall be installed, commissioned and maintained in accordance with the FIREX FX-KHS system manual 'Manual for Fixed Fire Extinguishing System for Catering Equipment' Rev. 1 dated 14/12/2016.

### Finder Yangin Güvenlik Elektronik Sistemler A.Ş

Kepez Mh, 5071 Sk. No: 10, Kepez, Antalya 07090, Turkey  
Tel: +90 242 221 40 07 • Fax: +90 242 259 28 88  
E-mail: info@finder.com.tr • Website: www.finder.com.tr

Certificate No: 1530a to LPS 1223: Issue 2.3

#### **'Defender DM' and 'Defender DP' Fixed Fire Extinguishing Systems for Catering Equipment**

Product Name	Designation	Description	LPCB Ref. No.
Defender DM Kitchen Extinguishing System	DM8	Manual and automatic operation, 9.5 litres Fire Eraser wet chemical agent, maximum of 8 flow points	1530a/01
	DM12	Manual and automatic operation, 15 litres Fire Eraser wet chemical agent, maximum of 12 flow points	1530a/02
	DM18	Manual and automatic operation, 22.7 litres Fire Eraser wet chemical agent, maximum of 18 flow points	1530a/03
Defender DP Kitchen Extinguishing System	DP4	Manual and automatic operation, 6 litres Fire Eraser wet chemical agent, maximum of 4 flow points	1530a/04
	DP8	Manual and automatic operation, 9.5 litres Fire Eraser wet chemical agent, maximum of 8 flow points	1530a/05
	DP16	Manual and automatic operation, 20 litres Fire Eraser wet chemical agent, maximum of 16 flow points	1530a/06

### Jactone Products Limited

Springvale Business Park, Springvale Avenue, Bilston, West Midlands WV14 0QL, United Kingdom  
Tel: +44 (0)1902 357777 • Fax: +44 (0)1902 357711  
E-mail: sales@jactone.com • Website: www.jactone.com

Certificate No: 783c to LPS 1223: issue 2.3

#### **'PAFSS KitchenGuard' Fixed Fire Extinguishing Systems for Catering Equipment**

Product Name	Designation	Description	LPCB Ref. No.
PAFSS KitchenGuard restaurant fire suppression system	FSGA8L	Manual and Automatic operation, wet chemical, 1 x 8 litre cylinder.	783c/04
	FSGA12L	Manual and Automatic operation, wet chemical, 1 x 12 litre cylinder.	783c/05

### Lehavot Production & Protection (1995) Ltd

Kibbutz Lehavot Habashan, Upper Galille, 1212500, Israel  
Tel: +972 523493146 • Fax: +972 4 6952118  
E-mail: Israels@lehavot.com • Website: www.lehavot.com

Certificate No: 1553a to LPS 1223: Issue 2.3

#### **Restaurant Fire Suppression System**

Product Name	Designation	Description	LPCB Ref. No.
WCK – kitchen fire suppression system, wet chemical	WCK 6 liter	Manual and automatic operation, wet chemical extinguishant	1553a/01

## **PART 4: SECTION 3**

### **FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
	WCK 9 liter	Manual and automatic operation, wet chemical extinguishant	1553a/02
	WCK 16 liter	Manual and automatic operation, wet chemical extinguishant	1553a/03
	WCK 20 liter	Manual and automatic operation, wet chemical extinguishant	1553a/04
	WCK 26 liter	Manual and automatic operation, wet chemical extinguishant	1553a/05
	WCK 16 liter +	Manual and automatic operation, wet chemical extinguishant	1553a/06
	WCK 6 liter		
	WCK 16 liter +	Manual and automatic operation, wet chemical extinguishant	1553a/07
	WCK 9 liter		
	WCK 16 liter +	Manual and automatic operation, wet chemical extinguishant	1553a/08
	WCK 16 liter		

#### **MOBIAK S.A.**

96-98 M. Mpotsari St, Chania, Crete 73136, Greece

Tel: +30 28210 63222 • Fax: +30 28210 66260

E-mail: sales@mobiak.gr • Website: <http://www.mobiak.gr>

Certificate No: 1534a to LPS 1223: Issue 2.3

#### **'Alexander The Great Kitchen System' Fixed Fire Extinguishing Systems for Catering Equipment**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
Alexander The Great Kitchen System	MBK15-090FCS-LPCB (0501091)	Manual and automatic operation 9 litres wet chemical agent maximum of 4 nozzles	1534a/01
	MBK15-120FCS-LPCB (0501105)	Manual and automatic operation 12 litres wet chemical agent maximum of 6 nozzles	1534a/02
	MBK15-160FCS-LPCB (0501106)	Manual and automatic operation 16 litres wet chemical agent maximum of 8 nozzles	1534a/03

A copy of the certificate, confirming the full scope of approval including notes relating to the superscript references in the above table, may be viewed online by clicking on the certificate link in the associated entry on [www.RedBookLive.com](http://www.RedBookLive.com)

#### **Spoon2 International Limited**

Haselor Lane, Hinton on the Green, Worcestershire WR11 2QZ, United Kingdom

Tel: +44 (0) 1386 861344 • Fax: +44 (0) 1386 861452

E-mail: info@spoon2.com • Website: [www.spoon2.com](http://www.spoon2.com)

Certificate No: 970a to LPS 1223

#### **Brand name "Spoon2"**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
SP2	SP2 - 1	Manual and automatic operation, 14, 28 or 42 litres Spoon2 K2 liquid agent	970a/01
	SP2 - 2	Manual and automatic operation, 56, 70 or 84 litres Spoon2 K2 liquid agent	
	SP2 - 3	Manual and automatic operation, 98, 112 or 126 litres Spoon2 K2 liquid agent	
	SP2 - 4	Manual and automatic operation, 141, 155 or 169 litres Spoon2 K2 liquid agent	
	SP2 - 5	Manual and automatic operation, 183, 197 or 211 litres Spoon2 K2 liquid agent	

SP2 systems shall be designed, installed and maintained in accordance with Spoon2 International limited  
Installation manual 1004 July 09, Testing and commissioning manual 206 July 09, Recharging manual 304 July 09, Operating and maintenance manual 302 QMF 22 Issue 1 June 09, Service manual 407 July 09.

**PART 4: SECTION 3**  
FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT

Certificate No: 970a to LPS 1223

**Brand name "Fireguard"**

Product Name	Designation	Description	LPCB Ref. No.
K2	K2 - 1	Manual and automatic operation, 14, 28 or 42 litres Spoon2 K2 liquid agent	970a/01
	K2 - 2	Manual and automatic operation, 56, 70 or 84 litres Spoon2 K2 liquid agent	
	K2 - 3	Manual and automatic operation, 98, 112 or 126 litres Spoon2 K2 liquid agent	
	K2 - 4	Manual and automatic operation, 141, 155 or 169 litres Spoon2 K2 liquid agent	
	K2 - 5	Manual and automatic operation, 183, 197 or 211 litres Spoon2 K2 liquid agent	

SP2 & K2 systems shall be designed, installed and maintained in accordance with Spoon2 International limited Installation manual 1004 July 09, Testing and commissioning manual 206 July 09, Recharging manual 304 July 09, Operating and maintenance manual 302 QMF 22 Issue 1 June 09, Service manual 407 July 09.

**Steel Recon Industries Sdn Bhd**

No 8 Jalan Subang 7, Taman Perindustrian Subang, 47610 Subang Jaya, Selangor Darul Ehsan, Malaysia  
Tel: +603 8023 2323 • Fax: +603 8023 2828  
E-mail: ck.wee@sri.com.my • Website: www.sri.com.my

Certificate No: 1239Ab to LPS 1223: issue 2.3

**Kitchen Shield F808, wet chemical, restaurant fire suppression system**

Product Name	Designation	Description	LPCB Ref. No.
Kitchen Shield F808, wet chemical, restaurant fire suppression system.	F8081000	9 litre, Manual and Automatic operation, wet chemical extinguishant	1239Ab/01
	F8082000	2 X 6 litre, Manual and Automatic operation, wet chemical extinguishant	1239Ab/02
	F8083000	2 X 9 litre, Manual and Automatic operation, wet chemical extinguishant	1239Ab/03

**Note:**

Steel Recon Industries Sdn Bhd, wet chemical restaurant fire suppression systems shall be installed, maintained and operated in accordance with Steel Recon Industries Sdn Bhd, Installation and Maintenance Handbook version 1.5 dated 6 March 2014 Rev.

Certificate No: 1435a to LPS 1223: issue 2.3

**KitchenShield, fire detection and suppression system for commercial kitchens and deep fat fryers**

Product Name	Designation	Description	LPCB Ref. No.
KitchenShield, fire detection and suppression system for commercial kitchens and deep fat fryers.	SPS-KS014-CYL-15L	8 litre, Manual and automatic operation, wet chemical extinguishant	1435a/01
	SPS-KS014-CYL-12L	10 litre, Manual and automatic operation, wet chemical extinguishant	1435a/02
	SPS-KS014-CYL-20L	12 or 15 litre, Manual and automatic operation, wet chemical extinguishant	1435a/03
	SPS-KS014-CYL-30L	17, 19 or 22 litre, Manual and automatic operation, wet chemical extinguishant	1435a/04
	SPS-KS014-CYL-35L	24 or 26 litre, Manual and automatic operation, wet chemical extinguishant	1435a/05

**Note:**

Steel Recon Industries Sdn Bhd, wet chemical restaurant fire suppression systems shall be installed, maintained and operated in accordance with Steel Recon Industries Sdn Bhd, Fire Detection and Suppression System Manual for Commercial Kitchens and Deep Fat Fryer, version 6/date: 25 January 2018.

## **PART 4: SECTION 3**

### **FIXED FIRE EXTINGUISHING SYSTEMS FOR CATERING EQUIPMENT**

#### **Telesto Sp. z o.o.**

Ul. Fabryczna 5, 26-130 Suchedniow, Poland

Tel: +48 22 489 6571 • Fax: +48 22 648 8764

E-mail: [telesto@telesto.pl](mailto:telesto@telesto.pl) • Website: [www.telesto.pl](http://www.telesto.pl)

Certificate No: 1129a to LPS 1223: issue 2.3

#### **"Safety Chef" Restaurant Fire Suppression System**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
SafetyChef	320 cm	Manual and Automatic operation, water mist restaurant suppression system up to 320 cm protected length supplied from single or manifold containers, 12.27, 30 and 50 litre volumes.	1129a/01
	800 cm	Manual and Automatic operation, water mist restaurant suppression system up to 800 cm protected length supplied from single or manifold containers, 12.27, 30 and 50 litre volumes.	1129a/02

#### **Notes:**

1. "SafetyChef" restaurant water mist suppression systems shall be installed, maintained and operated in accordance with Telesto Sp. z o.o SafetyChef fire extinguishing mist system installation, operation and maintenance manual No. SGMP-K/IMS/5 Rev. 5 dated 22.05.2015, and Telesto SafetyChef system technical specification No. SGMP-K/DTI/6 Rev 6 dated 22.05.2015.

2. For use only with Fusible link, glass bulb and pneumatic detection systems as detailed in Telesto SafetyChef system technical specification No. SGMP-K/DTI/6 Rev 6 dated 22.05.2015.

#### **Watermist Ltd**

Amber House, Station Road, Attleborough, Norfolk NR17 2AT, United Kingdom

Tel: +44 (0)800 731 9288 • Fax:

E-mail: [info@hydramist.co.uk](mailto:info@hydramist.co.uk) • Website: [www.hydramist.co.uk](http://www.hydramist.co.uk)

Certificate No: 1077a to LPS 1223

#### **Hydramist Fire Suppression System for Catering Equipment**

<b>Product Name</b>	<b>Designation</b>	<b>Description</b>	<b>LPCB Ref. No.</b>
Hydramist 15AMPU	Single phase electric pump system	Manual and Automatic operation, potable water used to produce water mist extinguishant	1077a/01
Hydramist 18AMPU	Three phase electric pump system	Manual and Automatic operation, potable water used to produce water mist extinguishant	1077a/02

(A)MPU system shall be designed, installed and maintained in accordance with the Hydramist System Manual (A)MPU-D02 issue 6 (16/02/15) and Hydramist Service Manual (A)MPU-D05. Section 12 of the system manual details the design parameters for the system applications.

The approval of the fire suppression systems listed in this section is based on LPS 1666: Issue 1.0 *Requirements and test procedures for the LPCB approval of direct low pressure (DLP) application fixed fire suppression systems, using heat sensitive pneumatic detection tubing, for the protection of small defined volume unoccupied enclosures.*

This standard specifies the requirements and test procedures for LPCB approval of direct low pressure (DLP) application fixed fire suppression systems, using heat sensitive pneumatic detection tubing, designed for the protection of small unoccupied defined volume enclosures such as electrical switchgear cabinets, server racking and similar installations from small local flaming fire sources.

The objective of the approval is to assess the ability of the system to prevent fire spread between units by evaluating the effectiveness and reliability of a system to detect and extinguish the fire at its source. The system shall also be capable of isolating the power to the protected enclosures and generating a signal for an alarm. The evaluation of a system is essentially a verification of the parameters specified in the system manual.

The selection and specification of fire protection equipment should be based on the completion of a suitable risk assessment and local regulatory requirements.

**These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.**

The requirements and test procedures specified herein are those which generally enable a satisfactory evaluation of a system to be made. However, the LPCB reserves the right to apply special considerations dependant on the scope of application of a particular system if it is not adequately dealt with by this standard.

The scheme provides approval for systems with:

- A single container heat detection tube installation run protecting a maximum single volume of 2m<sup>3</sup>.
- Up to 4 heat detection tube runs connected to a single container where no single protected volume exceeds a 2m<sup>3</sup> volume.
- A maximum heat detection tube length of 10m from the container outlet to the end of any single detection tube run.

The range of materials and products employed within these enclosed volumes is large and whilst this scheme addresses a number of potential fire scenarios it cannot be considered to address all applications in particular where the electrical power supply is not isolated/removed upon activation of the suppression system and the risk of re-ignition remains high.

### **AIR Fire S.p.A.**

Via Tenuta della Mistica - 33/37, Rome 00155, Italy

Tel: +34 680395217

E-mail: [info@airfire.eu](mailto:info@airfire.eu) • Website: [www.airfire.eu](http://www.airfire.eu)

Certificate No: 1408b to LPS 1666: Issue 1.0

#### **ARMANfire HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
ARF22701TB	1.3 Litre	1 kg HFC-227ea DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408b/01
ARF22702TB	3.8 Litre	2 kg HFC-227ea DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408b/02
ARF22703TB	3.8 Litre	3 kg HFC-227ea DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408b/03

## **PART 4: SECTION 4**

### **DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
ARF22704TB	7.5 Litre	4 kg HFC-227ea DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408b/04
ARF22706TB	7.5 Litre	6 kg HFC-227ea DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408b/05

Certificate No: 1408c to LPS 1666: Issue 1.0

#### **ARMANfire FK-5-1-12 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
ARFFK501TB	1.3 Litre	1 kg FK-5-1-12 DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408c/01
ARFFK502TB	3.8 Litre	2 kg FK-5-1-12 DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408c/02
ARFFK503TB	3.8 Litre	3 kg FK-5-1-12 DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408c/03
ARFFK504TB	7.5 Litre	4 kg FK-5-1-12 DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408c/04
ARFFK506TB	7.5 Litre	6 kg FK-5-1-12 DLP system	P/N: 125101 6mm o/d	Enclosed & open options <sup>4</sup>	Natural airflow only	1408c/05

### **Ceasefire Industries Pvt. Ltd**

Plot No. 4, Second Floor, Sector - 135, Noida, Uttar Pradesh 201301, India

Tel: +91 120 4255800 • Fax: +91 120 4255801

E-mail: amit@ceasefire.in • Website: www.ceasefire.in

Certificate No: 1329c to LPS 1666: Issue 1.0

#### **Ceasefire Industries Ltd HFC-236fa Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
CF-000792	2 kg	2 kg HFC-236fa DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329c/01
CF-000793	4 kg	4 kg HFC-236fa DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329c/02

#### **Notes:**

- 1) Ceasefire Industries Ltd HFC-236fa DLP Systems shall be configured, installed, serviced and maintained in accordance with Ceasefire Industries Ltd System Manual CQRS/DIR/MAN/01 Version.01 Rev.04 - 16.04.2018.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 15 bar @ 20°C.
  - System operation temperature range: -20°C to +60°C.
- 4) The above systems may have air vents at low and/or high level (refer note 1).
- 5) The above systems may have forced ventilation (refer note 1).



**PART 4: SECTION 4**  
DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS

Certificate No: 1329d to LPS 1666: Issue 1.0

**Ceasefire Industries Ltd HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
CF-000880	2 kg	2 kg HFC-227ea DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329d/01
CF-000881	4 kg	4 kg HFC-227ea DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329d/02

**Notes:**

- 1) Ceasefire Industries Ltd HFC-227ea DLP Systems shall be configured, installed, serviced and maintained in accordance with Ceasefire Industries Ltd System Manual CQRS/DIR/MAN/01 Version.01 Rev.04 - 16.04.2018.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 15 bar @ 20°C.
  - System operation temperature range: -20°C to +60°C.
- 4) The above systems may have air vents at low and/or high level (refer note 1).
- 5) The above systems may have forced ventilation (refer note 1).

Certificate No: 1329k to LPS 1666: Issue 1.0

**Ceasefire Industries Pvt. Ltd FK-5-1-12 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
CF-000792A	2 kg	2 kg FK-5-1-12 DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329k/01
CF-000792B	3 kg	3 kg FK-5-1-12 DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329k/02
CF-000792C	4 kg	4 kg FK-5-1-12 DLP system	P/N:TI-000010A 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	1329k/03

**EKC International FZE**

P.O. Box 61041, Jebel Ali, Dubai, United Arab Emirates  
Tel: +971 4 886 5992 • Fax: +971 4 886 5006  
E-mail: [design@ekcfire.com](mailto:design@ekcfire.com) • Website: [www.ekcfire.com](http://www.ekcfire.com)

Certificate No: 1400Ba to LPS 1666: Issue 1.0

**EKC International FZE 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
EKC-920205	2.5 lb	2.5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/01
	2.5 lb	2.5 lb Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/02

## **PART 4: SECTION 4**

### **DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
EKC-898001	1 kg	1 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/03
	1 kg	1 kg Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/04
EKC-920505	5 lb	5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/05
	5 lb	5 lb Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/06
EKC-898002	2 kg	2 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/07
	2 kg	2 kg Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/08
EKC-921005	10 lb	10 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/09
	10 lb	10 lb Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/10
EKC-898003	5 kg	5 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ba/11
	5 kg	5 kg Novec™ 1230 DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Ba/12

#### **Notes:**

- 1) EKC International FZE 3MTM Novec™ 1230 DLP Systems shall be configured, installed, serviced and maintained in accordance with EKC International FZE System Manual EKC-800035-000 - 11/08/2017.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.

- System operation pressure: 195 psig @ 70°F (13.5 bar @ 21.1°C).

- System operation temperature range: -20°C to +60°C.

**Certificate No: 1400Bb to LPS 1666: Issue 1.0**

### **EKC International FZE HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
EKC-920301	3 lb	3 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/01
	3 lb	3 lb HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/02
EKC-898004	1 kg	1 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/03
	1 kg	1 kg HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/04
EKC-920601	6 lb	6 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/05
	6 lb	6 lb HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/06
EKC-898005	2 kg	2 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/07
	2 kg	2 kg HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/08
EKC-921201	12 lb	12 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/09
	12 lb	12 lb HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/10
EKC-898006	5 kg	5 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Bb/11
	5 kg	5 kg HFC-227ea DLP system	P/N: 200007 8mm o/d	Enclosed only	None	1400Bb/12

**PART 4: SECTION 4**  
DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS

**Notes:**

- 1) EKC International FZE HFC-227ea DLP Systems shall be configured, installed, serviced and maintained in accordance with EKC International FZE System Manual EKC-800023-000 - 11/08/2017.
  - 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
  - 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
- System operation pressure: 150 psig @ 70°F (10.3 bar @ 21.1°C).
- System operation temperature range: -20°C to +60°C.

**Firetrace International LLC**

Suite 2, 8435 N. 90th Street, Scottsdale, Arizona 85258, USA  
 Tel: +1 480 607 1218 • Fax: +1 480 315 1316  
 E-mail: info@firetrace.com • Website: http://www.firetrace.com

Certificate No: 1400a to LPS 1666: Issue 1.0

**Firetrace International LLC 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
920205	2.5 lb	2.5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/01
898001	1 kg	1 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/03
920505	5 lb	5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/05
898002	2 kg	2 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/07
921005	10 lb	10 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/09
898003	5 kg	5 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400a/11

**Notes:**

- 1) Firetrace International LLC 3M™ Novec™ 1230 DLP Systems shall be configured, installed, serviced and maintained in accordance with Firetrace International LLC System Manual 800035-003 – 12/01/2017.
  - 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
  - 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
- System operation pressure: 195 psig @ 70°F (13.5 bar @ 21.1°C).
- System operation temperature range: -20°C to +60°C.

Certificate No: 1400b to LPS 1666: Issue 1.0

**Firetrace International LLC HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
920301	3 lb	3 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/01
898004	1 kg	1 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/03
920601	6 lb	6 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/05

## **PART 4: SECTION 4**

### **DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
898005	2 kg	2 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/07
921201	12 lb	12 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/09
898006	5 kg	5 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400b/11

#### **Notes:**

- 1) Firetrace International LLC HFC-227ea DLP Systems shall be configured, installed, serviced and maintained in accordance with Firetrace International LLC System Manual 800023-006 – 12/01/2017.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 150 psig @ 70°F (10.3 bar @ 21.1°C).
  - System operation temperature range: -20°C to +60°C.

### **Firetrace Limited**

Unit 22, Knightsdale Road, Ipswich, Suffolk IP1 4JJ, United Kingdom

Tel: 01473 744090 • Fax: 01473744901

E-mail: [info@firetrace.co.uk](mailto:info@firetrace.co.uk) • Website: [www.firetrace.co.uk](http://www.firetrace.co.uk)

Certificate No: 1430a to LPS 1666: Issue 1.0

### **Firetrace® Ltd 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
2Kg Firetrace®	2 kg	2 kg Novec™ 1230 DLP system	FT0115	Enclosed only	None	1430a/01

#### **Notes:**

- 1) Firetrace Ltd. 3M™ Novec™ 1230 DLP Systems shall be configured, installed, serviced and maintained in accordance with Firetrace Ltd. System Manual FIRETRACE LPCB 1116 - 04/03/2017.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 12 bar @ 20°C.
  - System operation temperature range: -20°C to +60°C.

### **Jactone Products Limited**

Springvale Business Park, Springvale Avenue, Bilston, West Midlands WV14 0QL, United Kingdom

Tel: +44 (0)1902 357777 • Fax: +44 (0)1902 357711

E-mail: [sales@jactone.com](mailto:sales@jactone.com) • Website: [www.jactone.com](http://www.jactone.com)

Certificate No: 783d to LPS 1666: Issue 1.0

**PART 4: SECTION 4****DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS****Jactone® PAFSS® 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
PAFSSND2	2 kg	2 kg Novec™ 1230 DLP system	FSTFV300	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	783d/01
PAFSSND25	2.5 kg	2.5 kg Novec™ 1230 DLP system	FSTFV300	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	783d/02
PAFSSND3	3 kg	3 kg Novec™ 1230 DLP system	FSTFV300	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	783d/03

**Macron Safety Systems (UK) Ltd**

Burlingham House, Hewett Road, Gapton Hall Industrial Estate, Great Yarmouth, Norfolk NR31 0NN, United Kingdom

Tel: +44 (0)1493 417600 • Fax: +44 (0)1493 417700

E-mail: [info@tycoint.com](mailto:info@tycoint.com) • Website: [www.macron-safety.com](http://www.macron-safety.com)

Certificate No: 587c to LPS 1666: Issue 1.0

**SAPPHIRE COMPACT 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
3031500XX (F13516)	2 kg	SAPPHIRE COMPACT 2kg DLP system	304150013	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	587c/01
3031500XX (F13517)	2.5 kg	SAPPHIRE COMPACT 2.5kg DLP system	304150013	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	587c/02
3031500XX (F13518)	3 kg	SAPPHIRE COMPACT 3kg DLP system	304150013	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	587c/03

**NAFFCO FZ Co**

PO Box 17014, Jebel Ali, Dubai, United Arab Emirates

Tel: +971 4815111 • Fax: +971 48151222

E-mail: [natfire@emirates.net.ae](mailto:natfire@emirates.net.ae) • Website: [www.naffco.com](http://www.naffco.com)

Certificate No: 463p to LPS 1666: Issue 1.0

**Naffco FZ Co HFC-236fa Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
NF01DLP236-1	1.2 Litre	0.75 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/01
NF01DLP236-2	2.6 Litre	1.5 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/02
NF01DLP236-3	3.8 Litre	2.5 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/03
NF01DLP236-4	4.8 Litre	3.5 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/04
NF01DLP236-5	2.6 Litre	2 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/05
NF01DLP236-6	3.8 Litre	3 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/06
NF01DLP236-7	4.8 Litre	4 kg HFC-236fa DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463p/07

Notes:

## **PART 4: SECTION 4**

### **DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS**

- 1) Naffco FZ Co HFC-236fa DLP Systems shall be configured, installed, serviced and maintained in accordance with Naffco FZ Co System Manual NF01DLP236M Rev No.00 Issue:B - 18/09/2018.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 12 bar @ 21.1°C.
  - System operation temperature range: -20°C to +60°C.
- 4) The above systems may have air vents at low and/or high level (refer note 1).
- 5) The above systems may have forced ventilation (refer note 1).

**Certificate No: 463q to LPS 1666: Issue 1.0**

#### ***Naffco FZ Co HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems***

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
NF01DLP227-1	1.2 Litre	0.75 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/01
NF01DLP227-2	2.6 Litre	1.5 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/02
NF01DLP227-3	3.8 Litre	2.5 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/03
NF01DLP227-4	4.8 Litre	3.5 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/04
NF01DLP227-5	2.6 Litre	2 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/05
NF01DLP227-6	3.8 Litre	3 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/06
NF01DLP227-7	4.8 Litre	4 kg HFC-227ea DLP system	P/N: NF07800301 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463q/07

#### **Notes:**

- 1) Naffco FZ Co HFC-227ea DLP Systems shall be configured, installed, serviced and maintained in accordance with Naffco FZ Co System Manual NF01DLP227M Rev No.00 Issue:B - 18/09/2018.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
  - System operation pressure: 12 bar @ 21.1°C.
  - System operation temperature range: -20°C to +60°C.
- 4) The above systems may have air vents at low and/or high level (refer note 1).
- 5) The above systems may have forced ventilation (refer note 1).

**Certificate No: 463r to LPS 1666: Issue 1.0**

#### ***Naffco FZ Co HFC-236fa Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems***

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
NF02DLP236-1	1.2 Litre	0.75 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/01
NF02DLP236-2	2.6 Litre	1.5 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/02
NF02DLP236-3	3.8 Litre	2.5 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/03
NF02DLP236-4	4.8 Litre	3.5 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/04

## PART 4: SECTION 4

### DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
NF02DLP236-5	2.6 Litre	2 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/05
NF02DLP236-6	3.8 Litre	3 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/06
NF02DLP236-7	4.8 Litre	4 kg HFC-236fa DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463r/07

Certificate No: 463s to LPS 1666: Issue 1.0

#### **Naffco FZ Co HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
NF02DLP227-1	1.2 Litre	0.75 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/01
NF02DLP227-2	2.6 Litre	1.5 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/02
NF02DLP227-3	3.8 Litre	2.5 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/03
NF02DLP227-4	4.8 Litre	3.5 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/04
NF02DLP227-5	2.6 Litre	2 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/05
NF02DLP227-6	3.8 Litre	3 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/06
NF02DLP227-7	4.8 Litre	4 kg HFC-227ea DLP system	P/N: NF07800302 6mm o/d	Enclosed & open options <sup>4</sup>	Forced & natural <sup>5</sup>	463s/07

### Regulus Fire Systems

Suite 2, 8435 N. 90th Street, Scottsdale, Arizona 85258, USA

Tel: +1 480 607 1218 • Fax: +1 480 315 1316

E-mail: [info@regulusfire.com](mailto:info@regulusfire.com) • Website: [www.regulusfire.com](http://www.regulusfire.com)

Certificate No: 1400Aa to LPS 1666: Issue 1.0

#### **Regulus Fire Systems 3M™ Novec™ 1230 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

Product Name	Container Size	Description	Detector Tube	Ventilation (Enclosed or Open Vents)	Air Flow (Forced / Natural)	LPCB Ref. No.
02-921542	2.5 lb	2.5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/01
02-899338	1 kg	1 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/03
02-921842	5 lb	5 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/05
02-899339	2 kg	2 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/07
02-922342	10 lb	10 lb Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/09
02-899340	5 kg	5 kg Novec™ 1230 DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Aa/11

#### Notes:

- 1) Regulus Fire Systems 3MTM NovecTM 1230 DLP Systems shall be configured, installed, serviced and maintained in accordance with Regulus Fire Systems System Manual 02-801372-000 - 11/08/2017.
- 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.

## **PART 4: SECTION 4**

### **DIRECT LOW PRESSURE (DLP) APPLICATION SYSTEMS**

- 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
- System operation pressure: 195 psig @ 70°F (13.5 bar @ 21.1°C).
  - System operation temperature range: -20°C to +60°C.

Certificate No: 1400Ab to LPS 1666: Issue 1.0

#### **Regulus Fire Systems HFC-227ea Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
02-921638	3 lb	3 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/01
02-899341	1 kg	1 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/03
02-921938	6 lb	6 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/05
02-899342	2 kg	2 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/07
02-922538	12 lb	12 lb HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/09
02-899343	5 kg	5 kg HFC-227ea DLP system	P/N: 200005 6mm o/d	Enclosed only	None	1400Ab/11

#### **Notes:**

- 1) Regulus Fire Systems HFC-227ea DLP Systems shall be configured, installed, serviced and maintained in accordance with Regulus Fire Systems System Manual 02-801360-000 - 11/08/2017.
  - 2) These systems are intended solely to provide enhanced local fire protection. They are not intended for use as whole room or building fire protection systems.
  - 3) The systems use a single method for detection and delivery of the extinguishing agent to the activation point.
- System operation pressure: 150 psig @ 70°F (10.3 bar @ 21.1°C).
  - System operation temperature range: -20°C to +60°C.

#### **Resguardo Industries Pvt Ltd**

Plot No: 312 D, Harohalli Industrial Area, 2nd Phase Harohalli, Kanakapura Taluk, Ramanagara Dist-562112, Karnakata, India

Tel: 080-29760151, 9632235143

E-mail: mail@resguardo.com • Website: www.resguardo.com

Certificate No: 1604a to LPS 1666: Issue 1.0

#### **Resguardo Automatic Fire Sniper FK-5-1-12 Direct Low Pressure (DLP) Application Fixed Fire Suppression Systems**

<b>Product Name</b>	<b>Container Size</b>	<b>Description</b>	<b>Detector Tube</b>	<b>Ventilation (Enclosed or Open Vents)</b>	<b>Air Flow (Forced / Natural)</b>	<b>LPCB Ref. No.</b>
900115	1.2 Litre	1 kg FK-5-1-12 DLP system	P/N: 701007 6mm o/d	Enclosed & open options 4	Natural airflow only	1604a/01
900116	2.3 Litre	2 kg FK-5-1-12 DLP system	P/N: 701007 6mm o/d	Enclosed & open options 4	Natural airflow only	1604a/02
900117	4.7 Litre	4 kg FK-5-1-12 DLP system	P/N: 701007 6mm o/d	Enclosed & open options 4	Natural airflow only	1604a/03
900118	7.0 Litre	6 kg FK-5-1-12 DLP system	P/N: 701007 6mm o/d	Enclosed & open options 4	Natural airflow only	1604a/04





## **PART 4: SECTION 5**

### CONDENSED AEROSOL EXTINGUISHING GENERATORS

These generators comprise a non-pressurized container filled with a dry solid fire extinguishing compound which, when activated, discharges an aerosol to extinguish the fire. They are designed to be fixed in place for "total flooding" applications, where the whole protected risk area is filled to achieve a specific design application density.

Subject to satisfactory performance and function tests, including full scale fire tests, these generators can be designated for use against the following classes:

- Class A (solid surface burning fires)
- Class B (liquid pool fires)

The selection and specification of fire protection equipment should be based on the completion of a suitable risk assessment and local regulatory requirements.

Generators are typically activated by appropriate fire detectors with the aim of ensuring that they operate early in the fire development phase. Guidance on the use, limitations, safety considerations and precautions, venting and structural strength of compartments, detection, actuation and control arrangements as well as commissioning, acceptance and maintenance procedures can be found in prEN 15276 parts 1 and 2.

Condensed aerosol generators are approved on the basis that they will be installed and maintained in accordance with prEN 15276 and the manufacturer's instructions.

#### **FirePro Systems Limited**

8, Falea Street, Agios Athanasios Industrial Zone, Limassol CY4101, Cyprus

Tel: +357-25-379999 • Fax: +357-25-354432

E-mail: [info@firepro.com](mailto:info@firepro.com) • Website: [www.firepro.com](http://www.firepro.com)

Certificate No: 1417a to SD0228 and Selected Clauses of prEN15276-1 and prEN15276-2 (Sept 2017)

#### **Condensed Aerosol Generator**

Product Name	Description	LPCB Ref. No.
FP-1200 (note 1)	Condensed aerosol generator (electrical activation only) and mounting bracket	1417a/01
FP-2000 (note 1)	Condensed aerosol generator (electrical activation only) and mounting bracket	1417a/02
FP-3000 (note 1)	Condensed aerosol generator (electrical activation only) and mounting bracket	1417a/03
FP-4200 (note 2)	Condensed aerosol generator (electrical activation only) and mounting bracket	1417a/04
FP-5700 (note 1)	Condensed aerosol generator (electrical activation only) and mounting bracket	1417a/05

#### **General Notes:**

This approval covers the components listed when used in accordance with the FirePro "Instruction, information and user manual" version 7.0, dated 18<sup>th</sup> October 2017.

This approval does not cover system design, system performance or installation.

The Application Densities for these components, as defined in prEN15276-1 Clause 5.2, for the following applications are:

- Class A (surface burning fire only) - 97.6 g/m<sup>3</sup>
- Class B - 68.6 g/m<sup>3</sup>

The component approval does not cover applications for:

- Potentially Explosive Atmospheres, or
- Grouped Power or Data Cables.

#### **Table Notes:**

(1) The Product is available in 4 variants:

FP-xxxx - Mild Steel Body

FP-xxxxS - Stainless Steel Body

FP-xxxxT - Mild Steel Body; Thermal Activation Model Variant in Electrical Activation Mode Only

FP-xxxxTS - T Variant with Stainless Steel Body

(2) The Product is available in 2 variants:

FP-xxxxT - Mild Steel Body; Thermal Activation Model Variant in Electrical Activation Mode Only

FP-xxxxTS - T Variant with Stainless Steel Body

